

REVISED PER ADDENDUM NO. 4 DATED APRIL 11, 2024
JOB NO. MA24-03
KAHULUI SBH PREFABRICATED BATHROOM & WASTEWATER SYSTEM
FLOOR PLAN
(NOT TO SCALE)

~~20' x 8' SHIPPING CONTAINER WITH SIDING AND ROOF. SEE SPECIFICATIONS FOR DETAILS~~

SEE SITE PLAN REVISED PER ADDENDUM NO. 4 DATED APRIL 11, 2024 FOR LOCATION OF WASTEWATER TREATMENT SYSTEM

ADDENDUM NO. 4

ADDENDUM NO. 1


SEE NEW FLOOR PLAN ON 'PREFABRICATED BATHROOM DRAWINGS' PROVIDED WITH ADDENDUM NO. 1 DATED MARCH 25, 2024



CONC. SIDEWALK TRANSITION (~5' WIDE x 16' LONG) SLOPE TO MATCH GRADE OF EX. CONC. SIDEWALK. MAX SLOPE: 8.3%

ADDENDUM NO. 1

5' MIN.

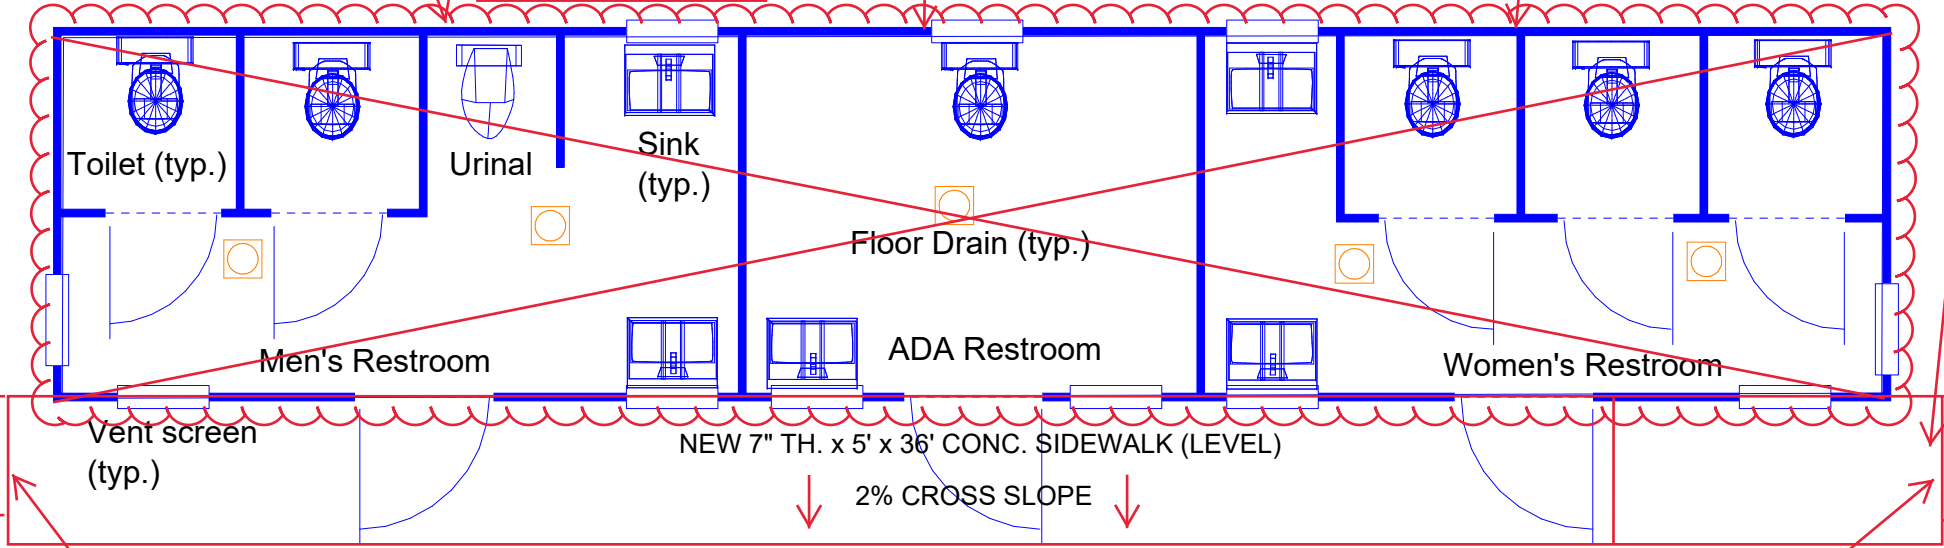

SAWCUT EX. SIDEWALK, NEW CONC. SIDEWALK TO MATCH GRADE OF EX. SIDEWALK.

SAWCUT EX. SIDEWALK, NEW CONC. SIDEWALK TO MATCH GRADE OF EX. SIDEWALK.

- NOTES:**
1. NEW CONCRETE SIDEWALK SHALL BE CONSTRUCTED SUCH THAT THRESHOLD FOR ALL RESTROOM DOORS IS FLUSH WITH SURFACE OF SIDEWALK.
 2. PRE-FABRICATED BATHROOM SHALL BE INSTALLED LEVEL. FOLLOW MANUFACTURER'S RECOMMENDATIONS FOR LEVELING.
 3. SLAB ON GRADE REINFORCEMENT SHALL BE #4 BARS AT 12" O.C.E.W.
 4. REINFORCING STEEL SHALL MEET ASTM A1035, CHROMX 4100 OR APPROVED EQUAL.
 5. MIN. CONCRETE COVER ON ALL REINFORCING STEEL SHALL BE 3".
 6. SLAB ON GRADE CONCRETE SHALL BE MIN. 4,000 PSI STRENGTH WITH CALCIUM NITRITE CORROSION INHIBITOR ADMIXTURE (3 GAL/CY).
 7. SAWCUT LINES 1/4" WIDE x 1.5" DEEP ON CONC. SIDEWALK FOR SHRINKAGE CRACK CONTROL PERPENDICULAR TO LENGTH OF SIDEWALK AT 6' O.C.
 8. SLAB ON GRADE SHALL BE PLACED ON MIN. 6" BASECOURSE COMPACTED TO 95% RELATIVE COMPACTION.