

INDEX TO DRAWINGS

SHEET NO.	TITLE
T-1	TITLE SHEET, LOCATION AND VICINITY MAPS
T-2	INDEX TO DRAWINGS AND GENERAL PLAN
S-1	STRUCTURAL NOTES
S-2	PARTIAL PIER PLAN
S-3	PARTIAL PIER PLAN
S-4	PARTIAL PIER PLAN
S-5	TYPICAL PIER SECTIONS
S-6	SLAB SOFFIT AND VERTICAL SPALL REPAIR DETAILS
S-7	BEAM SPALL REPAIR DETAILS
S-8	PILE SPALL REPAIR DETAILS
S-9	PILE SPALL REPAIR DETAILS
S-10	SPLICE DETAIL


HONOLULU HARBOR

PIER 14

SEE SHEET S-3

SEE SHEET S-4

SEE SHEET S-2

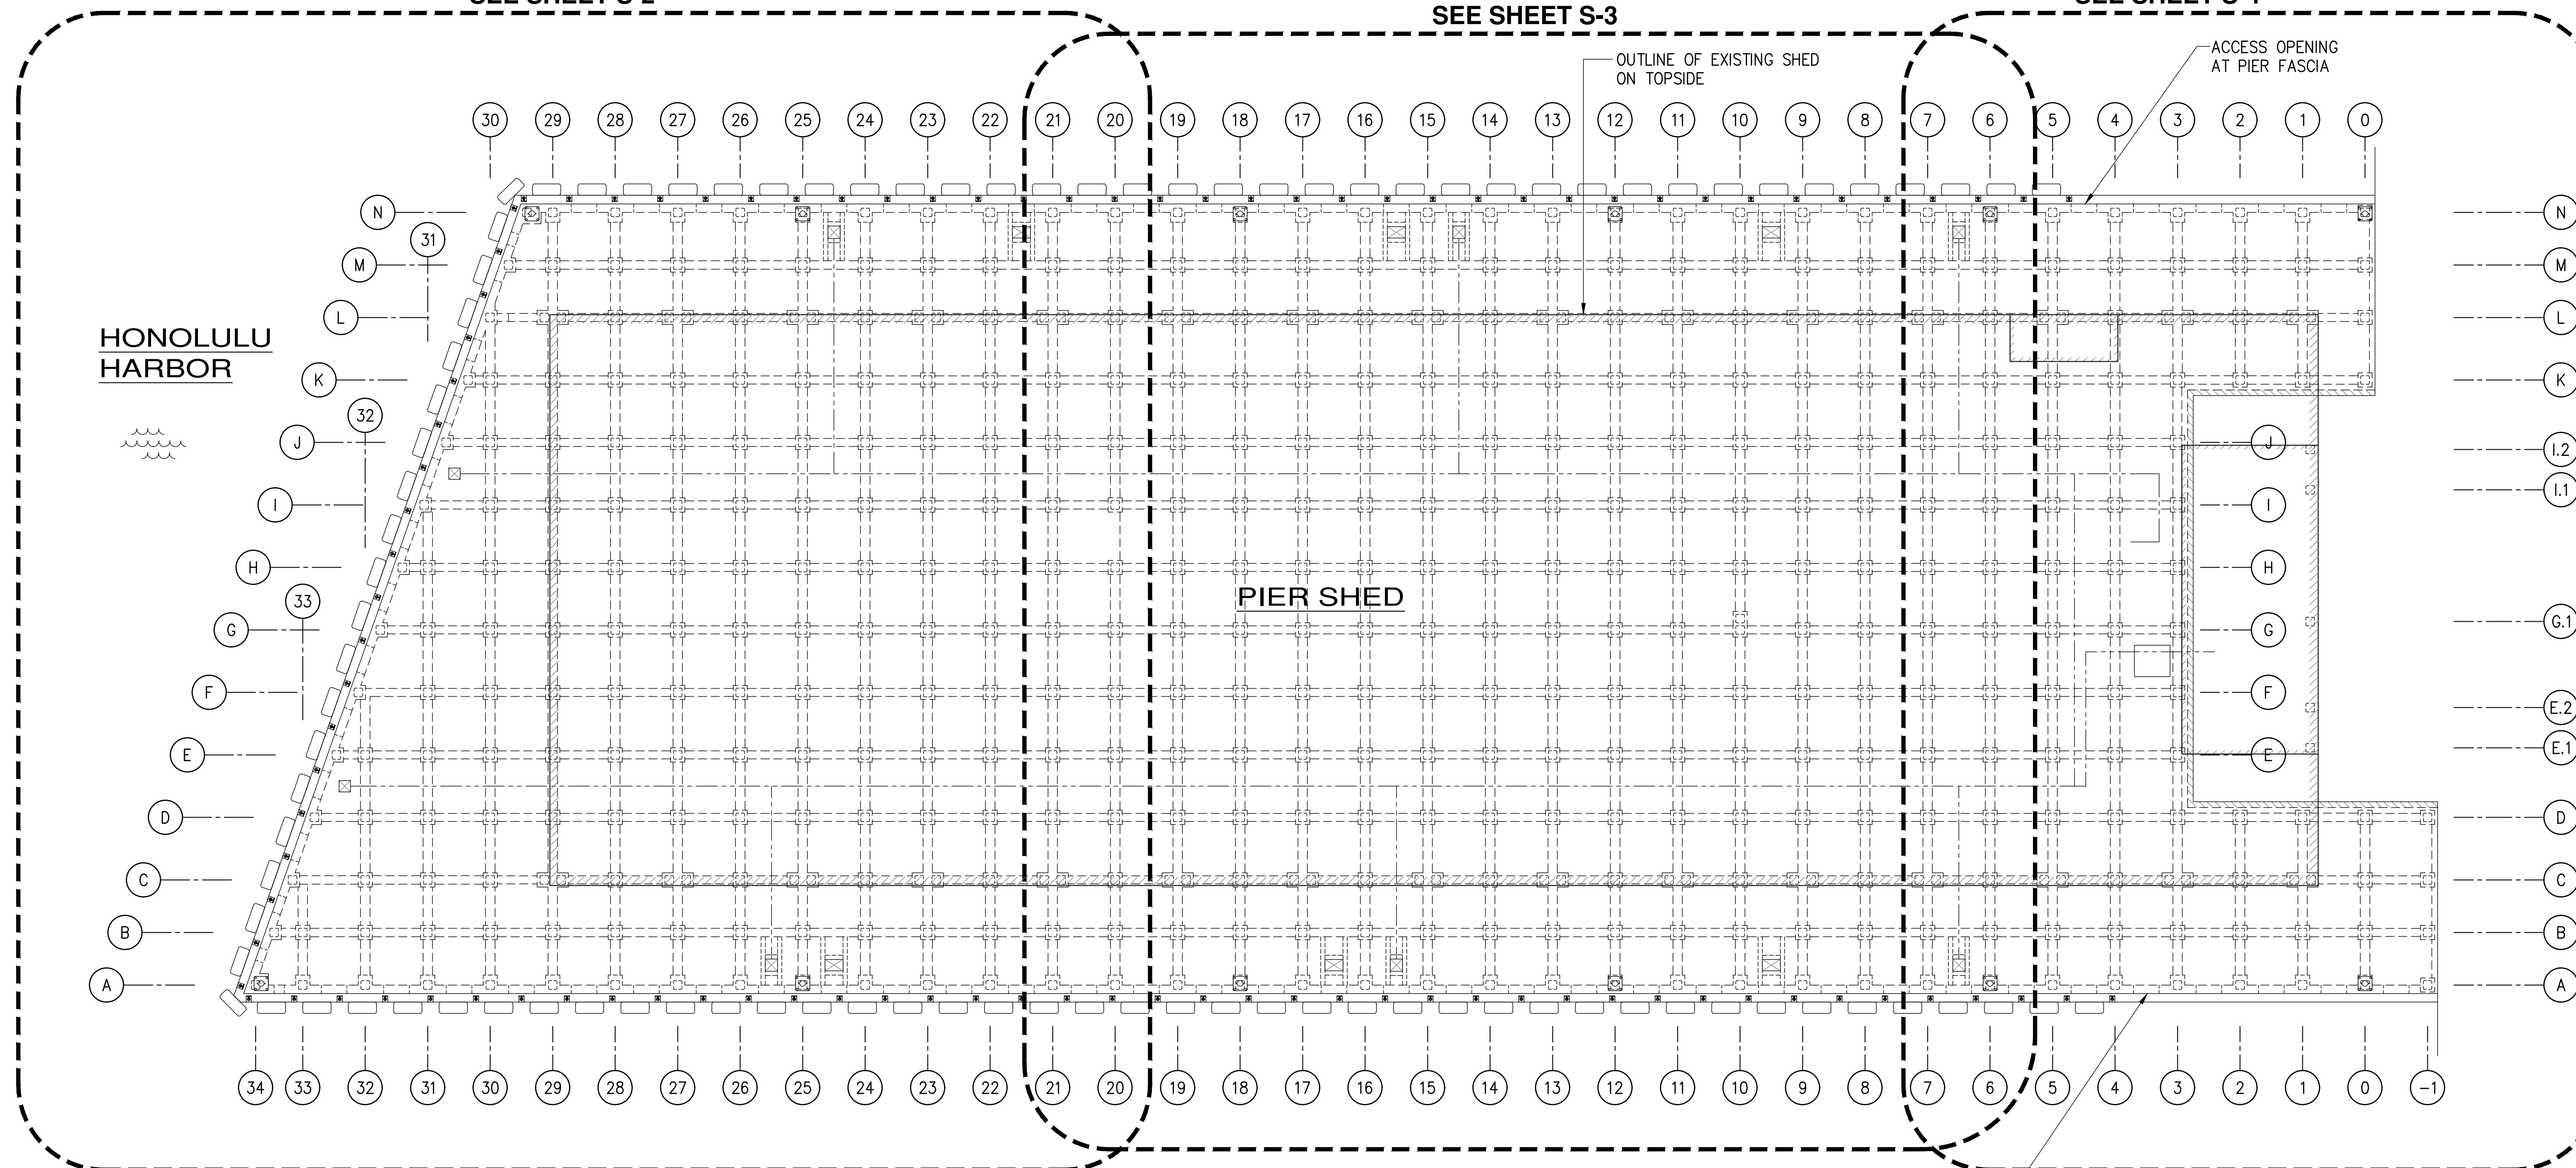

PIER 13

HONOLULU HARBOR

HONOLULU HARBOR

NIMITZ HIGHWAY


PIER SHED

ACCESS OPENING AT PIER FASCIA

OUTLINE OF EXISTING SHED ON TOPSIDE

ACCESS OPENING AT PIER FASCIA

GENERAL PLAN
NOT TO SCALE

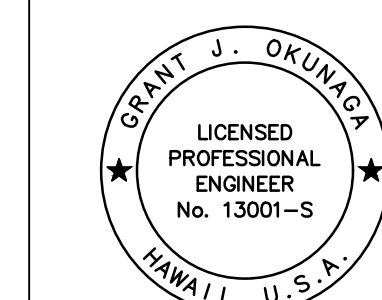

THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION
 EXP. 4-30-28
Grant J. Okunaga
 MKE ASSOCIATES LLC

REVISION	DATE	DESCRIPTION	BY	APPROVED
STATE OF HAWAII DEPARTMENT OF TRANSPORTATION HARBORS				
JOB TITLE HONOLULU HARBOR, PIERS 13-14, SUBSTRUCTURE REPAIRS, PHASE 2, OAHU, HAWAII				
SHEET TITLE INDEX TO DRAWINGS AND GENERAL PLAN				
DESIGNED BY: GO	JOB NUMBER		SHEET	
DRAWN BY: DL	S10928		T-2	
CHECKED BY: GO				
DATE: 04/2026				
SCALE: AS SHOWN	2 of 12 SHTS.			

STRUCTURAL NOTES:

GENERAL:

1. WORKMANSHIP AND MATERIALS SHALL CONFORM TO THE HAWAII STATE BUILDING CODE (2018 EDITION) AND THE HAWAII STANDARD SPECIFICATION FOR ROAD AND BRIDGE CONSTRUCTION, 2005, FOR THE STATE OF HAWAII, UNLESS OTHERWISE INDICATED. HOWEVER, SHOULD THERE BE CONFLICTS, OR WHERE REFERENCE IS MADE TO PERFORMANCE CONFORMING TO OTHER STANDARDS THE MORE STRINGENT SHALL APPLY.
2. THE CONTRACTOR SHALL COMPARE PLANS, SPECIFICATIONS AND ALL OTHER CONTRACT DOCUMENTS WITH EACH OTHER AND REPORT IN WRITING TO THE HARBORS CONSTRUCTION ENGINEER ALL INCONSISTENCIES AND OMISSIONS.
3. THE CONTRACTOR SHALL TAKE FIELD MEASUREMENTS AND VERIFY FIELD CONDITIONS AND SHALL COMPARE SUCH FIELD MEASUREMENTS AND CONDITIONS WITH THE DRAWINGS BEFORE COMMENCING WORK. REPORT IN WRITING TO THE HARBORS CONSTRUCTION ENGINEER ALL INCONSISTENCIES AND OMISSIONS.
4. CONTRACTOR SHALL RESOLVE ANY DISCREPANCIES AND QUESTIONS PRIOR TO THE START OF WORK. NO EXTRA PAYMENT SHALL BE ALLOWED ON ACCOUNT OF WORK MADE NECESSARY BY CONTRACTORS FAILURE TO VISIT THE SITE AND/OR FAILURE TO RESOLVE DISCREPANCIES AND QUESTIONS.
5. THE CONTRACTOR SHALL PROTECT ALL UTILITIES AND STRUCTURES IN AND ADJACENT TO THE PROJECT SITE. ANY DAMAGE SHALL BE REPAIRED TO THE SATISFACTION OF THE HARBORS CONSTRUCTION ENGINEER AND PAID FOR BY THE CONTRACTOR.
6. THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING THE WORK OF ALL TRADES.
7. THE CONTRACTOR SHALL COORDINATE HIS WORK WITH OTHER CONTRACTORS WITHIN THE PROJECT AREA. THE CONTRACTOR SHALL ALSO COORDINATE WITH THE HARBORS OAHU DISTRICT MANAGER AND CONSTRUCTION ENGINEER FOR AN APPROVED STAGING AND STORAGE AREA AND FOR RESTRICTIONS OF HARBORS OPERATIONS OVER REPAIR AREAS.
8. THE CONTRACTOR SHALL REMOVE ALL DEBRIS RESULTING FROM HIS WORK AS REQUIRED FOR PUBLIC HEALTH AND SAFETY AND TO THE SATISFACTION OF THE HARBORS CONSTRUCTION ENGINEER. SHOULD THE STATE PERFORM ANY OF THE ABOVE WORK DUE TO NON-PERFORMANCE BY THE CONTRACTOR, THE CONTRACTOR AGREES TO REIMBURSE THE STATE FOR ALL COSTS INCURRED.
9. HARBOR OPERATIONS TAKE PRECEDENCE OVER CONSTRUCTION ACTIVITY. THE CONTRACTOR MUST WORK AROUND HARBOR OPERATIONS SO THAT THE PIERS WILL REMAIN OPERATIONAL. WEEKEND WORK MAY BE REQUIRED AND SHALL BE COORDINATED WITH THE HARBORS CONSTRUCTION ENGINEER AND TENANTS IN ADVANCE.
10. THE CONTRACTOR SHALL BE RESPONSIBLE FOR METHODS OF CONSTRUCTION, WORKMANSHIP AND JOB SAFETY. THE CONTRACTOR SHALL PROVIDE TEMPORARY SHORING AND BRACING AS REQUIRED FOR STABILITY OF STRUCTURAL MEMBERS AND SYSTEMS.
11. ALL WORK SPECIFIED IN THE CONTRACT BUT NOT LISTED SEPARATELY SHALL BE CONSIDERED INCIDENTAL AND WILL NOT BE PAID FOR SEPARATELY.
12. THE CONTRACTOR SHALL COMPLY WITH THE CLEAN WATER ACT AND THE STATE HARBORS STORMWATER MANAGEMENT PROGRAM. NO POLLUTANTS ARE ALLOWED TO BE DISCHARGED DIRECTLY OR INDIRECTLY INTO ADJACENT HARBOR WATER, THROUGH THE HARBORS SMALL MS4 OR OTHER POTENTIAL PATHWAYS.
13. THE CONTRACTOR WILL BE RESPONSIBLE FOR REGULATORY FINES OR PENALTIES THAT MAY BE IMPOSED BY ENVIRONMENTAL REGULATORY AGENCIES (USEPA AND/OR STATE DOH) IN THE EVENT OF VIOLATIONS.
14. HARBOR OPERATIONS TAKE PRECEDENCE OVER CONSTRUCTION ACTIVITY. THE CONTRACTOR MUST WORK AROUND THESE OPERATIONS SO THAT THE PIER WILL REMAIN OPERATIONAL. WEEKEND WORK MAY BE REQUIRED.
15. THE CONTRACTOR SHALL SUBMIT A SITE-SPECIFIC BEST MANAGEMENT PRACTICES (BMP) PLAN TO THE HARBORS ENGINEERING BRANCH FOR REVIEW AND ACCEPTANCE PRIOR TO THE START OF ANY CONSTRUCTION WORK. THIS BMP PLAN SHALL COMPLY WITH THE TEMPORARY WATER POLLUTION, DUST, AND EROSION CONTROL ARTICLE IN THE SPECIFICATIONS AND PROPOSAL.
16. IN CASE OF SPILL, LEAK OR OTHER RELEASE CONTAINING A HAZARDOUS SUBSTANCE OR OIL, THE CONTRACTOR SHALL NOTIFY APPROPRIATE FACILITY PERSONNEL, EMERGENCY RESPONSE AGENCIES, AND REGULATORY AGENCIES FOLLOWING NOTIFICATION PROCEDURES, AND SHALL NOTIFY THE HARBORS CONSTRUCTION ENGINEER AND ENVIRONMENTAL HOTLINE (808-587-1962) IMMEDIATELY (I.E., WITHIN 24 HOURS). SUCH CONTACT INFORMATION MUST BE IN LOCATIONS THAT ARE READILY ACCESSIBLE AND AVAILABLE.
17. TIDAL DATA MAY NOT REPRESENT CONDITIONS THAT OCCUR DURING CONSTRUCTION AND ACTUAL WATER LEVELS WILL VARY FROM LEVELS INDICATED. THE CONTRACTOR IS RESPONSIBLE FOR MAKING THEIR OWN ESTIMATES OF WATER LEVELS WHICH MAY OCCUR DURING CONSTRUCTION. VARIATION FROM TIDAL LEVELS INDICATED OR CONTRACTOR'S ESTIMATION OF TIDAL LEVELS WILL NOT BE CONSIDERED AS A CLAIM FOR ADDITIONAL COMPENSATION OR DELAY OF WORK.

CONCRETE:

1. CONCRETE CONSTRUCTION SHALL CONFORM TO AMERICAN CONCRETE INSTITUTE ACI 318R-14 AND ACI 546R-14.
2. FORMED CONCRETE SHALL HAVE A 28-DAY COMPRESSIVE STRENGTH OF $f'_c=5,000$ PSI WITH SILICA FUME AND CORTEC MCI 2005 NS MIGRATING CORROSION INHIBITING ADMIXTURE, OR APPROVED EQUAL.
3. MAXIMUM AGGREGATE SIZE SHALL BE $\frac{3}{8}$ INCHES AND SHALL BE COORDINATED WITH CONCRETE PREPARATION PROCEDURES FOR SPALL REPAIRS.
4. CONCRETE DELIVERY TICKETS SHALL RECORD ALL FREE WATER IN THE MIX: AT BATCHING BY PLANT, FOR CONSISTENCY BY DRIVER, AND ANY ADDITIONAL REQUEST BY CONTRACTOR IF PERMITTED BY THE MIX DESIGN.
5. MAXIMUM WATER TO CEMENTITIOUS MATERIALS RATIO SHALL BE 0.40.
6. PATCHING COMPOUND FOR FORM AND POUR SPALL REPAIRS SHALL BE SIKACRETE 211 SCC PLUS BY SIKA, OR APPROVED EQUAL.
7. PATCHING COMPOUND FOR REPAIRING VERTICAL AND SOFFIT SPALLS IN LIFTS SHALL BE SIKAQUICK VOH WITH LATEX R BY SIKA, OR APPROVED EQUAL.
8. REINFORCING BARS, ANCHOR BOLTS, INSERTS, AND OTHER ITEMS TO BE CAST IN THE CONCRETE SHALL BE SECURED IN POSITION PRIOR TO PLACEMENT OF CONCRETE.

REINFORCING STEEL:


1. REINFORCING STEEL FOR WELD SPlicing SHALL BE ASTM A706 GRADE 60. WELDING ELECTRODES SHALL BE LOW HYDROGEN E70.
2. REINFORCING STEEL NOT TO BE WELD SPliced SHALL BE ASTM A615, GRADE 60 OR ASTM A706 GRADE 60.
3. CLEAR CONCRETE COVER FOR REINFORCING BARS SHALL BE 3 INCHES MINIMUM, UNLESS OTHERWISE NOTED.
4. BAR BENDS AND HOOKS SHALL BE STANDARD HOOKS IN ACCORDANCE WITH ACI 318.
5. REINFORCING STEEL SHALL BE SPliced AS INDICATED ON PLANS. PROVIDE WELD SPlice PER TYPICAL DETAILS, UNLESS OTHERWISE NOTED.
6. ANTI-CORROSION COATING WITH A MINIMUM 7 DAY OPEN TIME FOR REINFORCING STEEL SHALL BE ARMATEC 110 EPOCEM BY SIKA OR APPROVED EQUAL.
7. EPOXY FOR GROUTING OF DOWELS SHALL BE SET-3G BY SIMPSON STRONG-TIE, OR APPROVED EQUAL.
8. TIE WIRE SHALL BE PLASTIC-COATED, STAINLESS STEEL, OR MADE OF DIELECTRIC OR OTHER ACCEPTABLE MATERIAL. ALL LOOSE REINFORCING STEEL SHALL BE SECURED WITH TIES AT ALL INTERSECTIONS WITH ADJACENT REINFORCING STEEL.


PREPARATION OF SUBSTRATE AND REINFORCING STEEL FOR SPALL REPAIRS:

1. SURFACE PREPARATION FOR SPALL REPAIRS SHALL FOLLOW THE INTERNATIONAL CONCRETE REPAIR INSTITUTE (ICRI) GUIDELINE NO. 310.1R-2008.
2. BOTH SPALLS AND DELAMINATIONS ARE REFERRED TO ON THE DRAWINGS AS "SPALLS", AS THE REPAIR PROCEDURES ARE THE SAME FOR BOTH CONDITIONS.
3. THE CONTRACTOR SHALL SOUND ALL CONCRETE SURFACES TO IDENTIFY SPALLS AND DELAMINATIONS.
4. ANY ELEMENT BEING REPAIRED SHALL NOT BE SUBJECTED TO LIVE LOADS DURING THE PERIOD STARTING FROM THE REMOVAL OF EXISTING CONCRETE UNTIL THE REPAIR CONCRETE HAS OBTAINED A MINIMUM COMPRESSIVE STRENGTH OF 4,000 PSI.
5. PREPARATION OF SUBSTRATE AND REINFORCING STEEL FOR SPALL REPAIRS SHALL BE PERFORMED IN THE ORDER LISTED BELOW.
6. THE SPALLED AND DELAMINATED CONCRETE SHALL BE COMPLETELY REMOVED TO SOUND SUBSTRATE AND BEYOND THE EXTENT OF THE CORRODED REINFORCING. THE CONTRACTOR SHALL TAKE THE NECESSARY PRECAUTIONS TO AVOID DAMAGING THE UNDERLYING SOUND CONCRETE.
7. THE SPALLED AND DELAMINATED EDGES SHALL BE SQUARED BY SAW-CUTTING AND CHIPPING THE CONCRETE AT THE PERIMETER BEYOND THE REMOVAL AREA AS NECESSARY TO ATTAIN A MINIMUM DEPTH OF $\frac{3}{4}$ INCH AND TO PREVENT FEATHER EDGE CONDITIONS. EXERCISE GREAT CARE TO AVOID CUTTING OR DAMAGING ANY EXISTING EMBEDDED STEEL REINFORCING. ANGLES BETWEEN ADJACENT SAW-CUTS AROUND THE PERIMETER SHALL NOT BE LESS THAN 90 DEGREES AND THE SHAPE OF EACH PATCH SHALL NOT BE IRREGULAR.
8. FOR ANY EXPOSED REINFORCEMENT WITHIN THE REPAIR AREA, ADDITIONAL CONCRETE SHALL BE REMOVED FOR A MINIMUM $\frac{3}{4}$ INCH CLEAR SPACE MEASURED RADIALLY AROUND THE BARS.
9. EXISTING CONCRETE SURFACES WITHIN THE REPAIR AREAS SHALL BE ROUGHENED TO ENSURE PROPER ADHESION WITH REPAIR CONCRETE.
10. ALL EXPOSED CONCRETE SURFACES AND REINFORCING BARS IN THE REPAIR AREA SHALL BE NEEDLE GUNNED TO REMOVE ALL SCALE, LOOSE RUST, DEBRIS AND DETERIORATED CONCRETE.
11. ANY REINFORCEMENT WHICH HAS LOST MORE THAN 20 PERCENT OF ITS CROSS-SECTIONAL AREA SHALL BE REPLACED AND CALLED TO THE ATTENTION OF THE HARBORS CONSTRUCTION ENGINEER.
12. ALL WELDING SHALL CONFORM TO AWS D1.4.
13. ALL EXISTING BARS WITH CARBON EQUIVALENT (C.E.) ABOVE 0.55 PERCENT SHALL BE PREHEATED ACCORDING TO THE REQUIREMENTS SET FORTH IN AWS D.1. IF THE C.E. IS UNKNOWN, MAXIMUM PREHEAT REQUIREMENTS, FOR AN ASSUMED C.E. GREATER THAN 0.75 PERCENT SHALL BE USED.
14. THE PATCH AREA SHALL BE CLEANED OF ALL DUST AND DEBRIS JUST PRIOR TO PATCHING WITH HIGH PRESSURE, OIL-FREE COMPRESSED AIR WITH APPROPRIATE PPE'S AND CONTAINMENT.

APPLICATION OF SPALL REPAIR MATERIALS:

1. ALL EXPOSED STEEL IN THE REPAIR AREA SHALL BE LIBERALLY COATED WITH ANTI-CORROSION COATING PER MANUFACTURER'S RECOMMENDATIONS.
2. PRIOR TO PLACEMENT OF REPAIR CONCRETE, ALL CONCRETE REPAIR SURFACES SHALL BE WASHED WITH CLEAN POTABLE WATER AND THE EXPOSED CONCRETE SURFACE SHALL BE SATURATED WITH NO WATER ACCUMULATION ON THE SURFACE.
3. ALL VERTICAL AND OVERHEAD REPAIRS GREATER THAN 10 SQUARE FEET SHALL BE FORMED.
4. THE CONTRACTOR SHALL NOT SECURE FORMS BY RAMSETTING. ALL HOLES AND SPALLS CAUSED BY TEMPORARY ATTACHMENTS SHALL BE PATCHED. ALL INSERTS SHALL BE REMOVED OR SHALL BE STAINLESS STEEL WITH MINIMUM $\frac{3}{4}$ INCH. COVER AFTER FORM REMOVAL.
5. PATCHING COMPOUND MAY BE USED INSTEAD OF FORMED CONCRETE FOR VERTICAL AND OVERHEAD REPAIRS LESS THAN OR EQUAL TO 10 SQUARE FEET IN AREA. A SLURRY COAT OF THE COMPOUND SHALL BE USED TO PRIME THE SUBSTRATE AND THE MATERIAL SHALL BE APPLIED IN LIFTS PER MANUFACTURER'S RECOMMENDATIONS.
6. SNAP TIES AND OTHER NON-REMOVABLE INSERTS SHALL BE PLASTIC OR STAINLESS STEEL.
7. WITH THE EXCEPTION OF THE TOP SURFACE OF THE PIER AND FRONT FACE OF THE OUTBOARD FASCIA BEAM, ALL FORMED CONCRETE REPAIRS SHALL BE BUILT UP TO OR BEYOND THE ORIGINAL SURFACE AND SHALL MAINTAIN A 3 INCH MINIMUM CLEAR COVER FOR REINFORCING.
8. CONCRETE REPAIRS AT THE TOP SURFACE OF THE PIER AND FRONT FACE OF THE OUTBOARD FASCIA BEAM SHALL BE BUILT UP TO THE ORIGINAL CONCRETE SURFACE.
9. CONCRETE REPAIRS SHALL MATCH AND MAINTAIN EXISTING CHAMFER EDGES AND EXPANSION JOINTS. CONTRACTOR SHALL INSTALL JOINT FILLER TO MAINTAIN JOINTS.
10. REPAIR CONCRETE SHALL BE VIBRATED, RODDED OR TAMPED DURING PLACEMENT TO CONSOLIDATE THE POUR AND FILL ALL CORNERS OF THE PATCH OR FORM AND BENEATH THE REINFORCING.
11. THERE SHALL BE NO COLD JOINTS IN THE FIELD OF THE REPAIR.
12. THE REPAIRED SURFACE FINISH SHALL MATCH THE ORIGINAL SURFACE FINISH.
13. VOID SPACES BEYOND THE EDGE OF THE FORM SHALL BE DRY PACKED IN LIFTS WITH PATCHING COMPOUND.
14. FORMWORK FOR CONCRETE REPAIRS ON THE PIER SUBSTRUCTURE SHALL NOT BE REMOVED FOR A MINIMUM OF 24 HOURS AND UNTIL CONCRETE HAS OBTAINED A MINIMUM COMPRESSIVE STRENGTH OF 4,000 PSI.
15. CONCRETE REPAIRS ON THE UNDERSIDE OF THE PIER SHALL BE CURED EITHER BY LEAVING FORMS IN PLACE A MINIMUM OF 7 DAYS OR COVERING THE SURFACE WITH A CURING COMPOUND APPROVED BY THE HARBORS CONSTRUCTION ENGINEER.

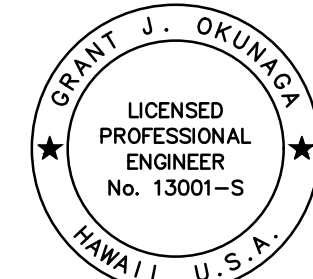 <p>THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION EXP. 4-30-28 <i>Grant J. Okunaga</i> MKE ASSOCIATES LLC</p>	REVISION	DATE	DESCRIPTION	BY	APPROVED
	STATE OF HAWAII DEPARTMENT OF TRANSPORTATION HARBORS				
	JOB TITLE HONOLULU HARBOR, PIERS 13-14, SUBSTRUCTURE REPAIRS, PHASE 2, OAHU, HAWAII				
	SHEET TITLE STRUCTURAL NOTES				
DESIGNED BY: GO	JOB NUMBER			SHEET	
DRAWN BY: DL	S10928			S-1	
CHECKED BY: GO					
DATE: 04/2026					
SCALE: AS SHOWN				3 of 12 SHTS.	

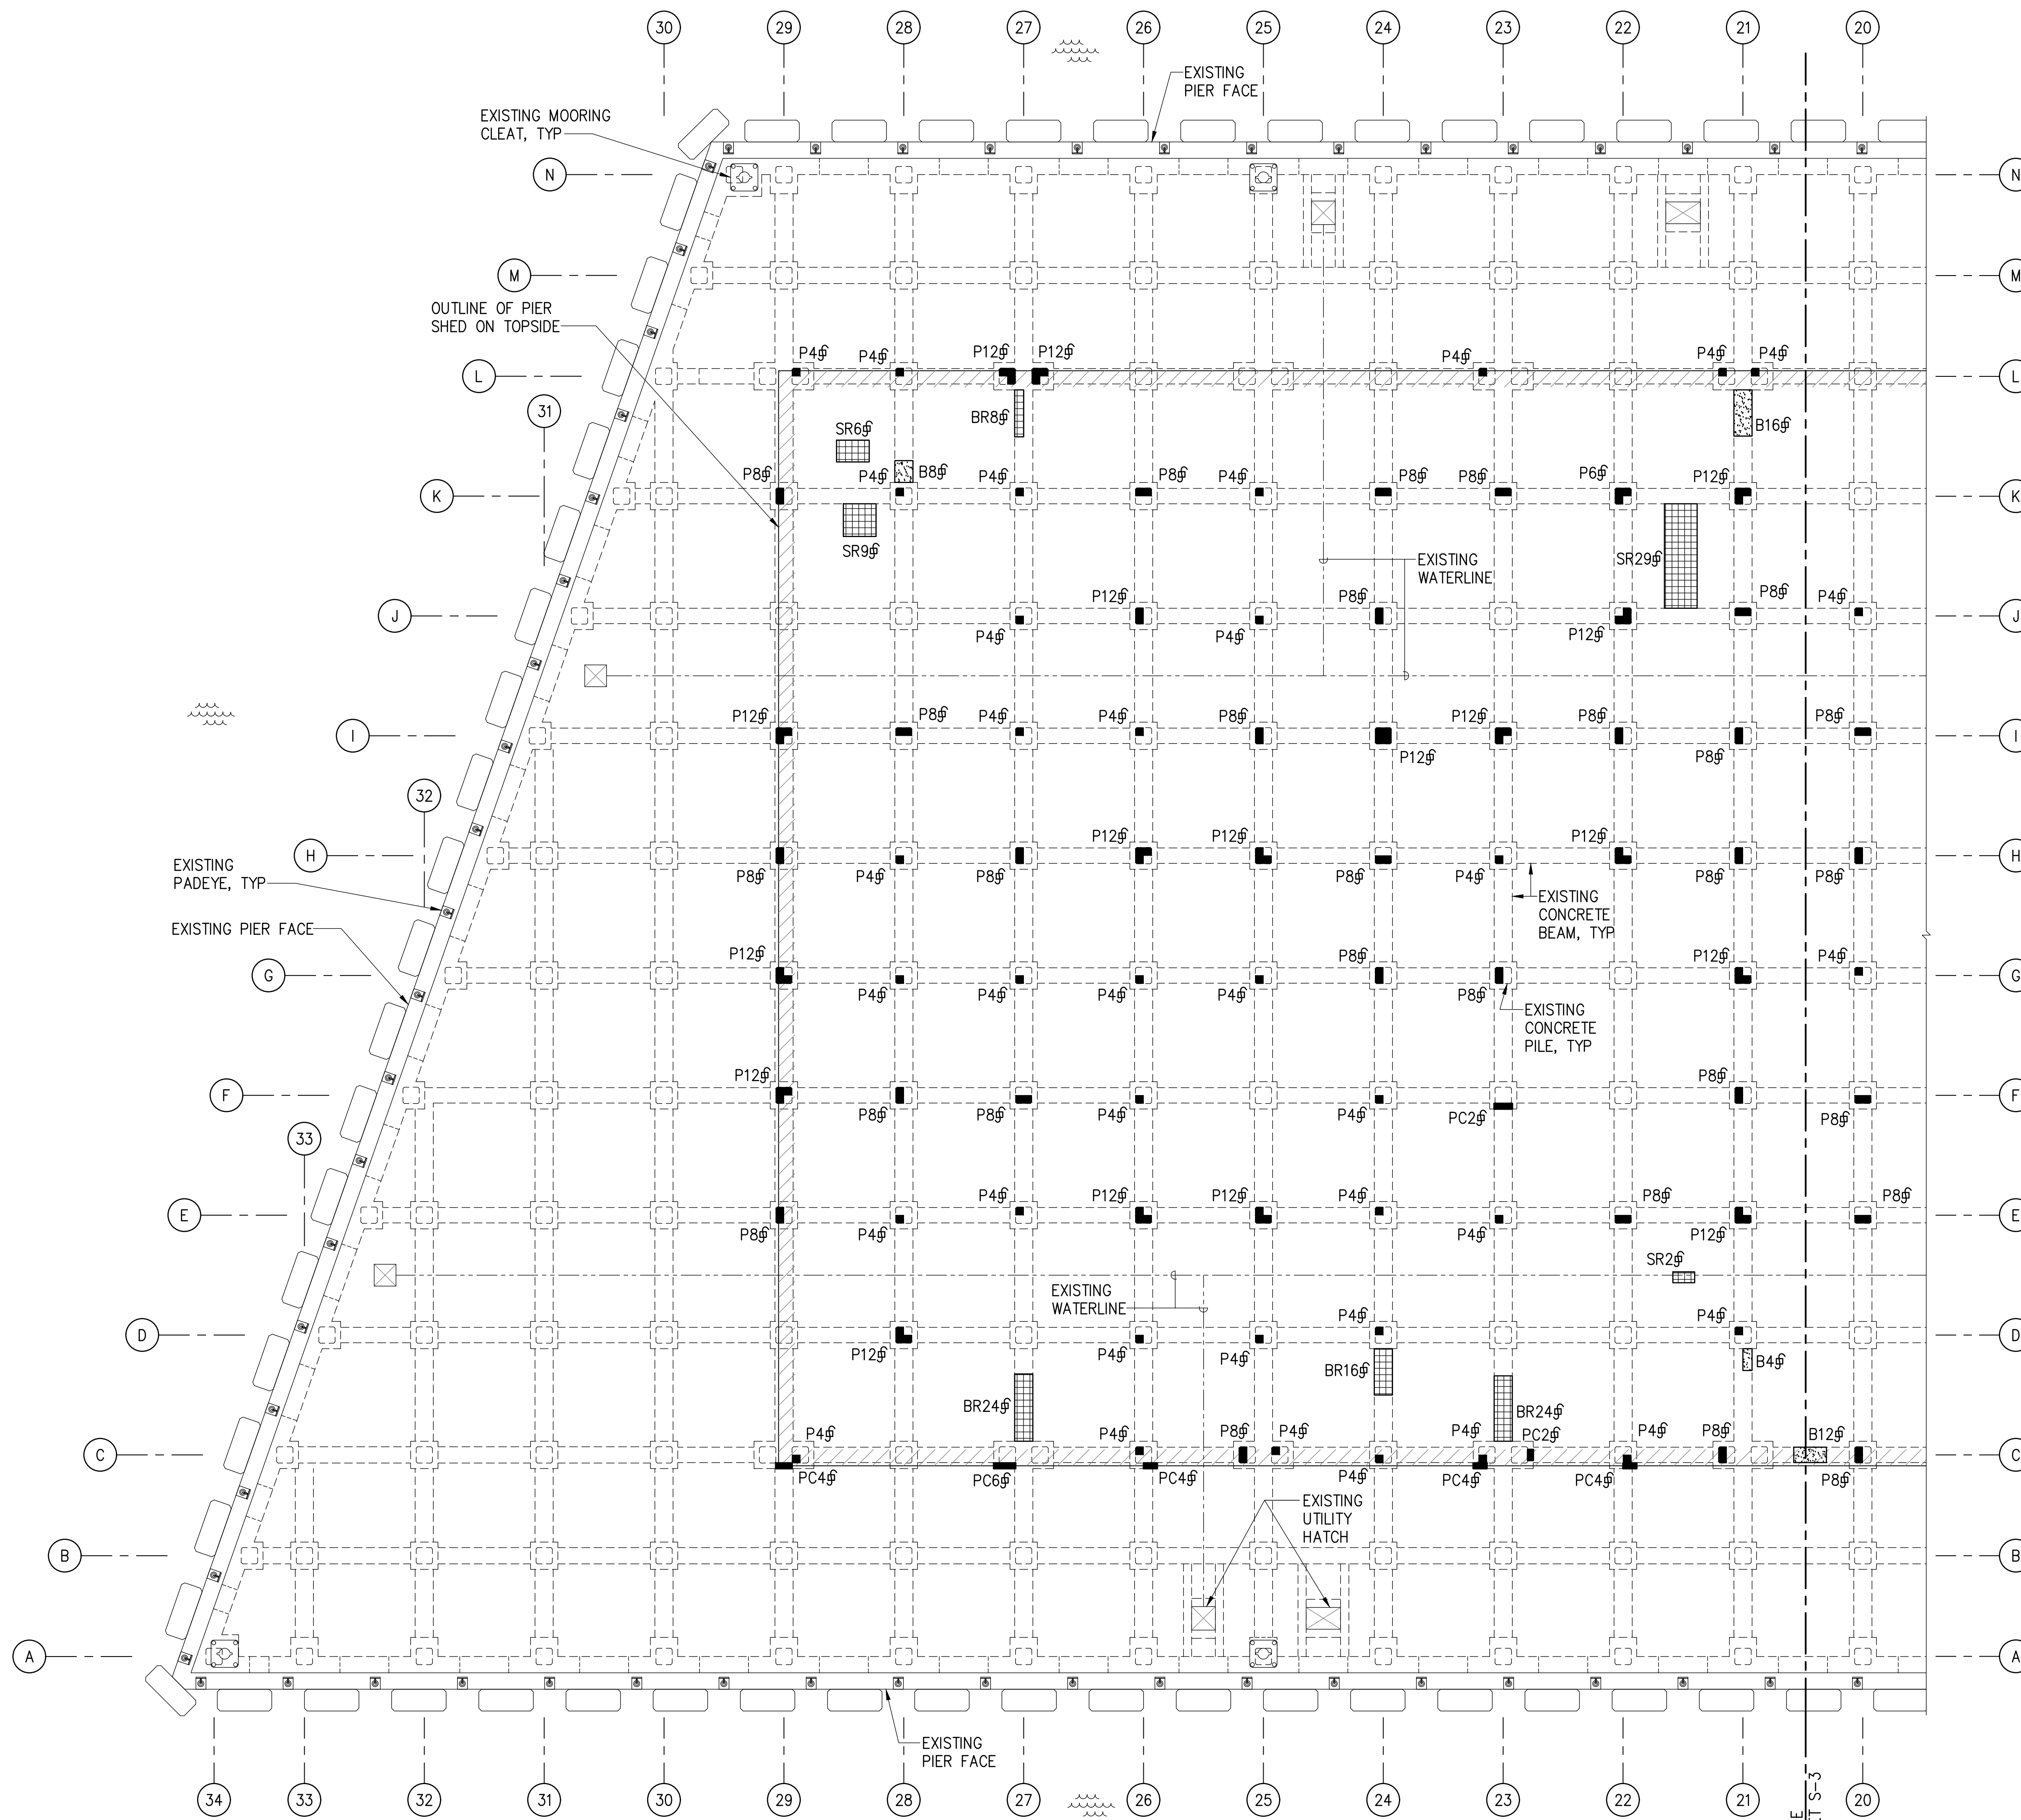


- SPALL REPAIR LEGEND:**
- SLAB SOFFIT SPALL (S), SEE DETAIL 1/S-6
 - SLAB SOFFIT SPALL WITH REINFORCING THAT HAS LOST MORE THAN 20% OF ITS CROSS-SECTIONAL AREA (SR), SEE DETAIL 2/S-6
 - BEAM SOFFIT SPALL (B), SEE DETAIL 1/S-7
 - BEAM SOFFIT SPALL WITH REINFORCING THAT HAS LOST MORE THAN 20% OF ITS CROSS-SECTIONAL AREA (BR), SEE DETAIL 2/S-7
 - VERTICAL SURFACE SPALL OR VERTICAL SPALL WITH REINFORCING THAT HAS LOST MORE THAN 20% OF ITS CROSS-SECTIONAL AREA (V OR VR), SEE DETAILS 3/S-6 AND 4/S-6
 - OR PILE OR PILECAP CORNER SPALL REPAIR (P OR PC), SEE DETAILS 1/S-8 AND 1/S-9
 - OR PILE OR PILECAP FACE SPALL REPAIR (P OR PC), SEE DETAILS 1/S-8 AND 1/S-9
 - OR PILE OR PILECAP ALL SPALL REPAIR (P OR PC), SEE DETAILS 1/S-8 AND 1/S-9
 - OR PILE OR PILECAP ALL SPALL REPAIR (P OR PC), SEE DETAILS 1/S-8 AND 1/S-9
 - SQUARE FEET

PARTIAL PIER PLAN
 SCALE: 1/8" = 1'-0"

THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION
 EXP. 4-30-28
Grant J. Okunaga
 MKE ASSOCIATES LLC

REVISION	DATE	DESCRIPTION	BY	APPROVED
STATE OF HAWAII DEPARTMENT OF TRANSPORTATION HARBORS				
JOB TITLE HONOLULU HARBOR, PIERS 13-14, SUBSTRUCTURE REPAIRS, PHASE 2, OAHU, HAWAII				
SHEET TITLE PARTIAL PIER PLAN				
DESIGNED BY: GO				SHEET S-2
DRAWN BY: DL				JOB NUMBER S10928
CHECKED BY: GO				
DATE: 04/2026				
SCALE: AS SHOWN				4 of 12 SHEETS

MATCHLINE SEE SHEET S-3

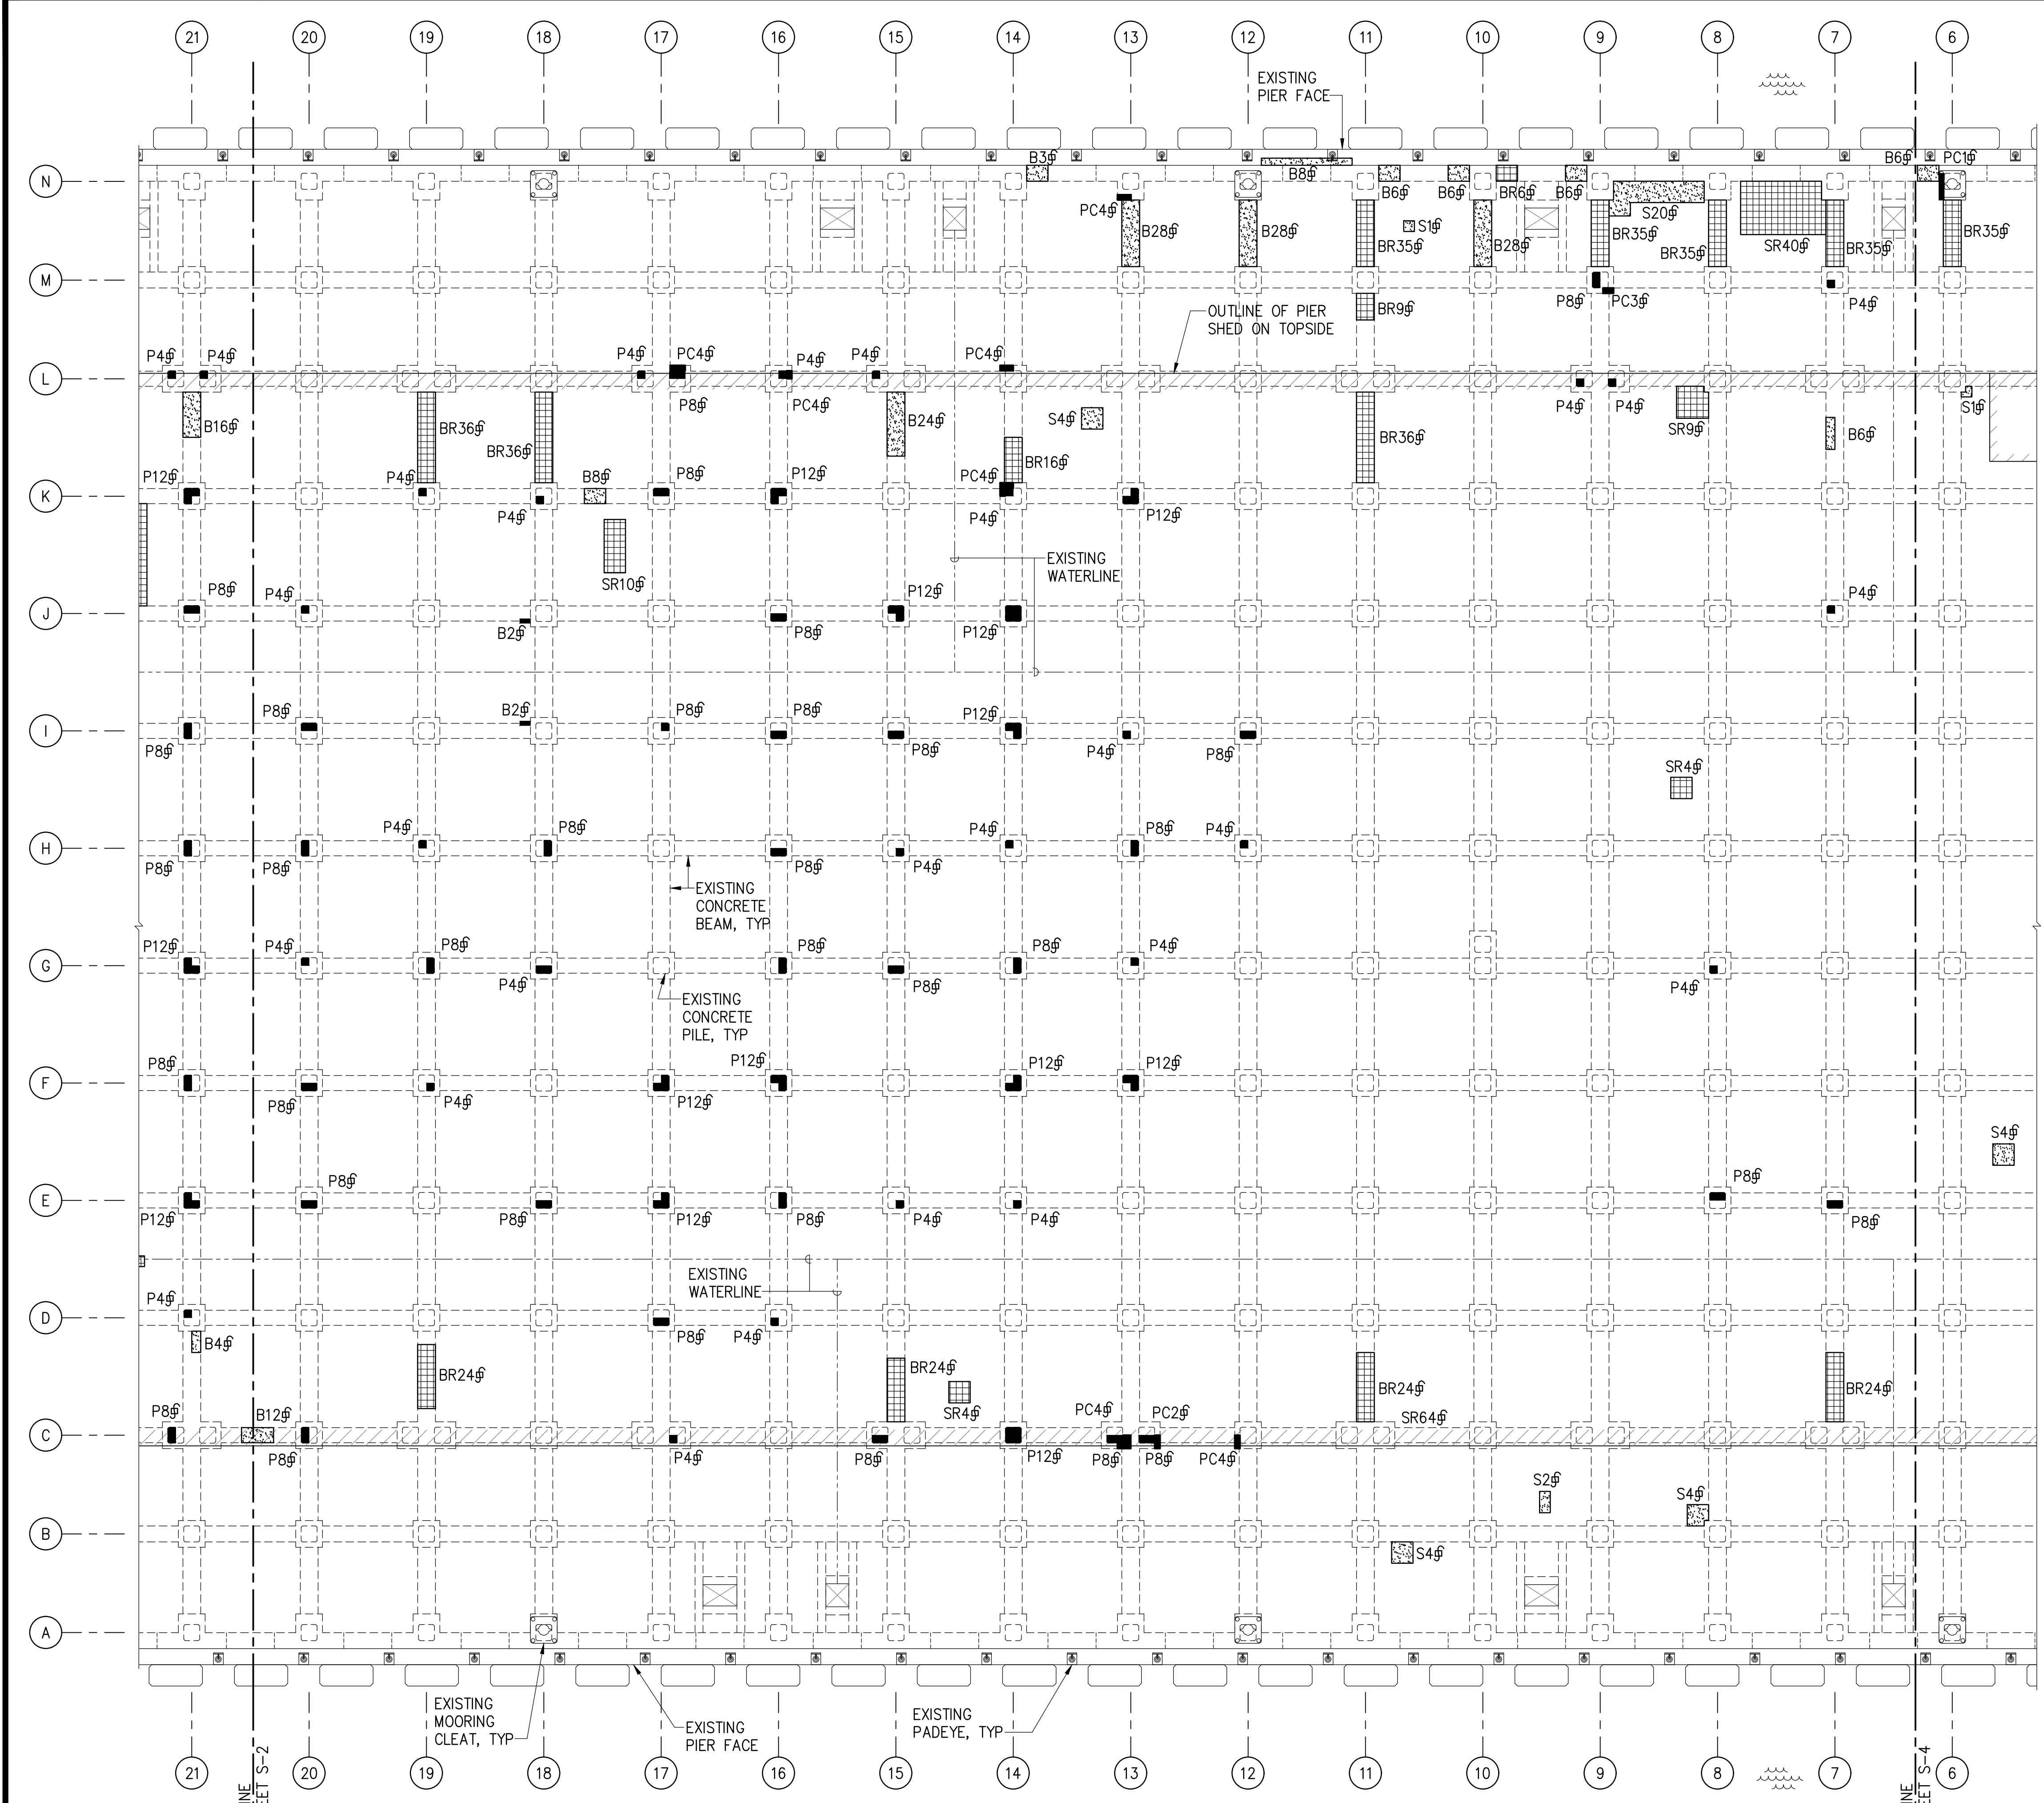


- SPALL REPAIR LEGEND:**
- SLAB SOFFIT SPALL (S), SEE DETAIL 1/S-6
 - SLAB SOFFIT SPALL WITH REINFORCING THAT HAS LOST MORE THAN 20% OF ITS CROSS-SECTIONAL AREA (SR), SEE DETAIL 2/S-6
 - BEAM SOFFIT SPALL (B), SEE DETAIL 1/S-7
 - BEAM SOFFIT SPALL WITH REINFORCING THAT HAS LOST MORE THAN 20% OF ITS CROSS-SECTIONAL AREA (BR), SEE DETAIL 2/S-7
 - VERTICAL SURFACE SPALL OR VERTICAL SPALL WITH REINFORCING THAT HAS LOST MORE THAN 20% OF ITS CROSS-SECTIONAL AREA (V OR VR), SEE DETAILS 3/S-6 AND 4/S-6
 - OR PILE OR PILECAP CORNER SPALL REPAIR (P OR PC), SEE DETAILS 1/S-8 AND 1/S-9
 - OR PILE OR PILECAP FACE SPALL REPAIR (P OR PC), SEE DETAILS 1/S-8 AND 1/S-9
 - OR PILE OR PILECAP ALL SPALL REPAIR (P OR PC), SEE DETAILS 1/S-8 AND 1/S-9
 - OR PILE OR PILECAP ALL SPALL REPAIR (P OR PC), SEE DETAILS 1/S-8 AND 1/S-9
 - ☐ SQUARE FEET

PARTIAL PIER PLAN
SCALE: 1/8" = 1'-0"






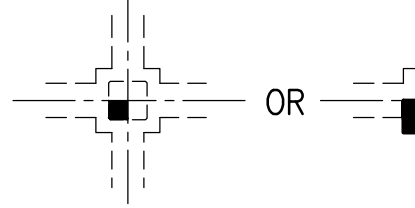
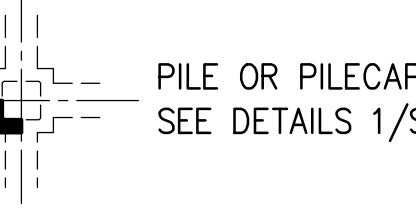
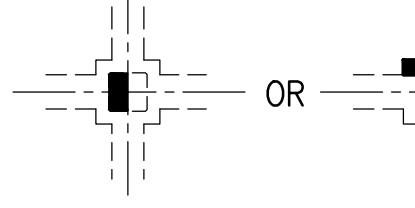
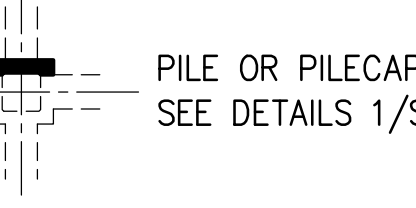
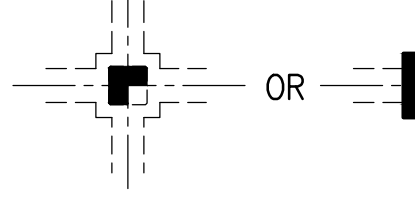
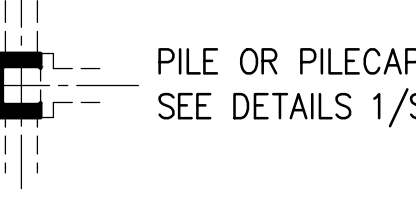
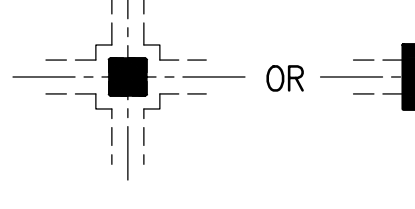
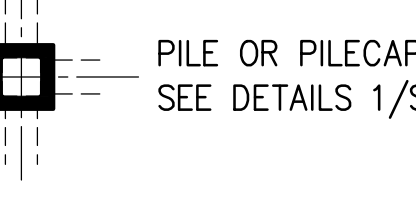



THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION
EXP. 4-30-28
Grant J. Okunaga
MKE ASSOCIATES LLC

REVISION	DATE	DESCRIPTION	BY	APPROVED
STATE OF HAWAII DEPARTMENT OF TRANSPORTATION HARBORS				
JOB TITLE HONOLULU HARBOR, PIERS 13-14, SUBSTRUCTURE REPAIRS, PHASE 2, OAHU, HAWAII				
SHEET TITLE PARTIAL PIER PLAN				
DESIGNED BY: GO	JOB NUMBER		SHEET	
DRAWN BY: DL	S10928		S-3	
CHECKED BY: GO	DATE: 04/2026		5 of 12 SHTS.	
SCALE: AS SHOWN				

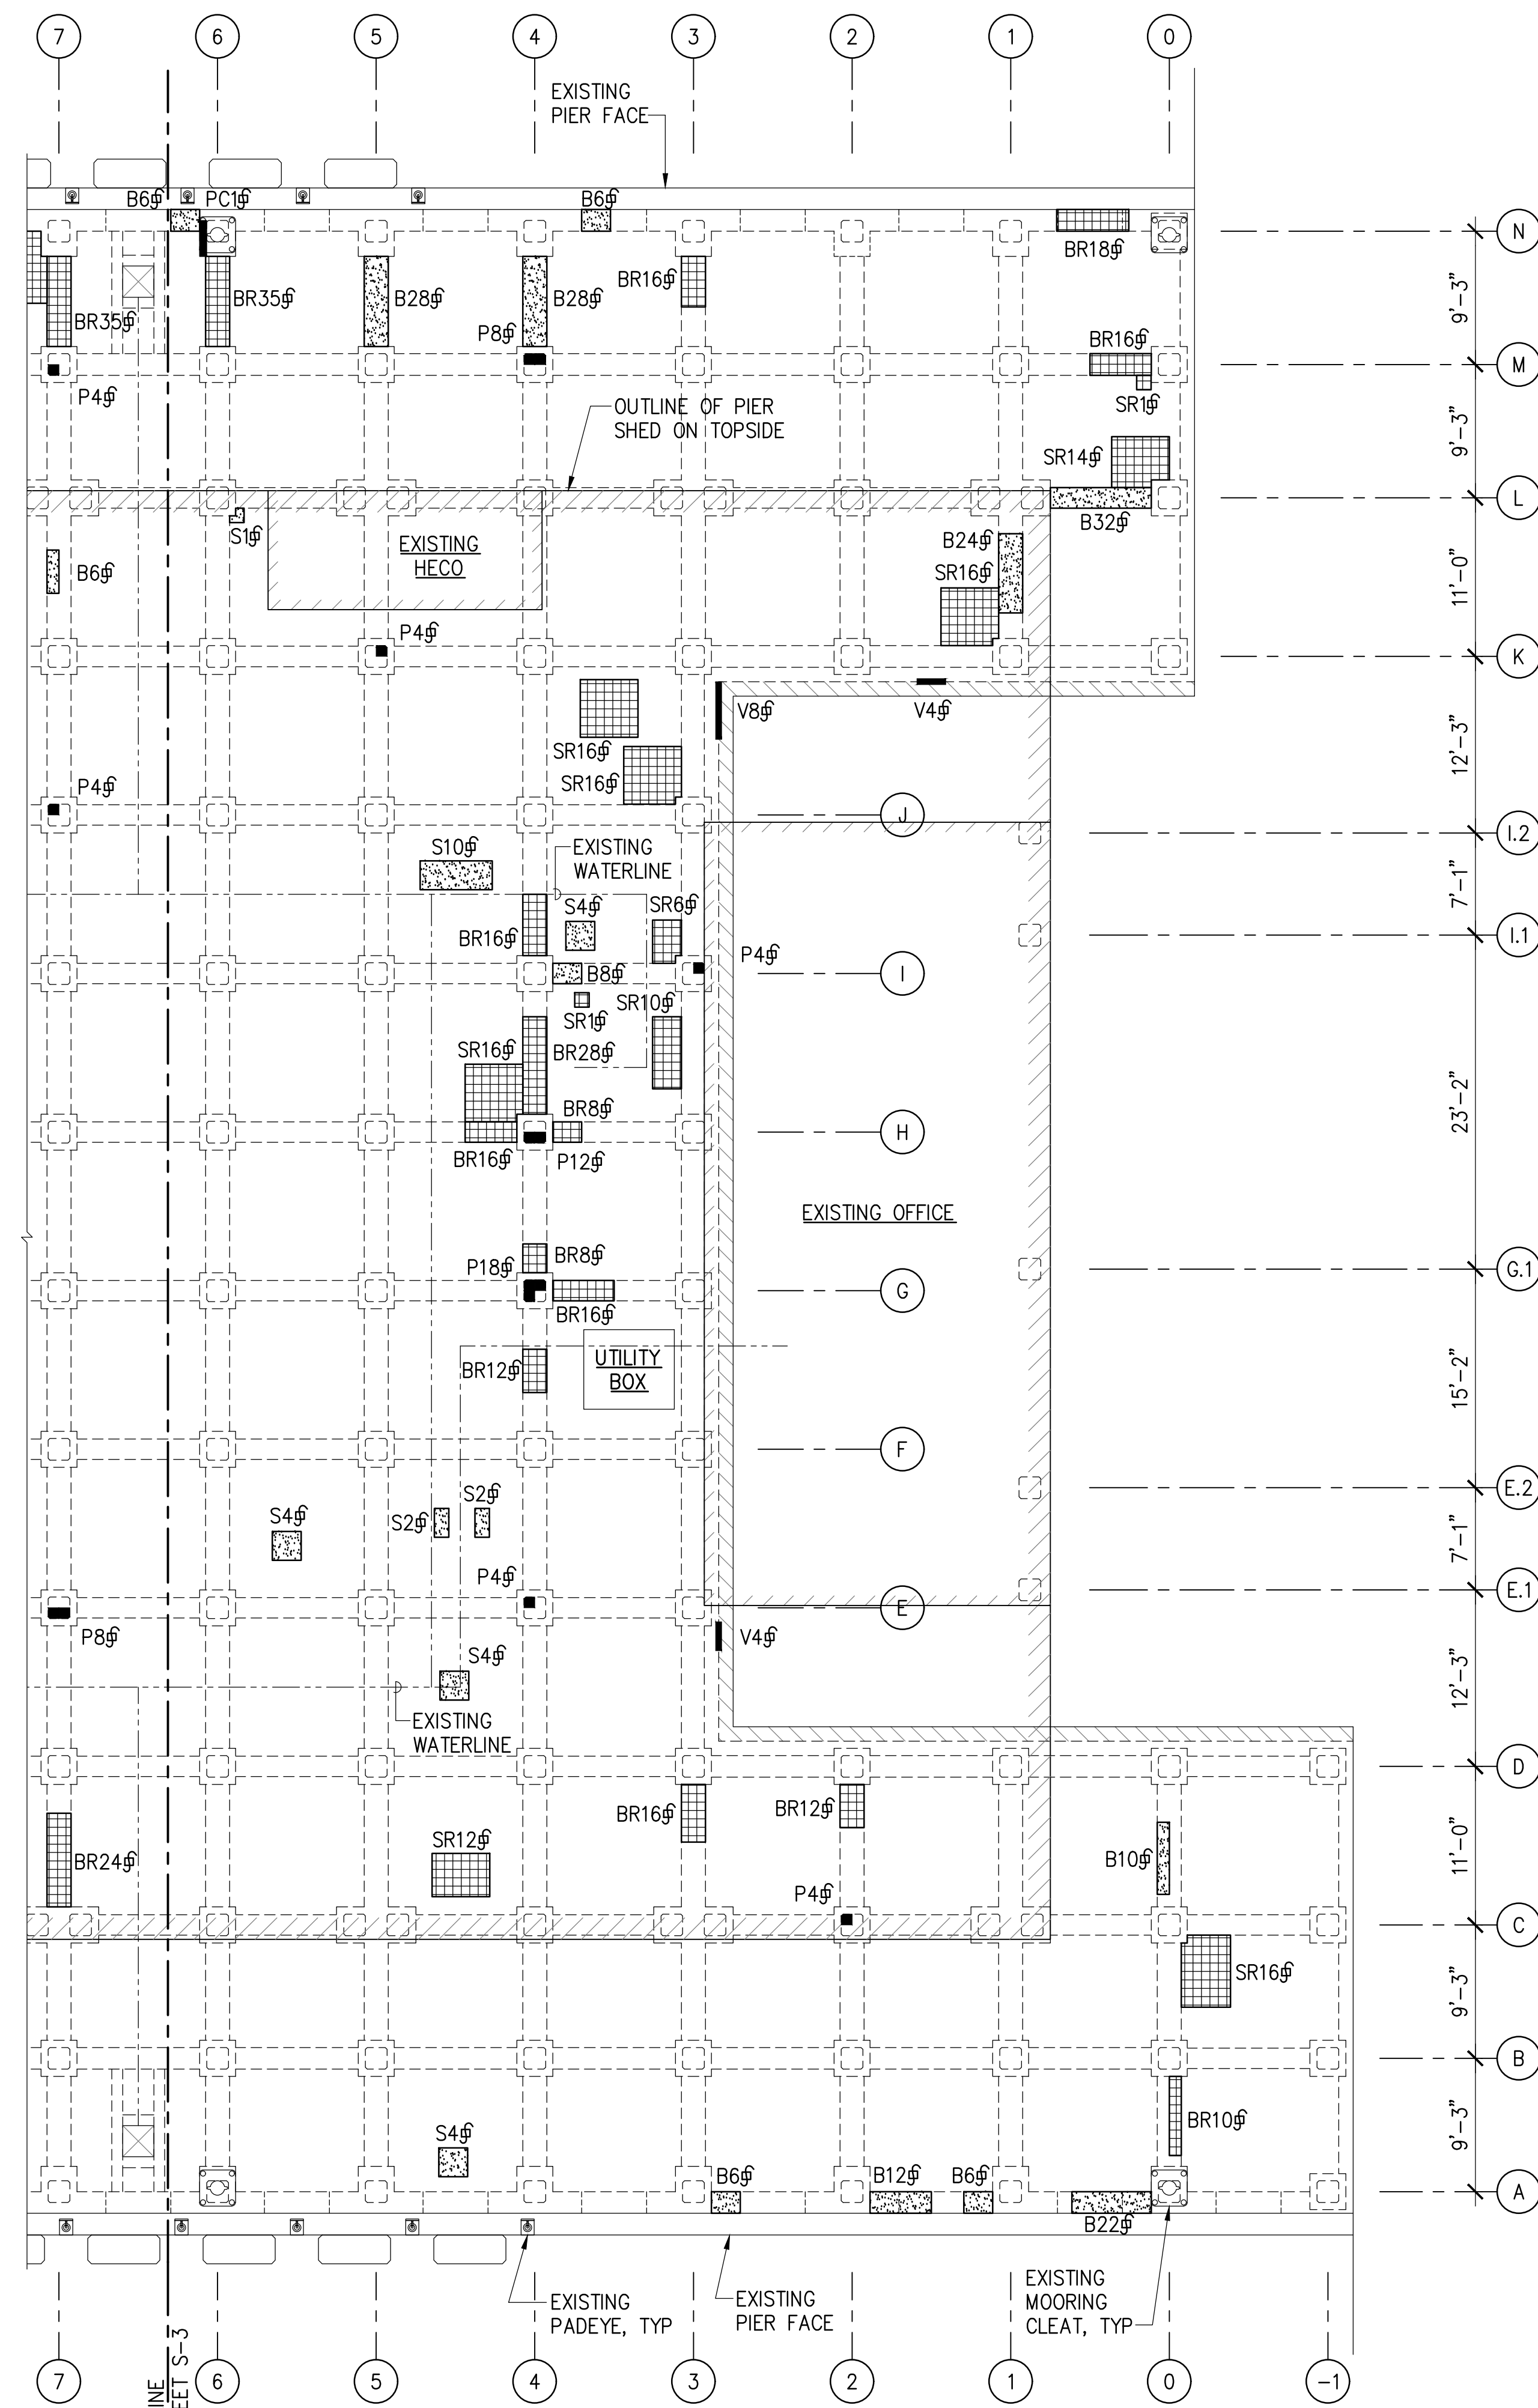



SPALL REPAIR LEGEND:

-  SLAB SOFFIT SPALL (S), SEE DETAIL 1/S-6
 -  SLAB SOFFIT SPALL WITH REINFORCING THAT HAS LOST MORE THAN 20% OF ITS CROSS-SECTIONAL AREA (SR), SEE DETAIL 2/S-6
 -  BEAM SOFFIT SPALL (B), SEE DETAIL 1/S-7
 -  BEAM SOFFIT SPALL WITH REINFORCING THAT HAS LOST MORE THAN 20% OF ITS CROSS-SECTIONAL AREA (BR), SEE DETAIL 2/S-7
 -  VERTICAL SURFACE SPALL OR VERTICAL SPALL WITH REINFORCING THAT HAS LOST MORE THAN 20% OF ITS CROSS-SECTIONAL AREA (V OR VR), SEE DETAILS 3/S-6 AND 4/S-6
 -  OR  PILE OR PILECAP CORNER SPALL REPAIR (P OR PC), SEE DETAILS 1/S-8 AND 1/S-9
 -  OR  PILE OR PILECAP FACE SPALL REPAIR (P OR PC), SEE DETAILS 1/S-8 AND 1/S-9
 -  OR  PILE OR PILECAP ALL SPALL REPAIR (P OR PC), SEE DETAILS 1/S-8 AND 1/S-9
 -  OR  PILE OR PILECAP ALL SPALL REPAIR (P OR PC), SEE DETAILS 1/S-8 AND 1/S-9
- ☐ SQUARE FEET

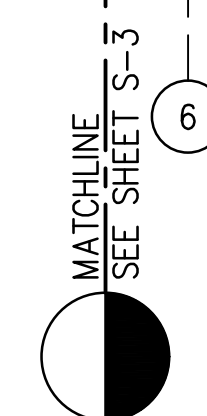


PARTIAL PIER PLAN
SCALE: 1/8" = 1'-0"

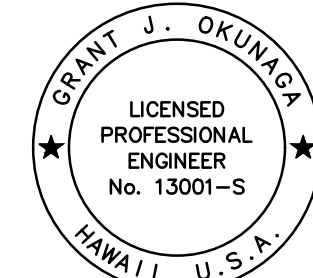 <p>THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION EXP. 4-30-28 <i>Grant J. Okuniga</i> MKE ASSOCIATES LLC</p>	REVISION	DATE	DESCRIPTION	BY	APPROVED
	STATE OF HAWAII DEPARTMENT OF TRANSPORTATION HARBORS				
	JOB TITLE HONOLULU HARBOR, PIERS 13-14, SUBSTRUCTURE REPAIRS, PHASE 2, OAHU, HAWAII				
	SHEET TITLE PARTIAL PIER PLAN				
DESIGNED BY: GO	JOB NUMBER			SHEET	
DRAWN BY: DL	S10928			S-4	
CHECKED BY: GO	DATE: 04/2026			6 of 12 SHTS.	
SCALE: AS SHOWN					

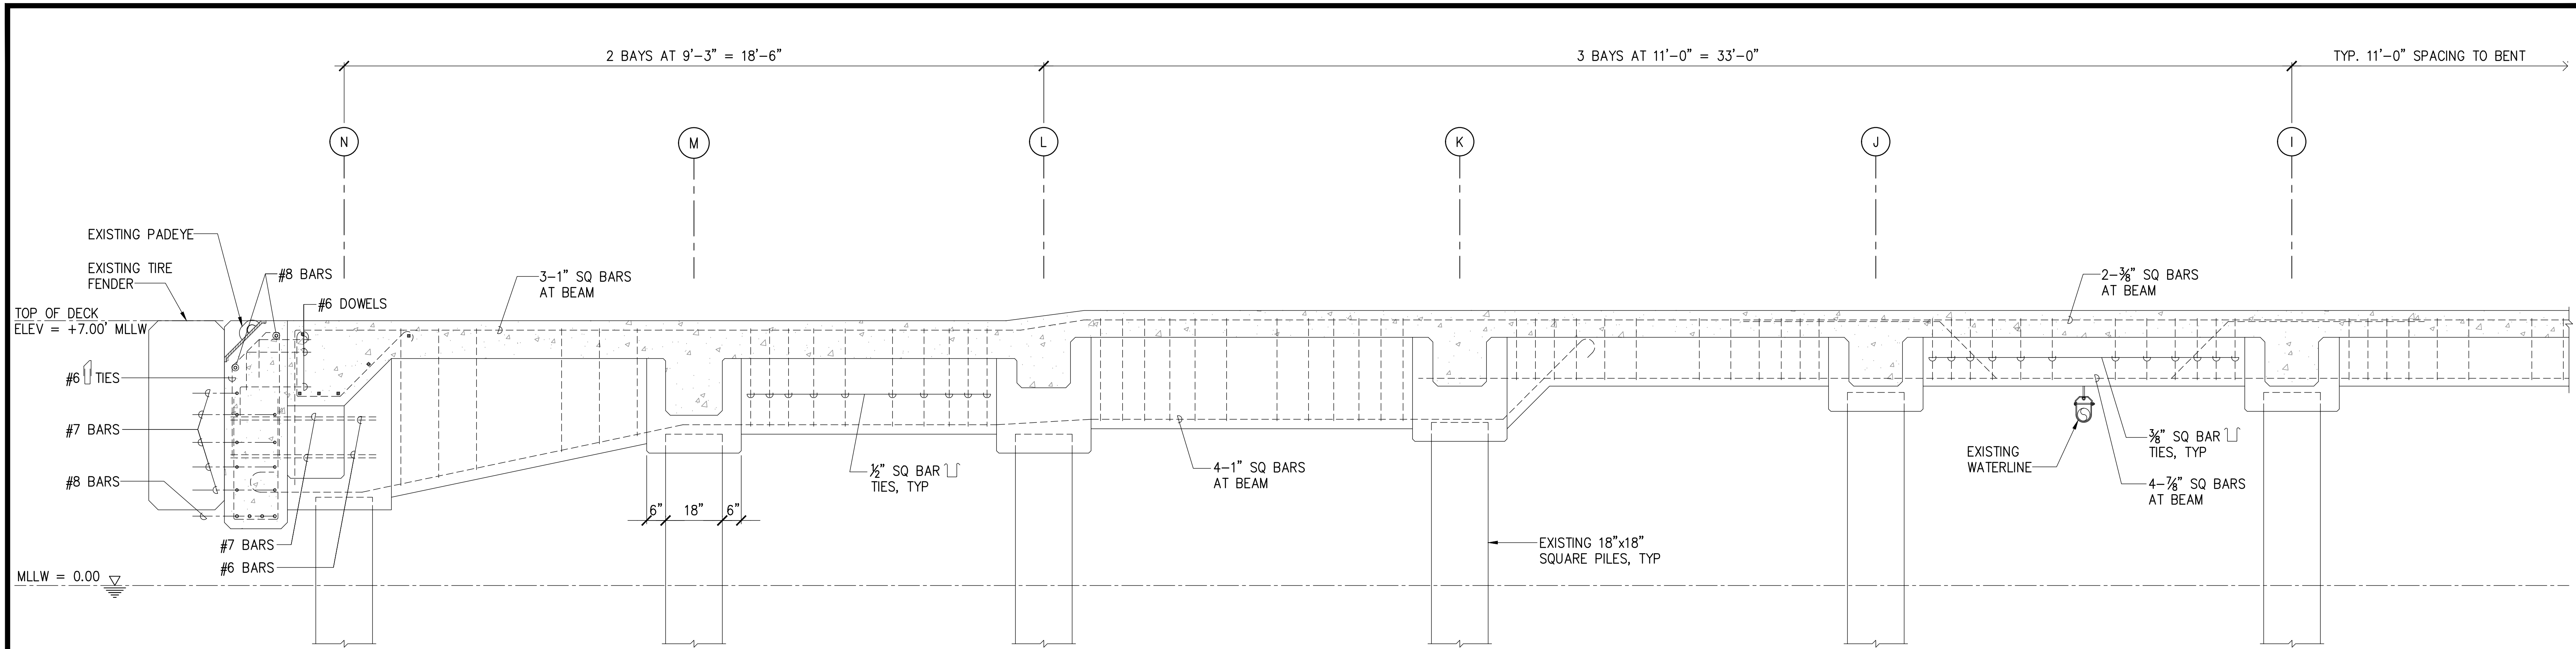

TYPICAL HALF SECTION NEAR BENT
SCALE: 1/2" = 1'-0"

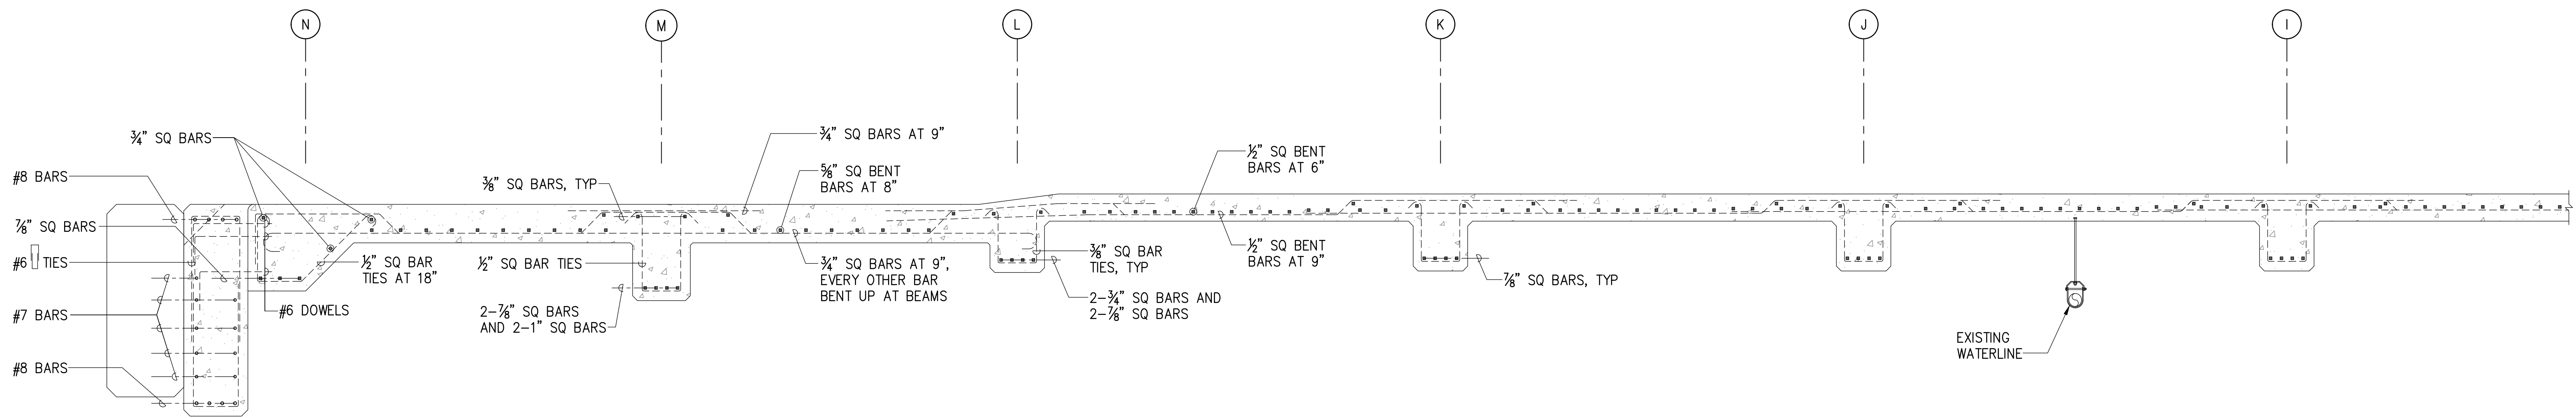


TYPICAL HALF SECTION THRU SLAB
SCALE: 1/2" = 1'-0"

NOTES:

- EXISTING REINFORCING STEEL SIZES SHOWN ARE BASED ON LIMITED AVAILABLE INFORMATION OF THE EXISTING CONDITIONS AND SHALL BE VERIFIED IN THE FIELD BY THE CONTRACTOR DURING THE ACTUAL REPAIRS.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR SHORING OF UTILITY LINES AND REINSTALLING EXISTING UTILITY HANGERS. LOCATIONS OF UTILITY HANGERS VARY AT BENT BEAMS AND/OR THE SLAB SOFFIT.


		REVISION DATE DESCRIPTION BY APPROVED	
STATE OF HAWAII DEPARTMENT OF TRANSPORTATION HARBORS			
JOB TITLE HONOLULU HARBOR, PIERS 13-14, SUBSTRUCTURE REPAIRS, PHASE 2, OAHU, HAWAII			
SHEET TITLE TYPICAL PIER SECTIONS			
DESIGNED BY: GO DRAWN BY: DL CHECKED BY: GO DATE: 04/2026 SCALE: AS SHOWN	JOB NUMBER S10928		SHEET S-5 7 of 12 SHTS.

THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION
 EXP. 4-30-28
 MKE ASSOCIATES LLC

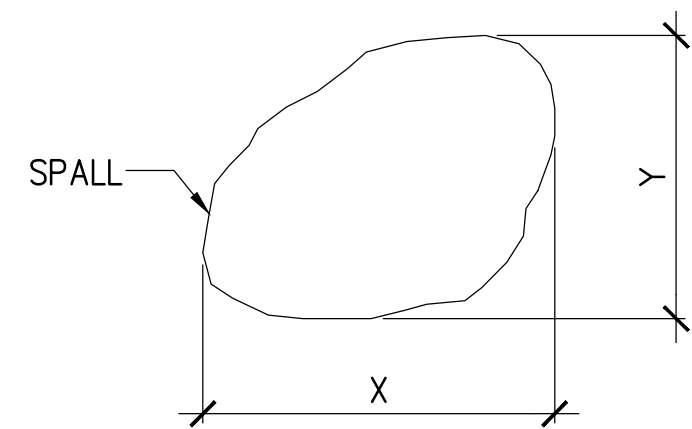


EXISTING SPALL AREA = X x Y

SOFFIT PLAN

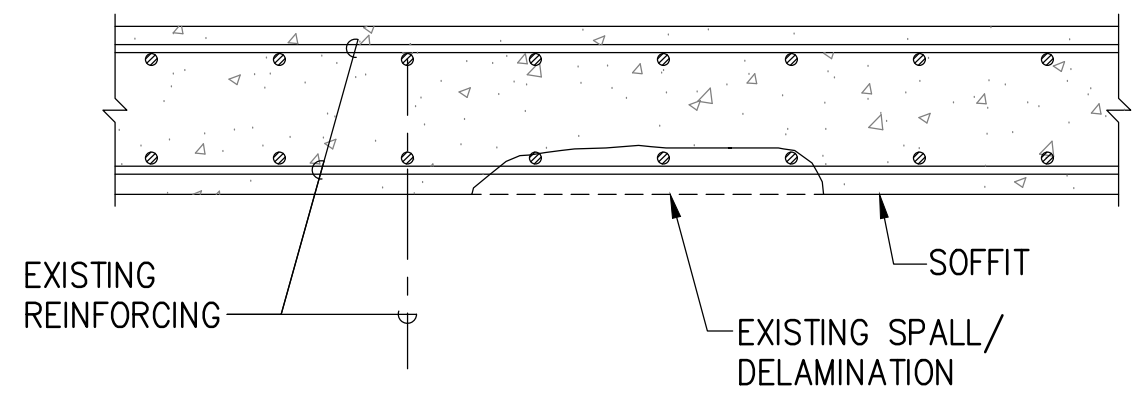


SECTION

EXISTING CONDITION

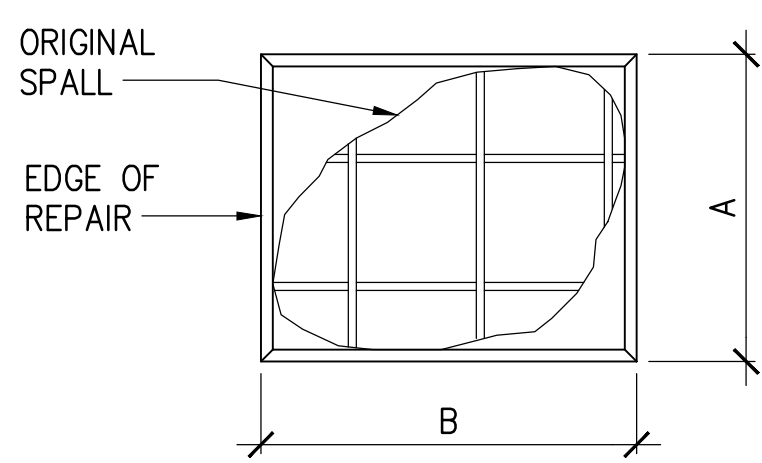


PAY AREA = A x B

SOFFIT PLAN

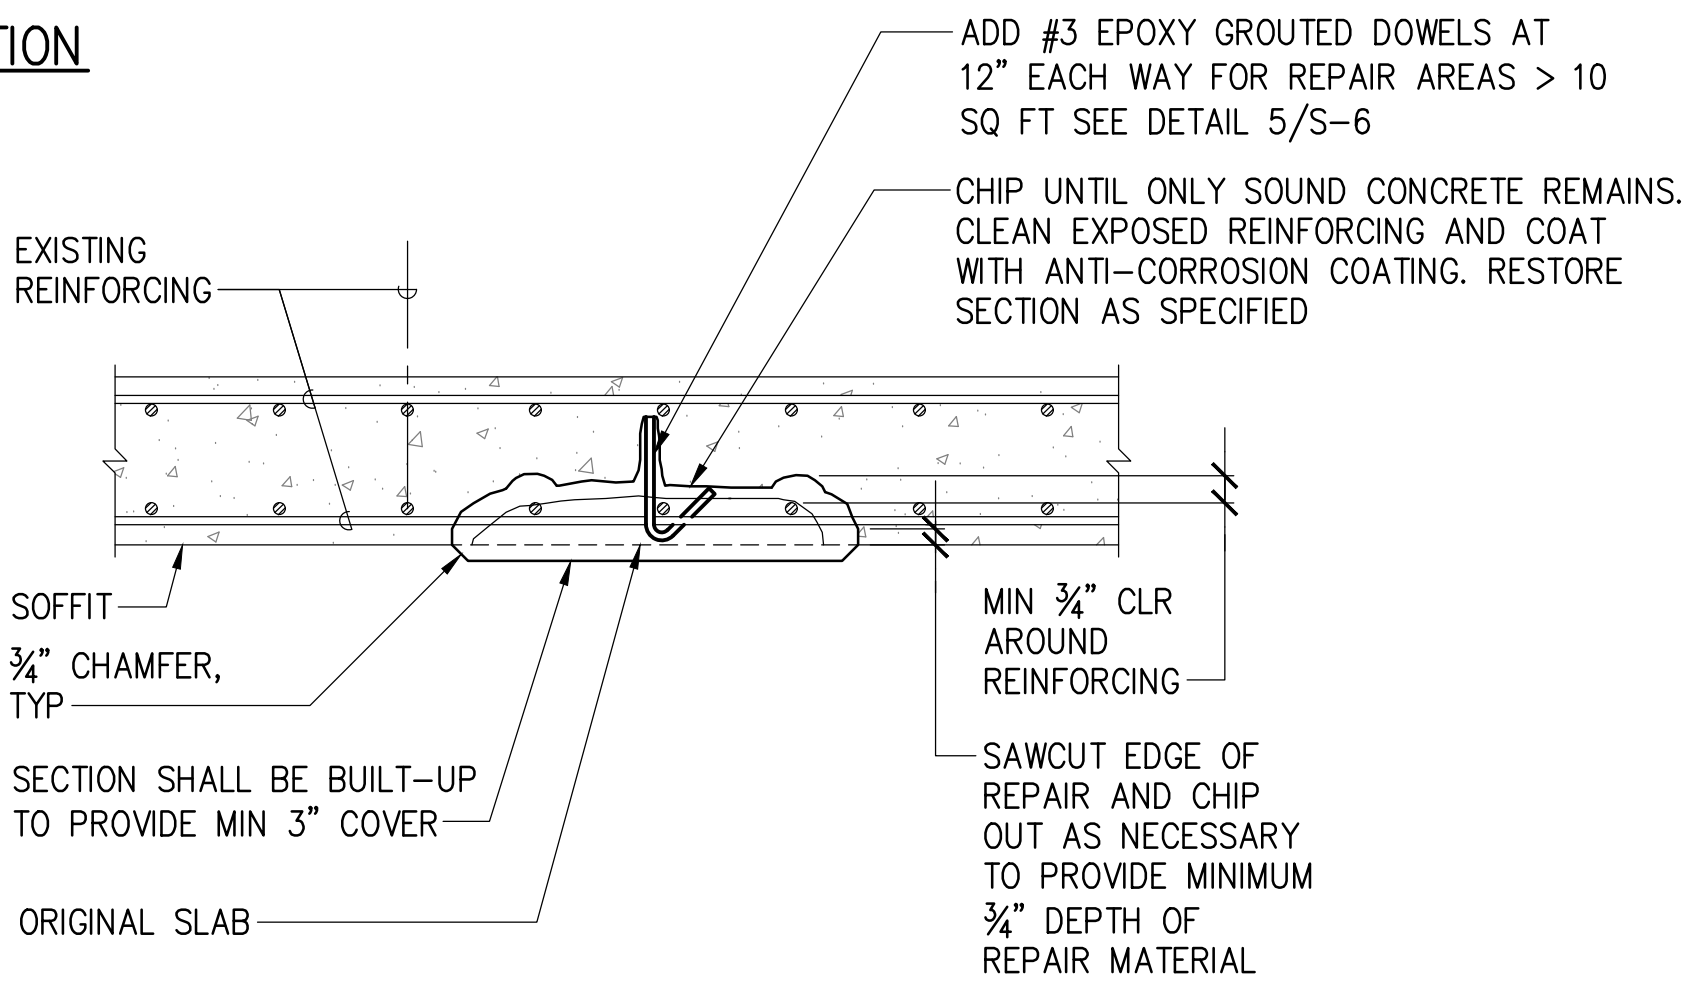


SECTION

REPAIRED CONDITION

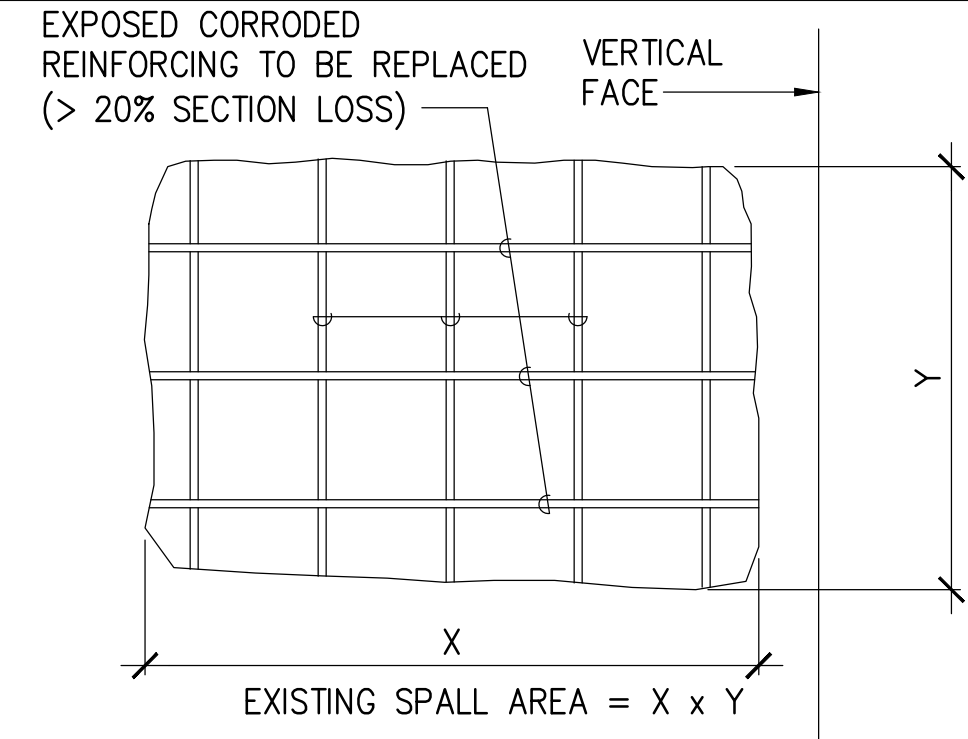


EXISTING SPALL AREA = X x Y

SOFFIT PLAN

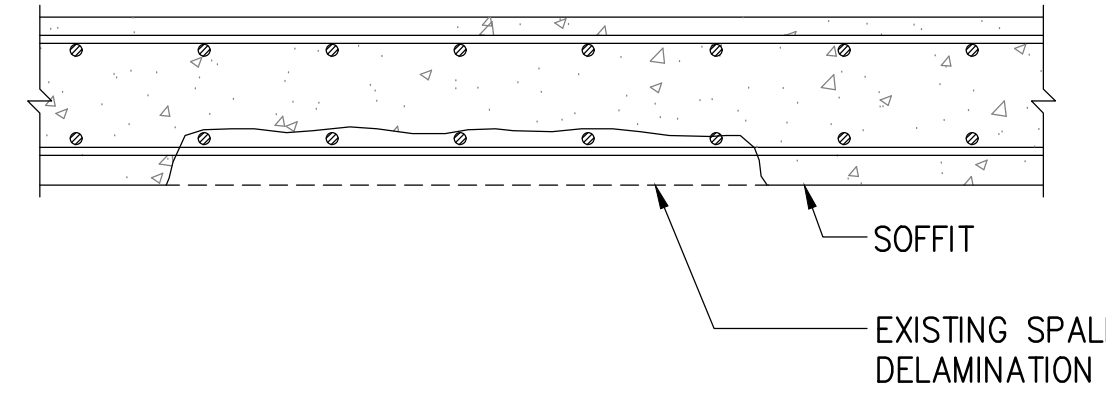

SECTION


EXISTING CONDITION

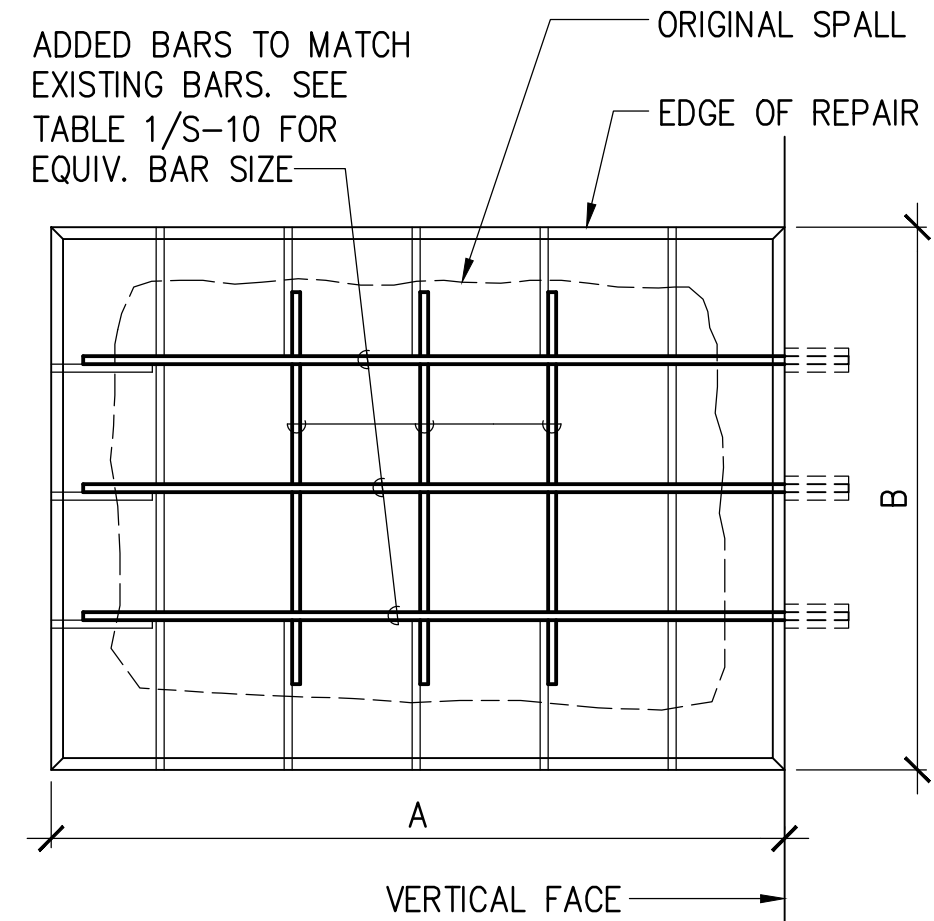

PAY AREA = A x B

SOFFIT PLAN

REPAIRED CONDITION

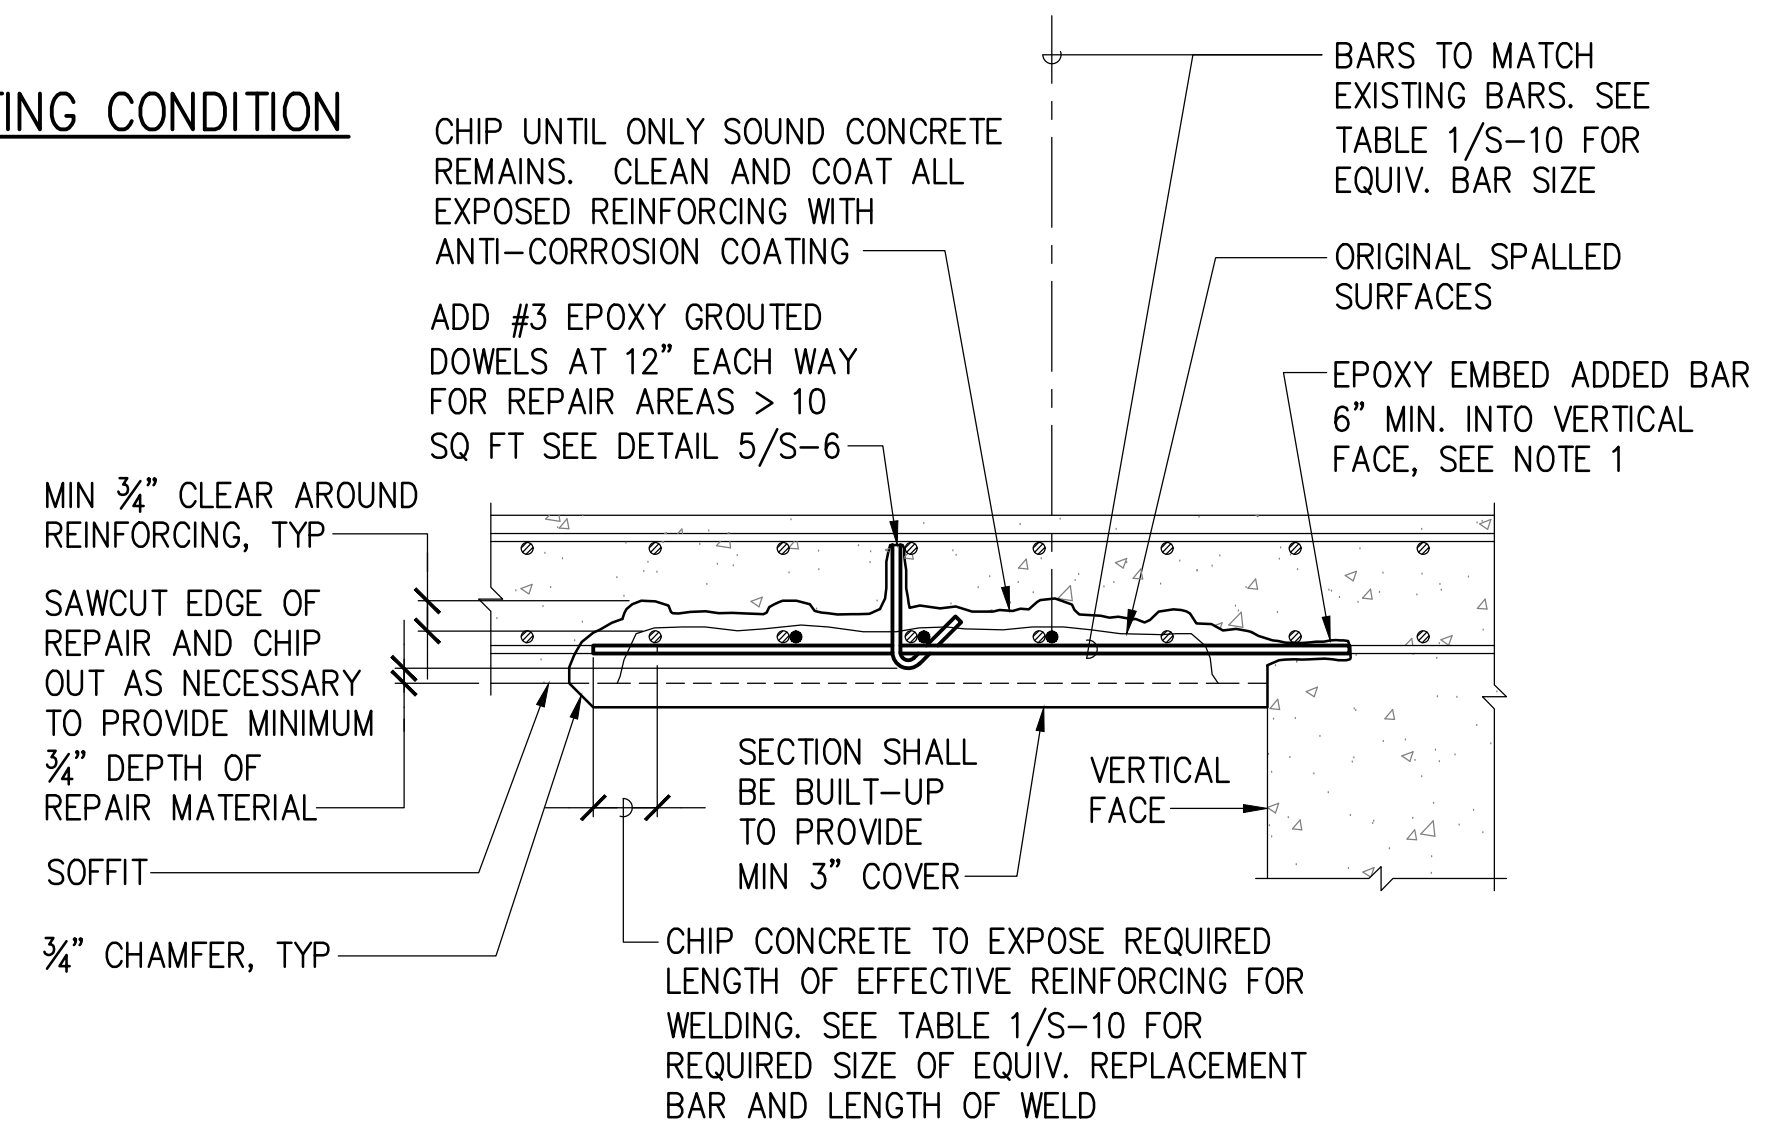


SECTION

1 SLAB SOFFIT SPALL REPAIR (TYPE S)
S-6 NOT TO SCALE


2 SLAB SOFFIT SPALL REPAIR WITH REINFORCING STEEL REPLACEMENT (TYPE SR)
S-6 NOT TO SCALE

NOTE:
1. NOTIFY CONSTRUCTION ENGINEER IF EPOXY EMBED BARS ARE LARGER THAN #5 BARS.

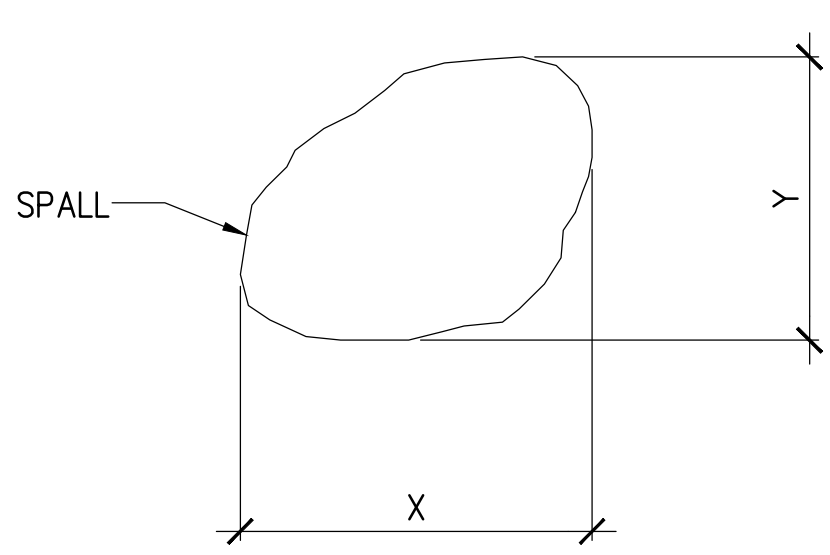


EXISTING SPALL AREA = X x Y

ELEVATION

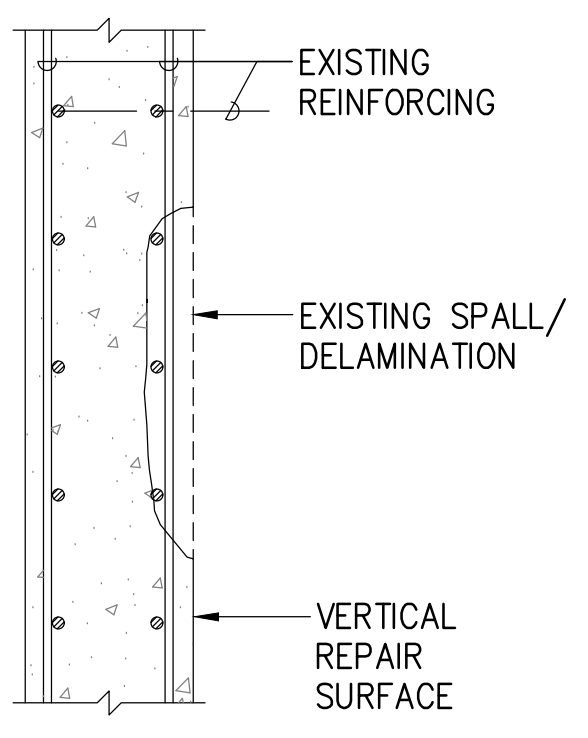

SECTION

EXISTING CONDITION

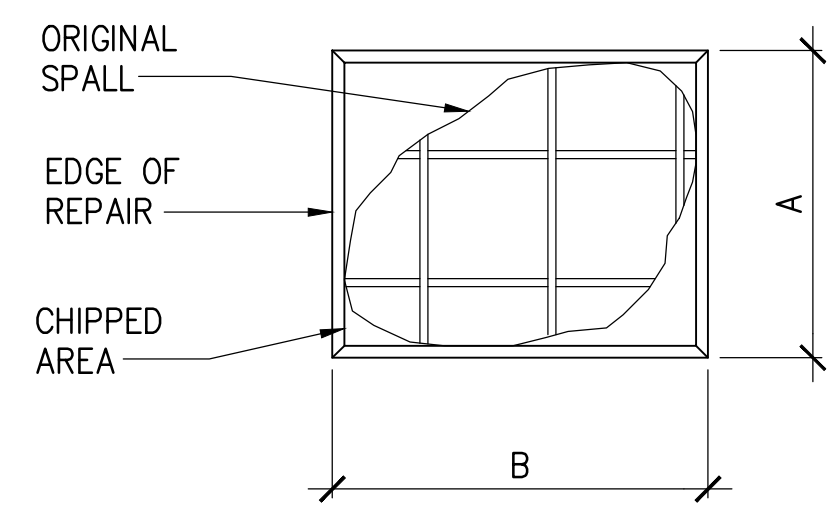


PAY AREA = A x B


ELEVATION

REPAIRED CONDITION

CHIP UNTIL ONLY SOUND CONCRETE REMAINS. CLEAN EXPOSED REINFORCING AND COAT WITH ANTI-CORROSION COATING. RESTORE SECTION AS SPECIFIED

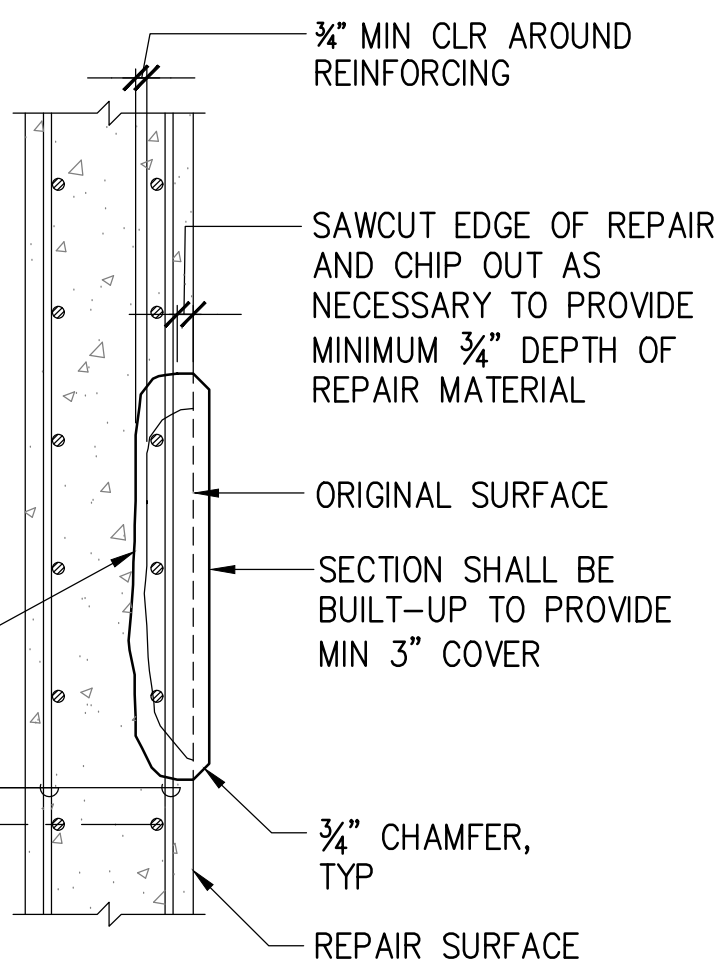


SECTION

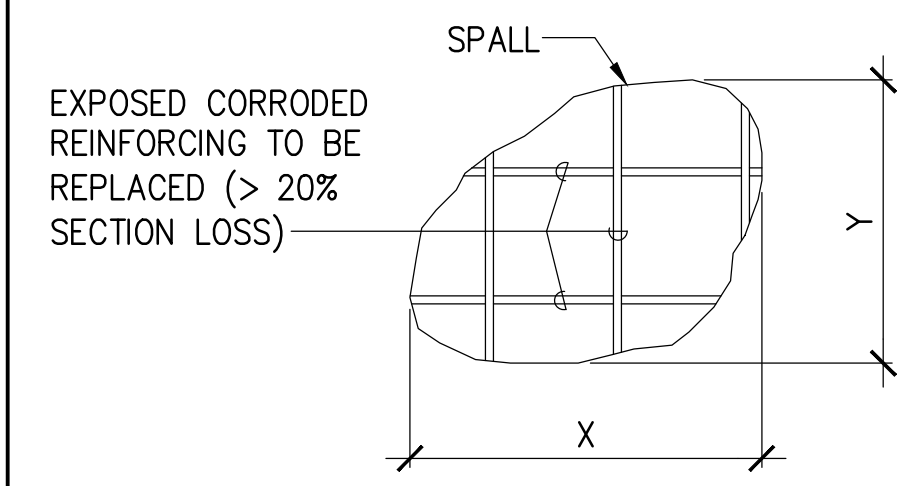

EXISTING SPALL AREA = X x Y

ELEVATION

EXISTING CONDITION

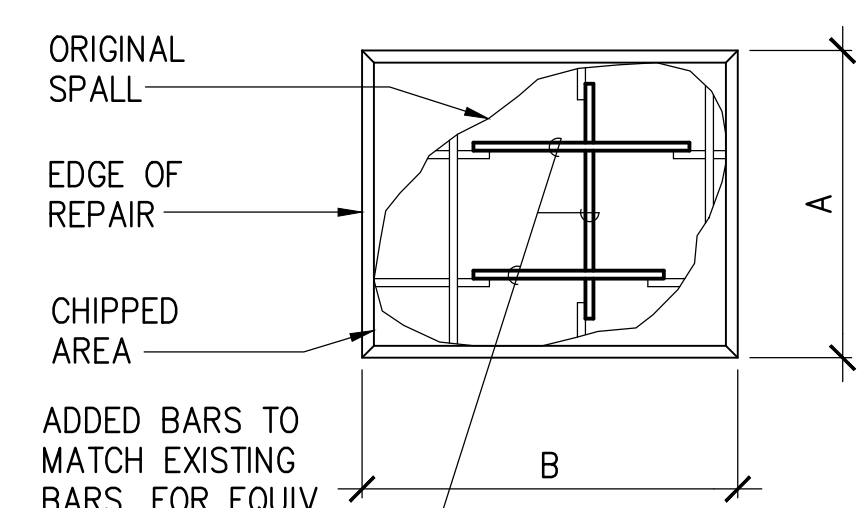


PAY AREA = A x B


ELEVATION

REPAIRED CONDITION

ADDED BARS TO MATCH EXISTING BARS. FOR EQUIV. BAR SIZE, SEE DETAIL 1/S-10

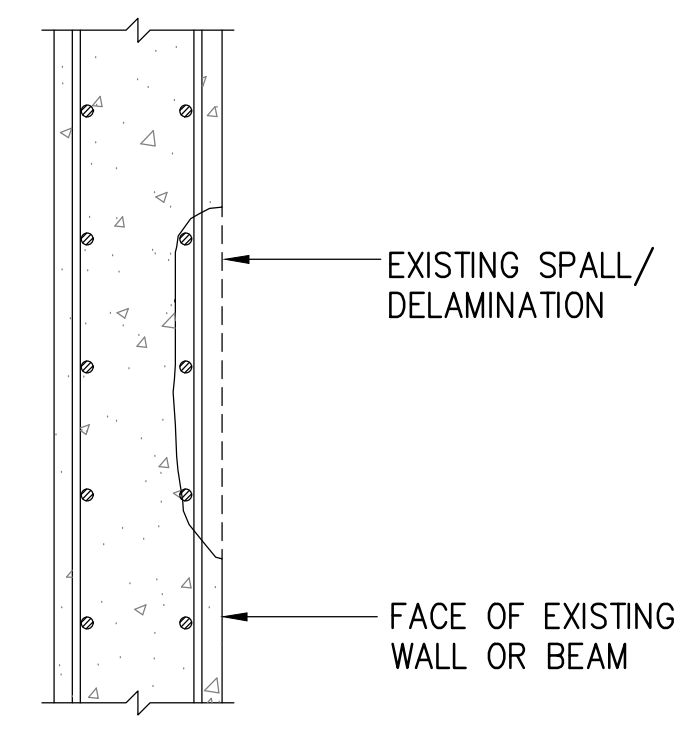


SECTION

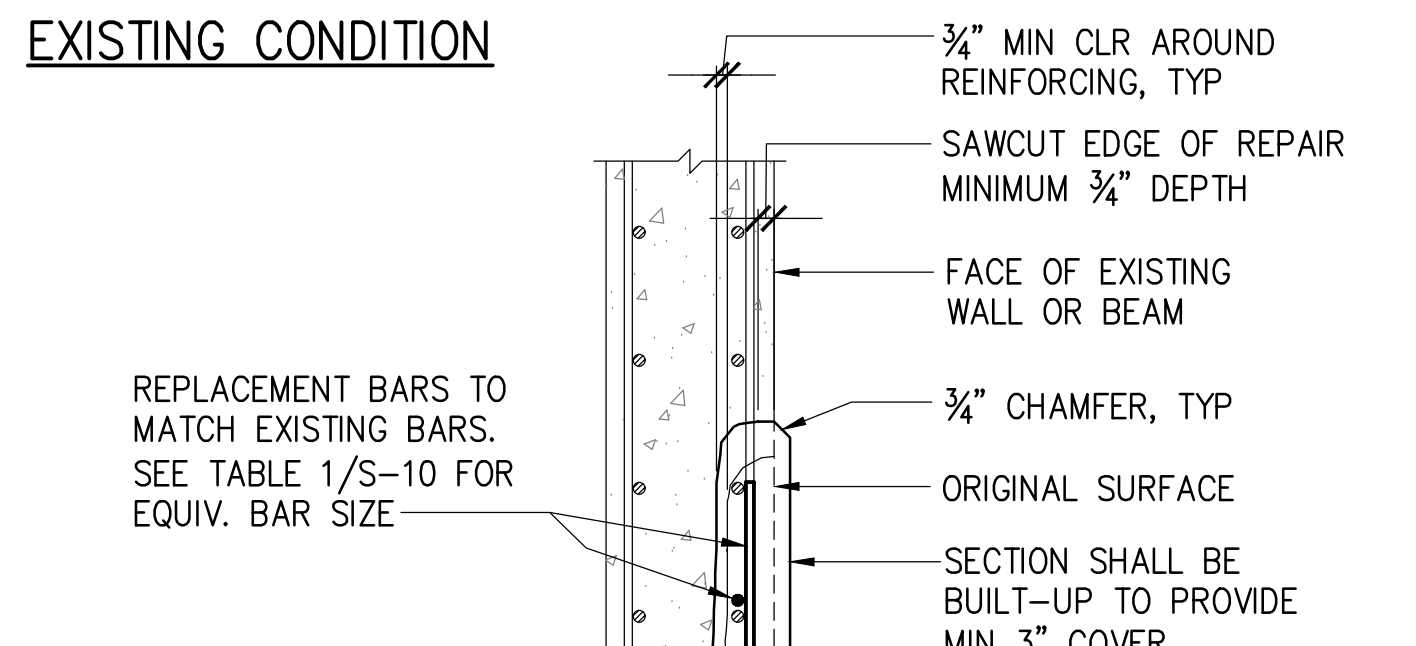

SECTION

3 VERTICAL SPALL REPAIR WITH REINFORCING STEEL REPLACEMENT (TYPE VR)
S-6 NOT TO SCALE

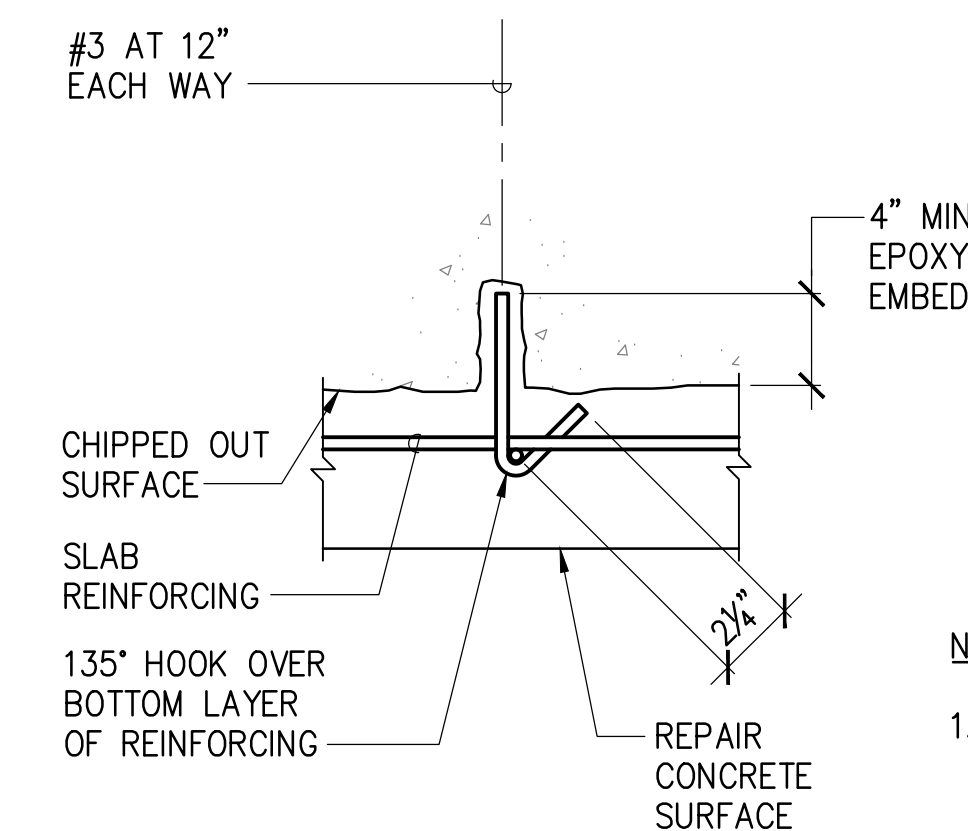

NOTE:
1. AS AN ALTERNATE TO THE #3 HOOKED REINFORCING BAR, A 3/8" DIA STAINLESS HEADED BOLT MAY BE USED.




5 EPOXY GROUDED DOWEL DETAIL
S-6 NOT TO SCALE

3 VERTICAL SPALL REPAIR (TYPE V)
S-6 NOT TO SCALE

GRANT J. OKUNICA
LICENSED PROFESSIONAL ENGINEER
No. 13001-S
HAWAII, U.S.A.

THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION
EXP. 4-30-28
MKE ASSOCIATES LLC

REVISION	DATE	DESCRIPTION	BY	APPROVED
STATE OF HAWAII DEPARTMENT OF TRANSPORTATION HARBORS				
JOB TITLE HONOLULU HARBOR, PIERS 13-14, SUBSTRUCTURE REPAIRS, PHASE 2, OAHU, HAWAII				
SHEET TITLE SLAB SOFFIT AND VERTICAL SPALL REPAIR DETAILS				
DESIGNED BY: GO	JOB NUMBER		SHEET	
DRAWN BY: DL	S10928		S-6	
CHECKED BY: GO	DATE: 04/20/26		8 of 12 SHTS.	
SCALE: AS SHOWN				

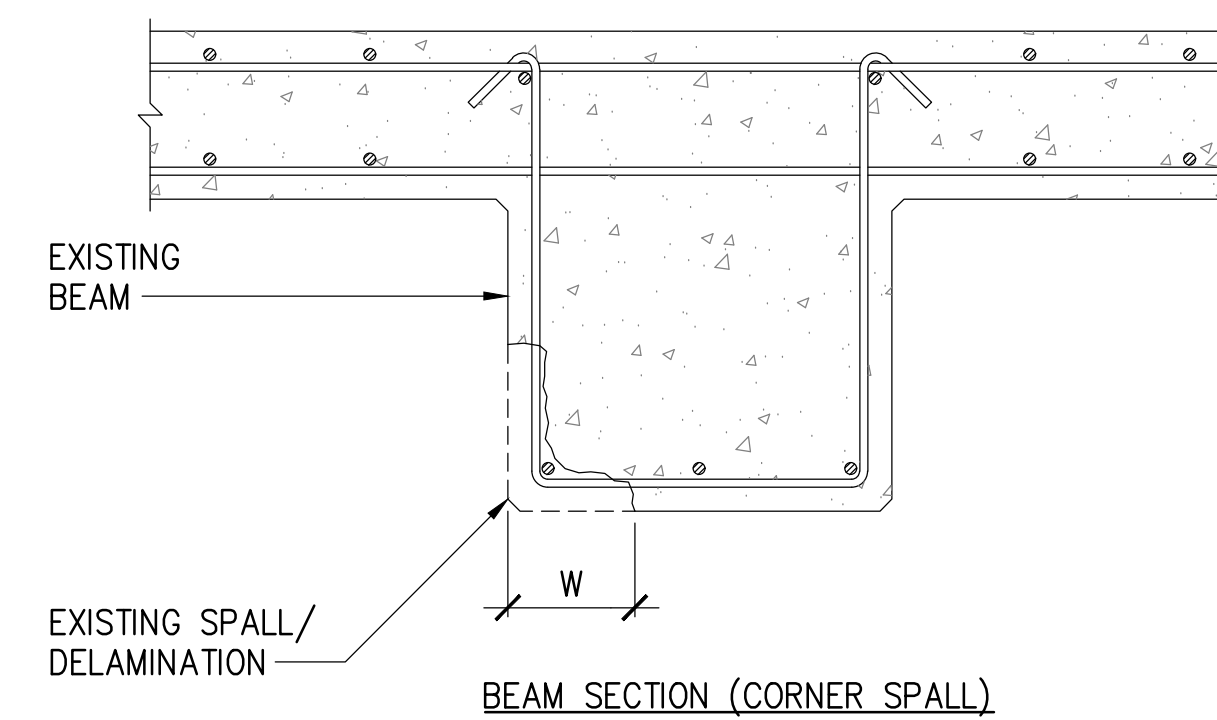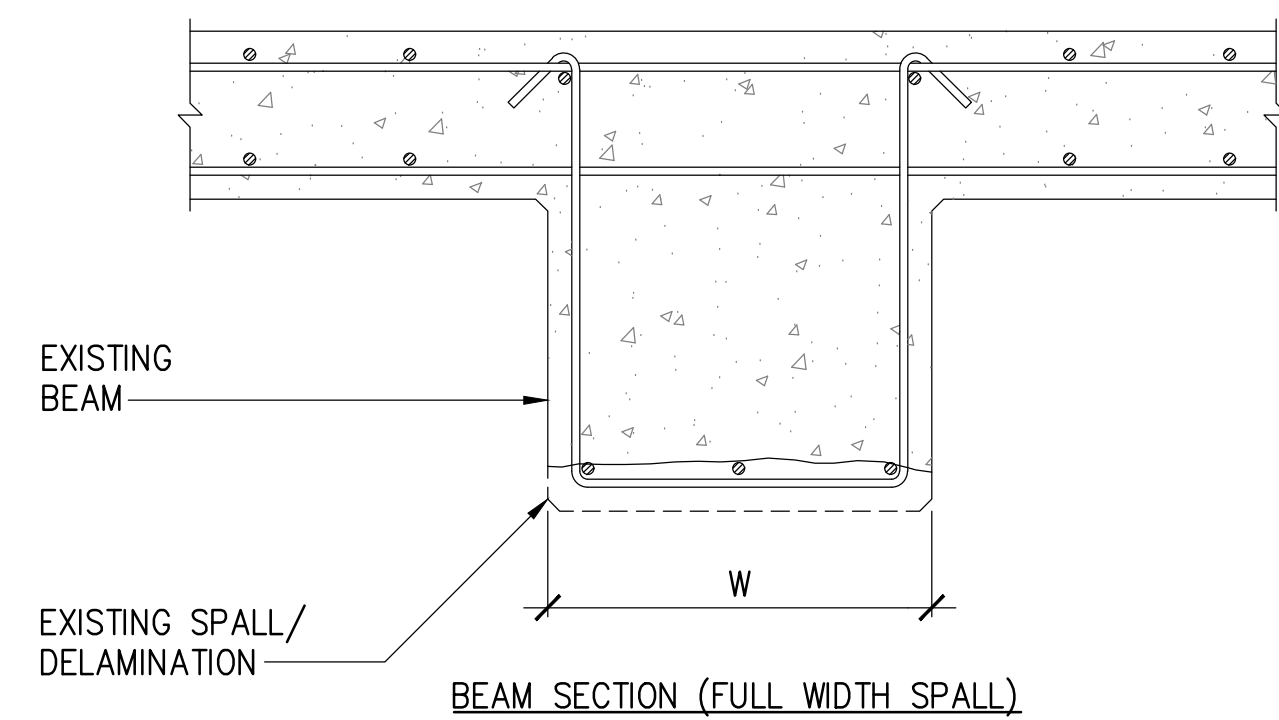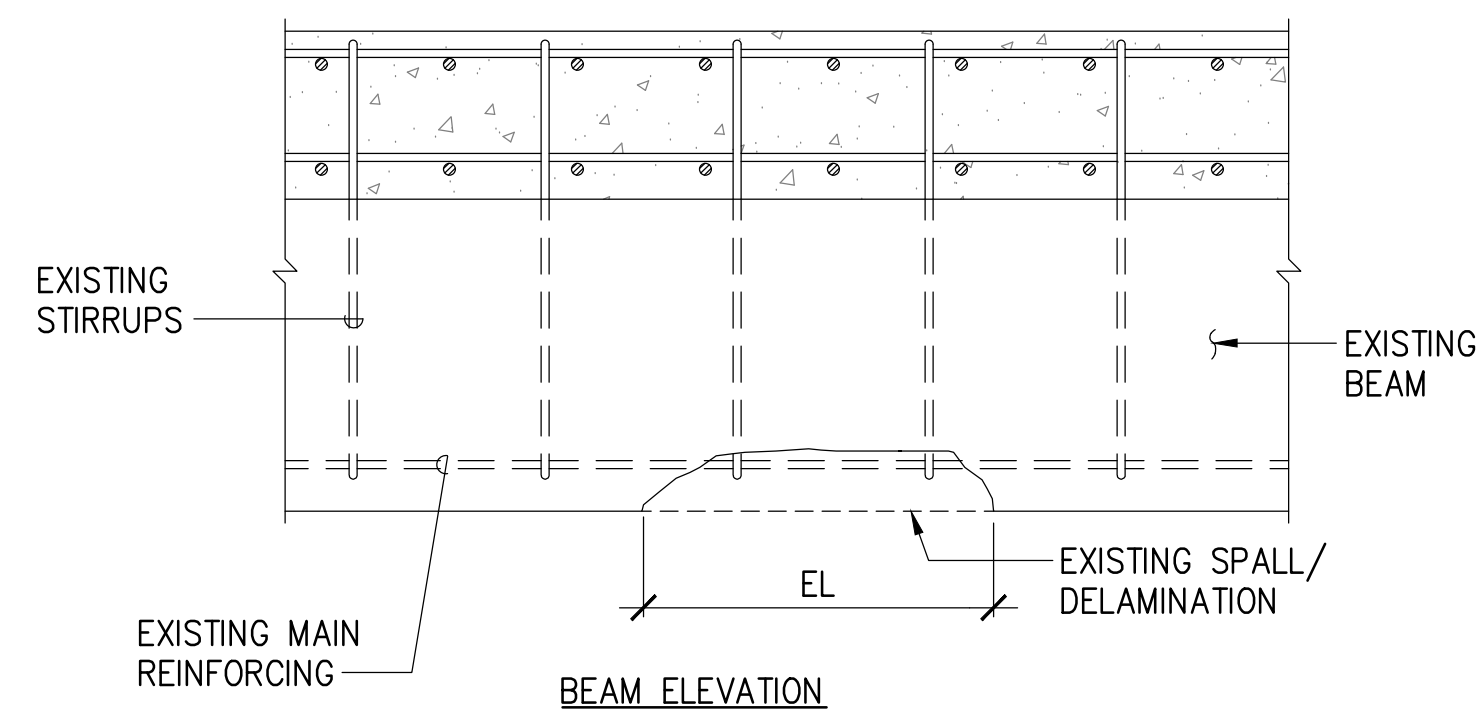




PAY AREA:
 HL = HEIGHT OF REPAIR (LEFT SIDE)
 HR = HEIGHT OF REPAIR (RIGHT SIDE)
 W = ORIGINAL WIDTH OF BEAM/GIRDER
 EL = EXISTING LENGTH OF SPALL
 NL = LENGTH OF REPAIR

PAY AREA = (HL+HR+W)NL

NOTE:




- PAY AREA SHALL BE THE TOTAL REPAIRED AREA ON ALL BEAM FACES. IF HL, HR OR W VARY ALONG THE LENGTH OF REPAIR, PAY AREA SHALL BE CALCULATED INDIVIDUALLY FOR EACH BEAM FACE.

EXISTING CONDITION

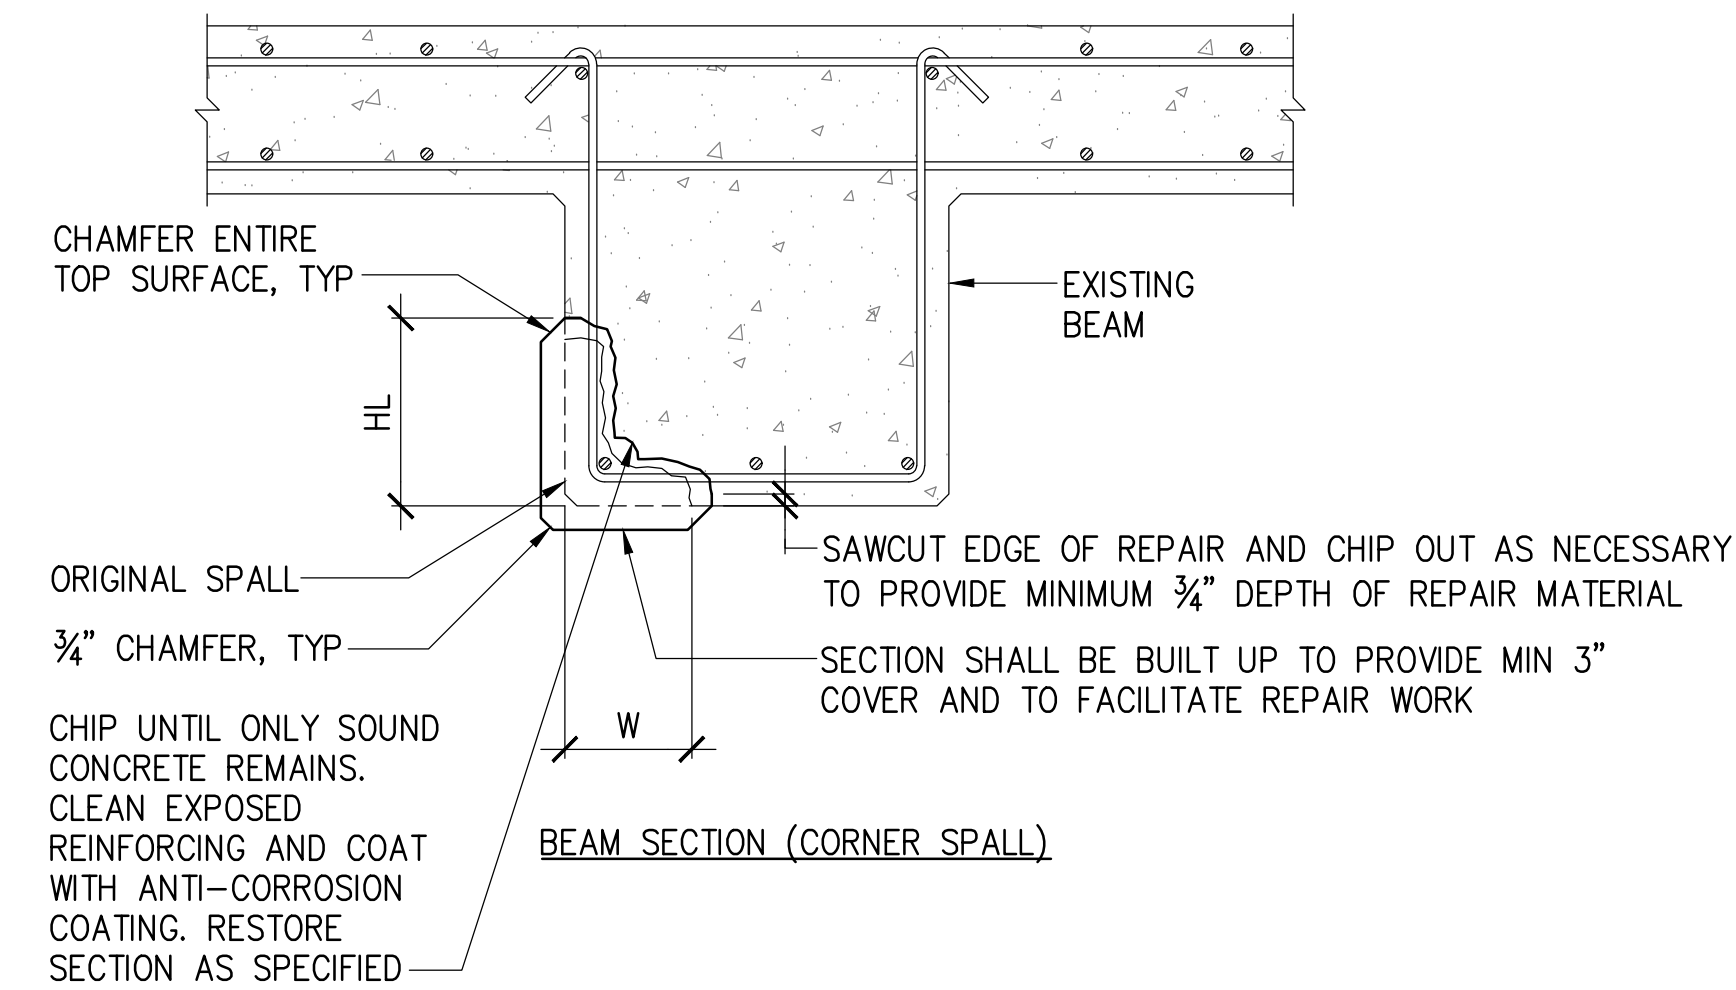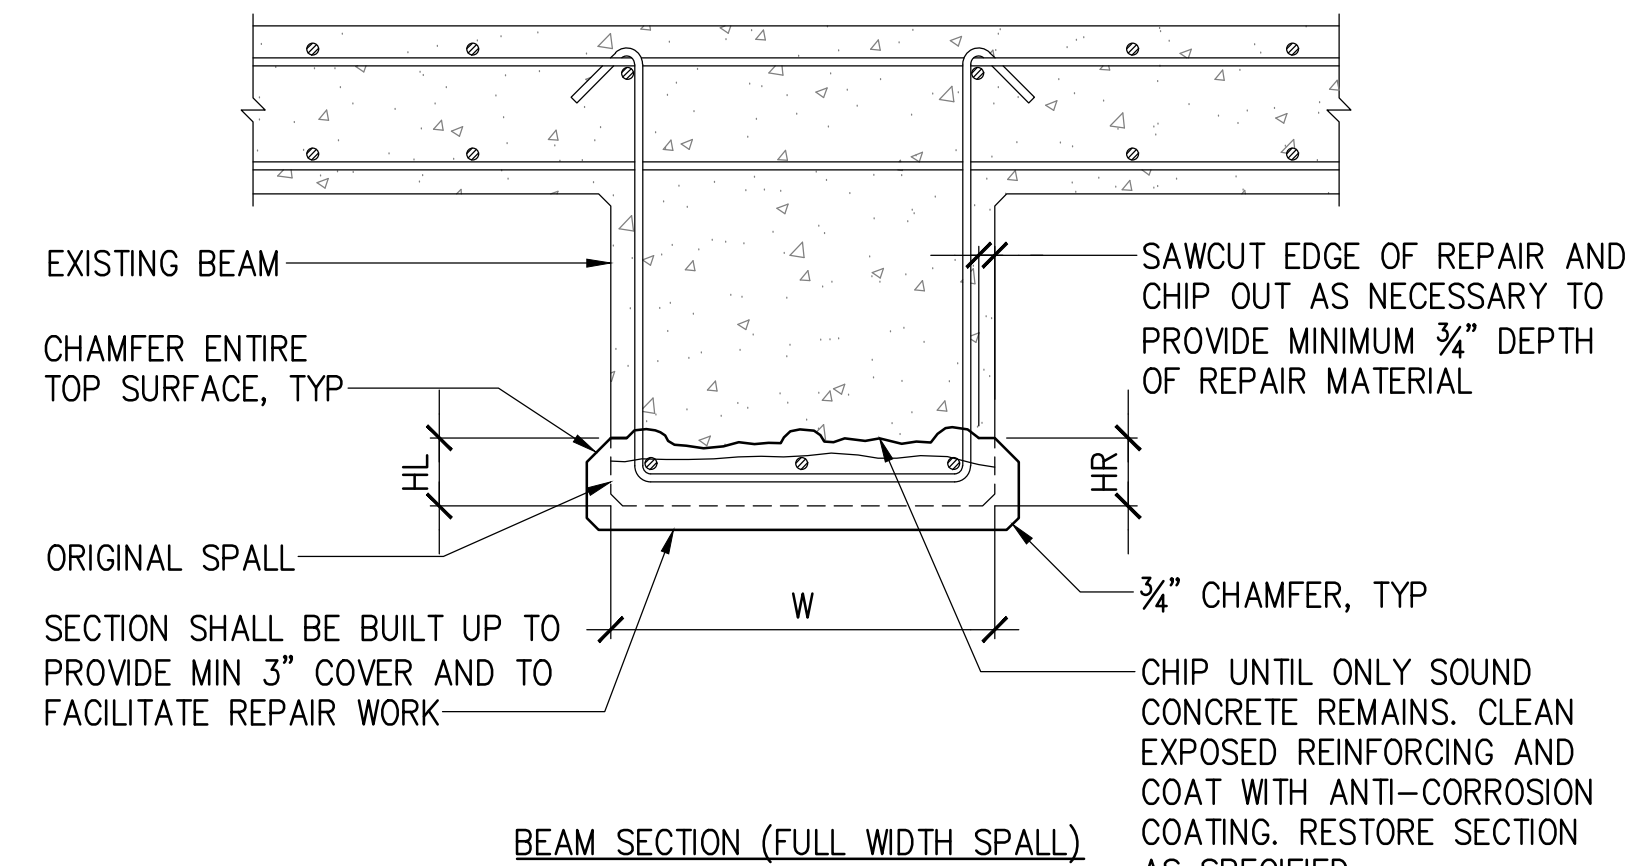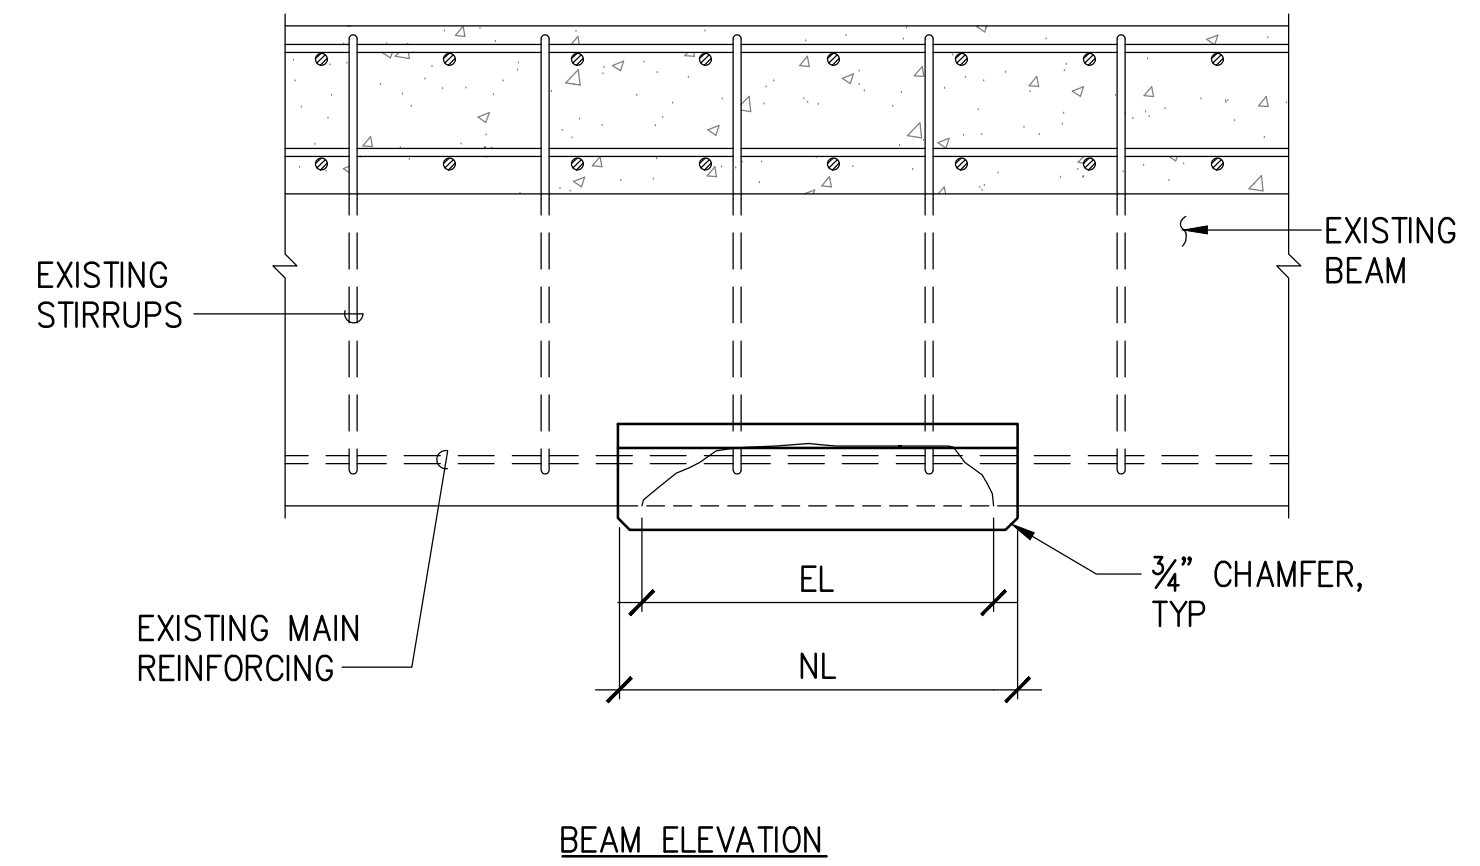

REPAIRED CONDITION

1 BEAM SPALL REPAIR (TYPE B)
 S-7 NOT TO SCALE

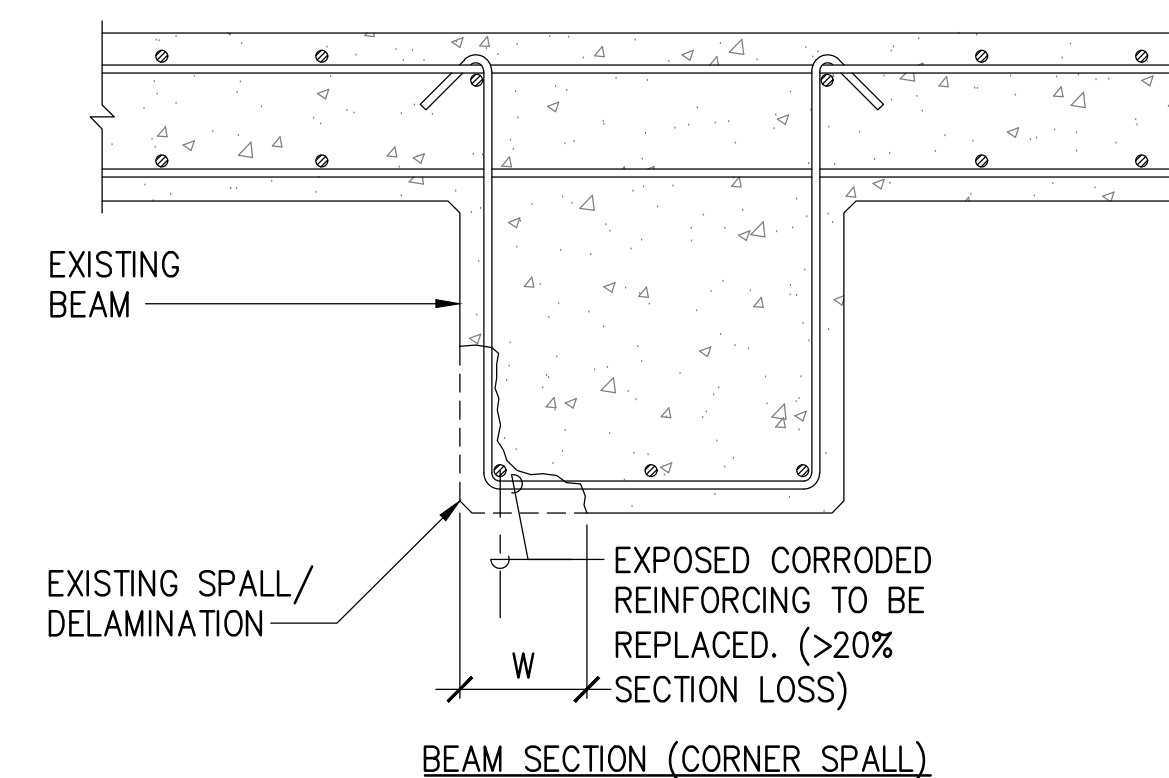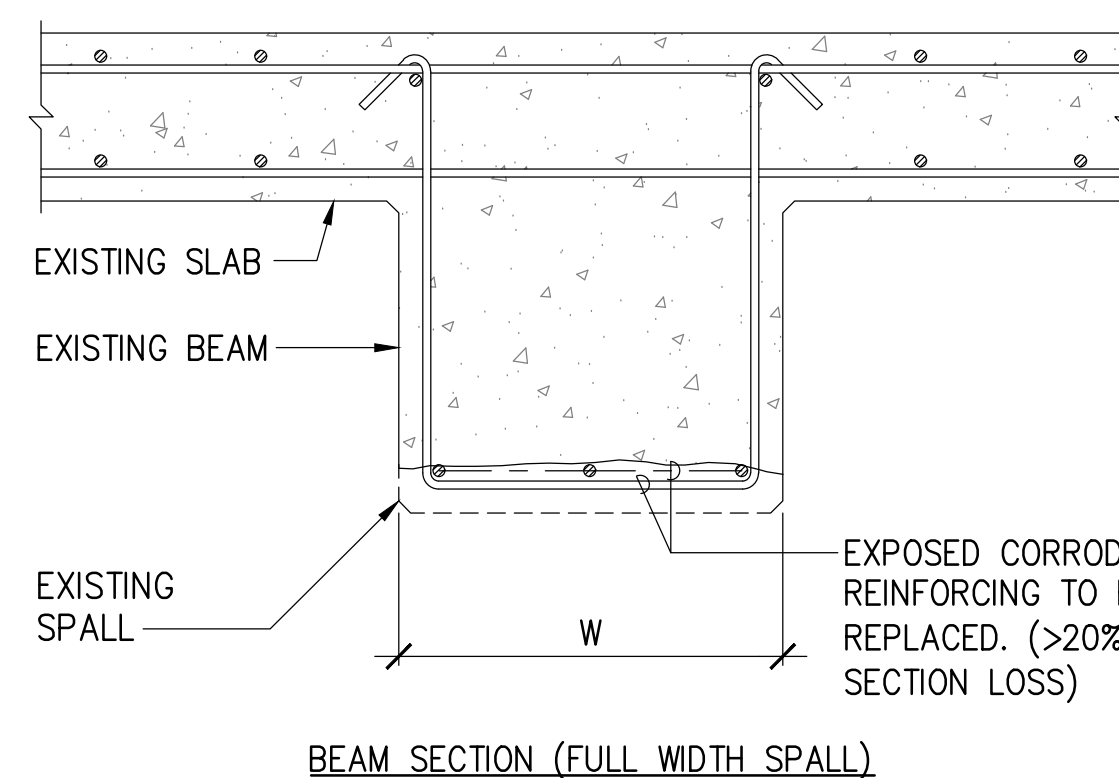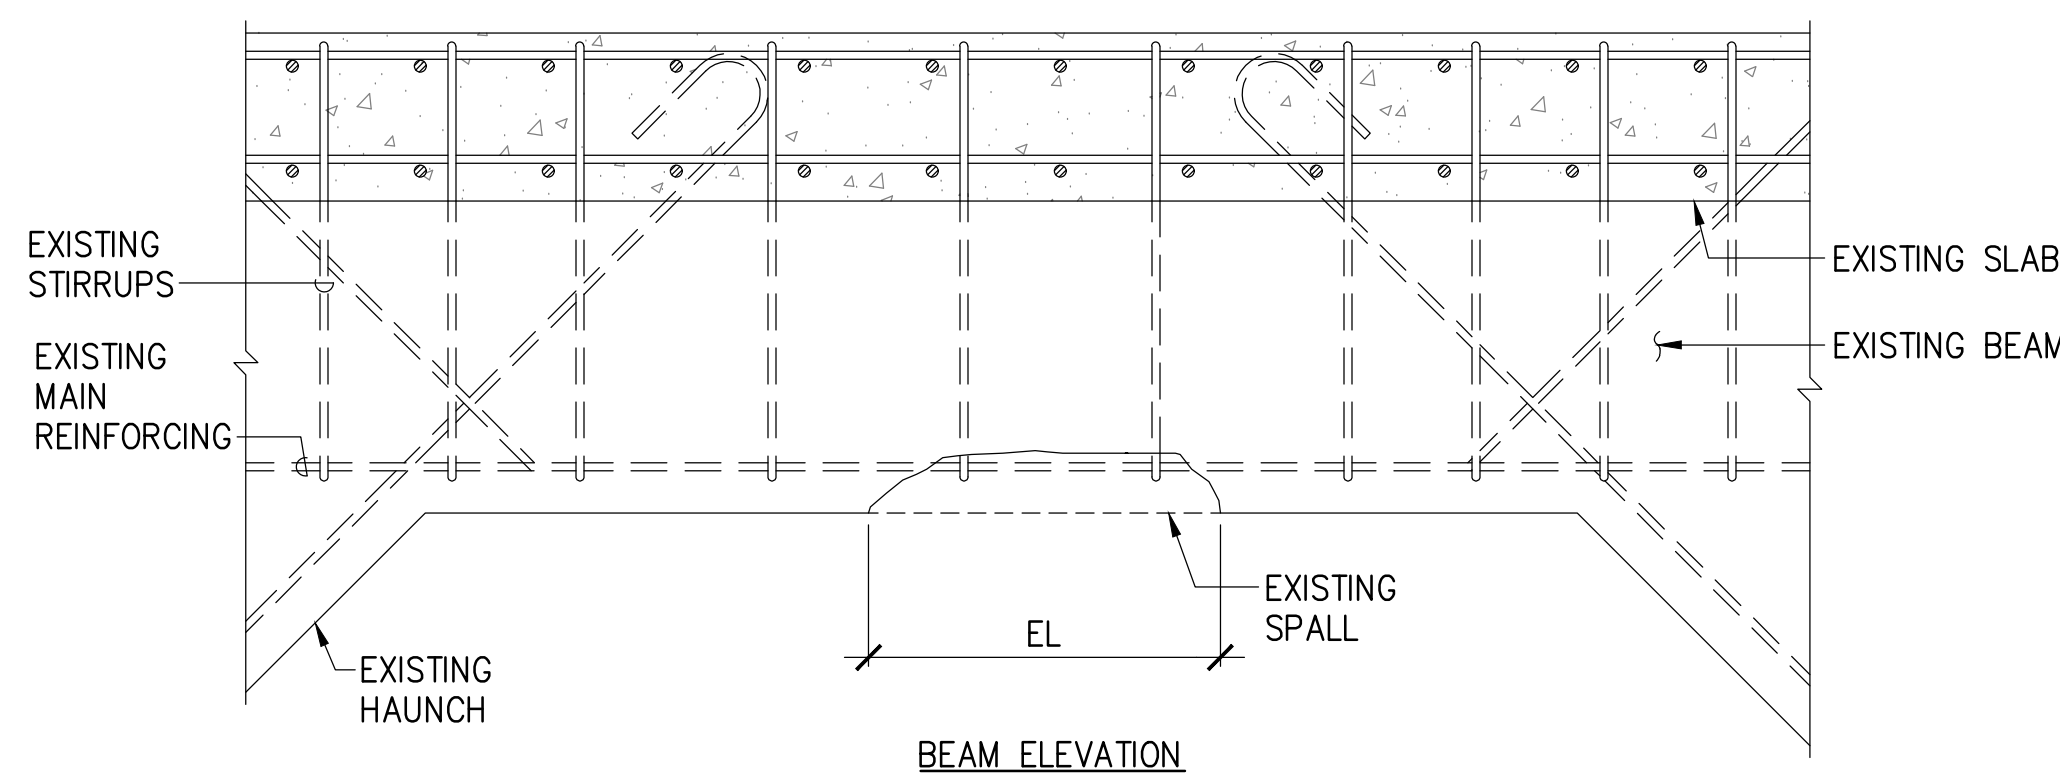




PAY AREA:
 HL = HEIGHT OF REPAIR (LEFT SIDE)
 HR = HEIGHT OF REPAIR (RIGHT SIDE)
 W = ORIGINAL WIDTH OF BEAM/GIRDER SPALL
 EL = EXISTING LENGTH OF SPALL
 NL = LENGTH OF REPAIR

PAY AREA = (HL+HR+W)NL

NOTE:

- PAY AREA SHALL BE THE TOTAL REPAIRED AREA ON ALL BEAM FACES. IF HL, HR OR W VARY ALONG THE LENGTH OF REPAIR, PAY AREA SHALL BE CALCULATED INDIVIDUALLY FOR EACH BEAM FACE.

EXISTING CONDITION

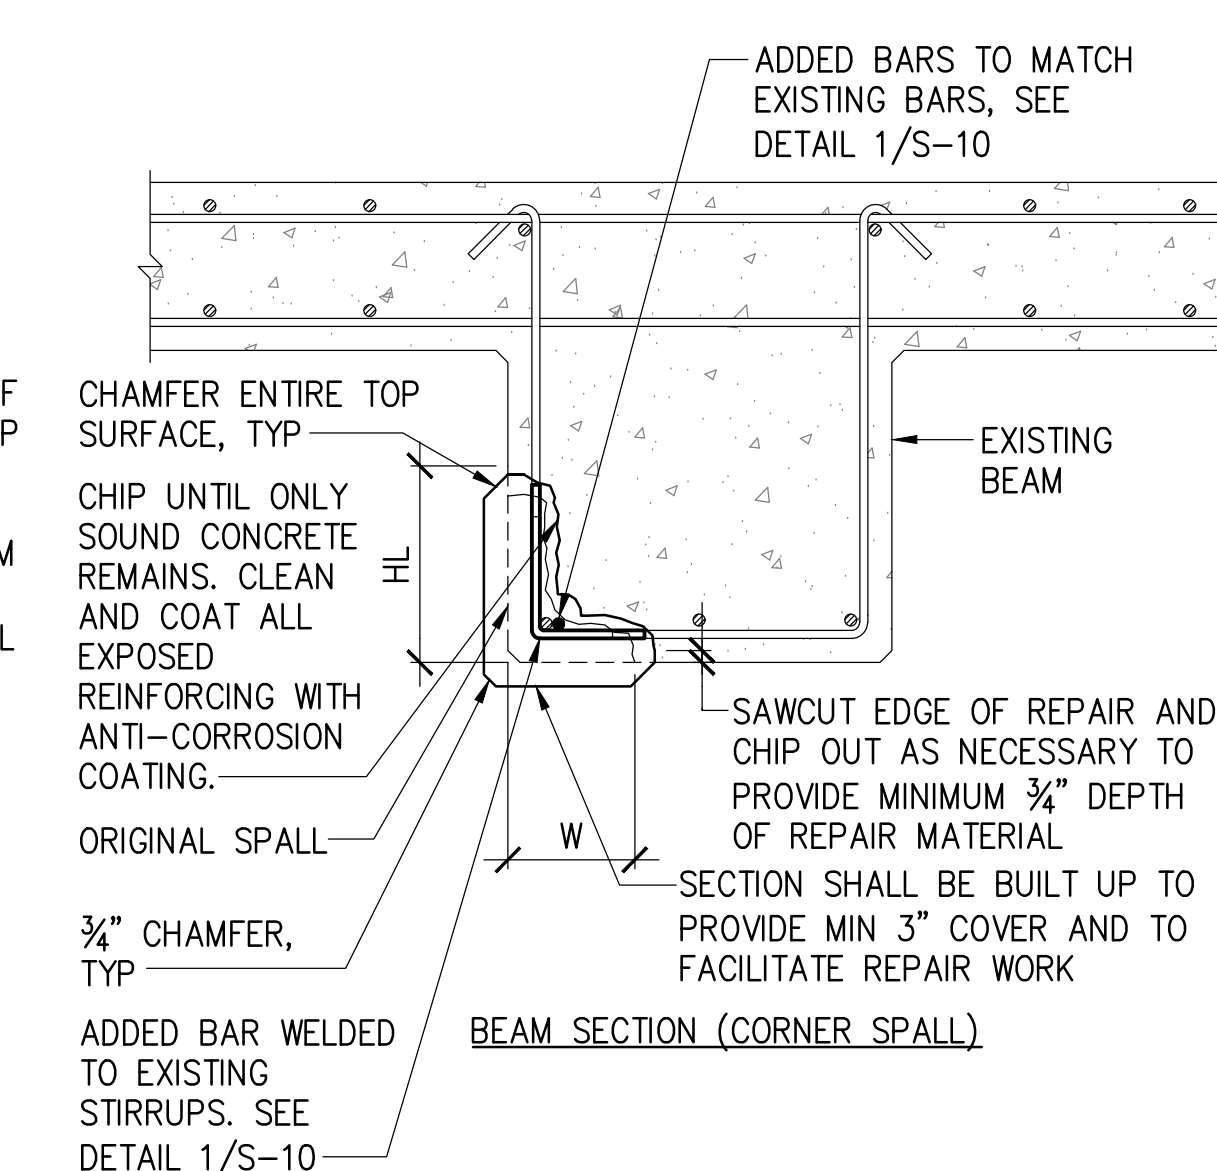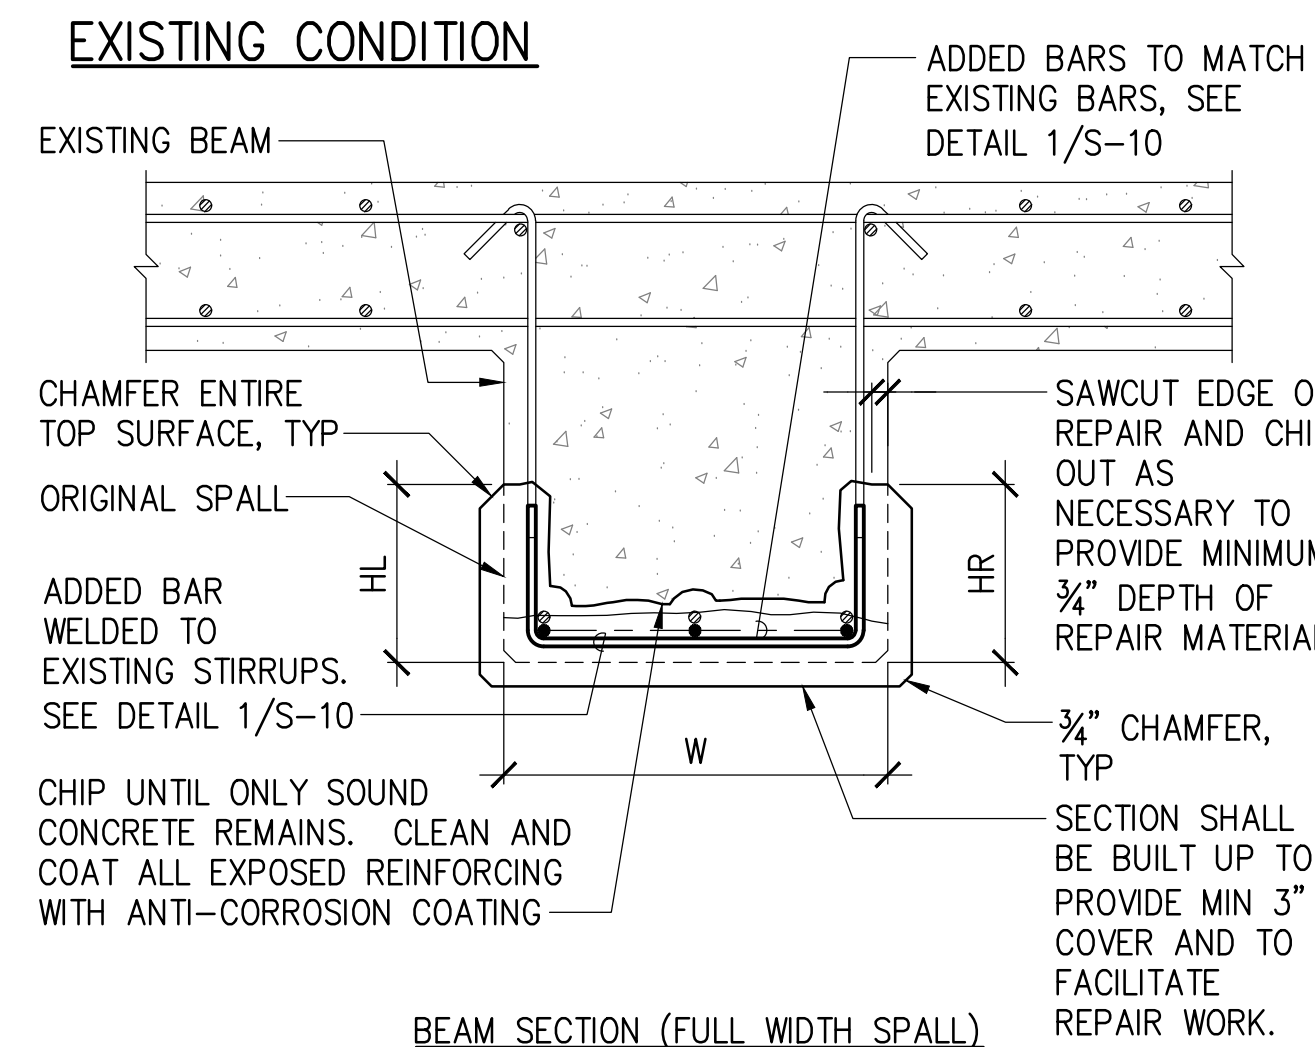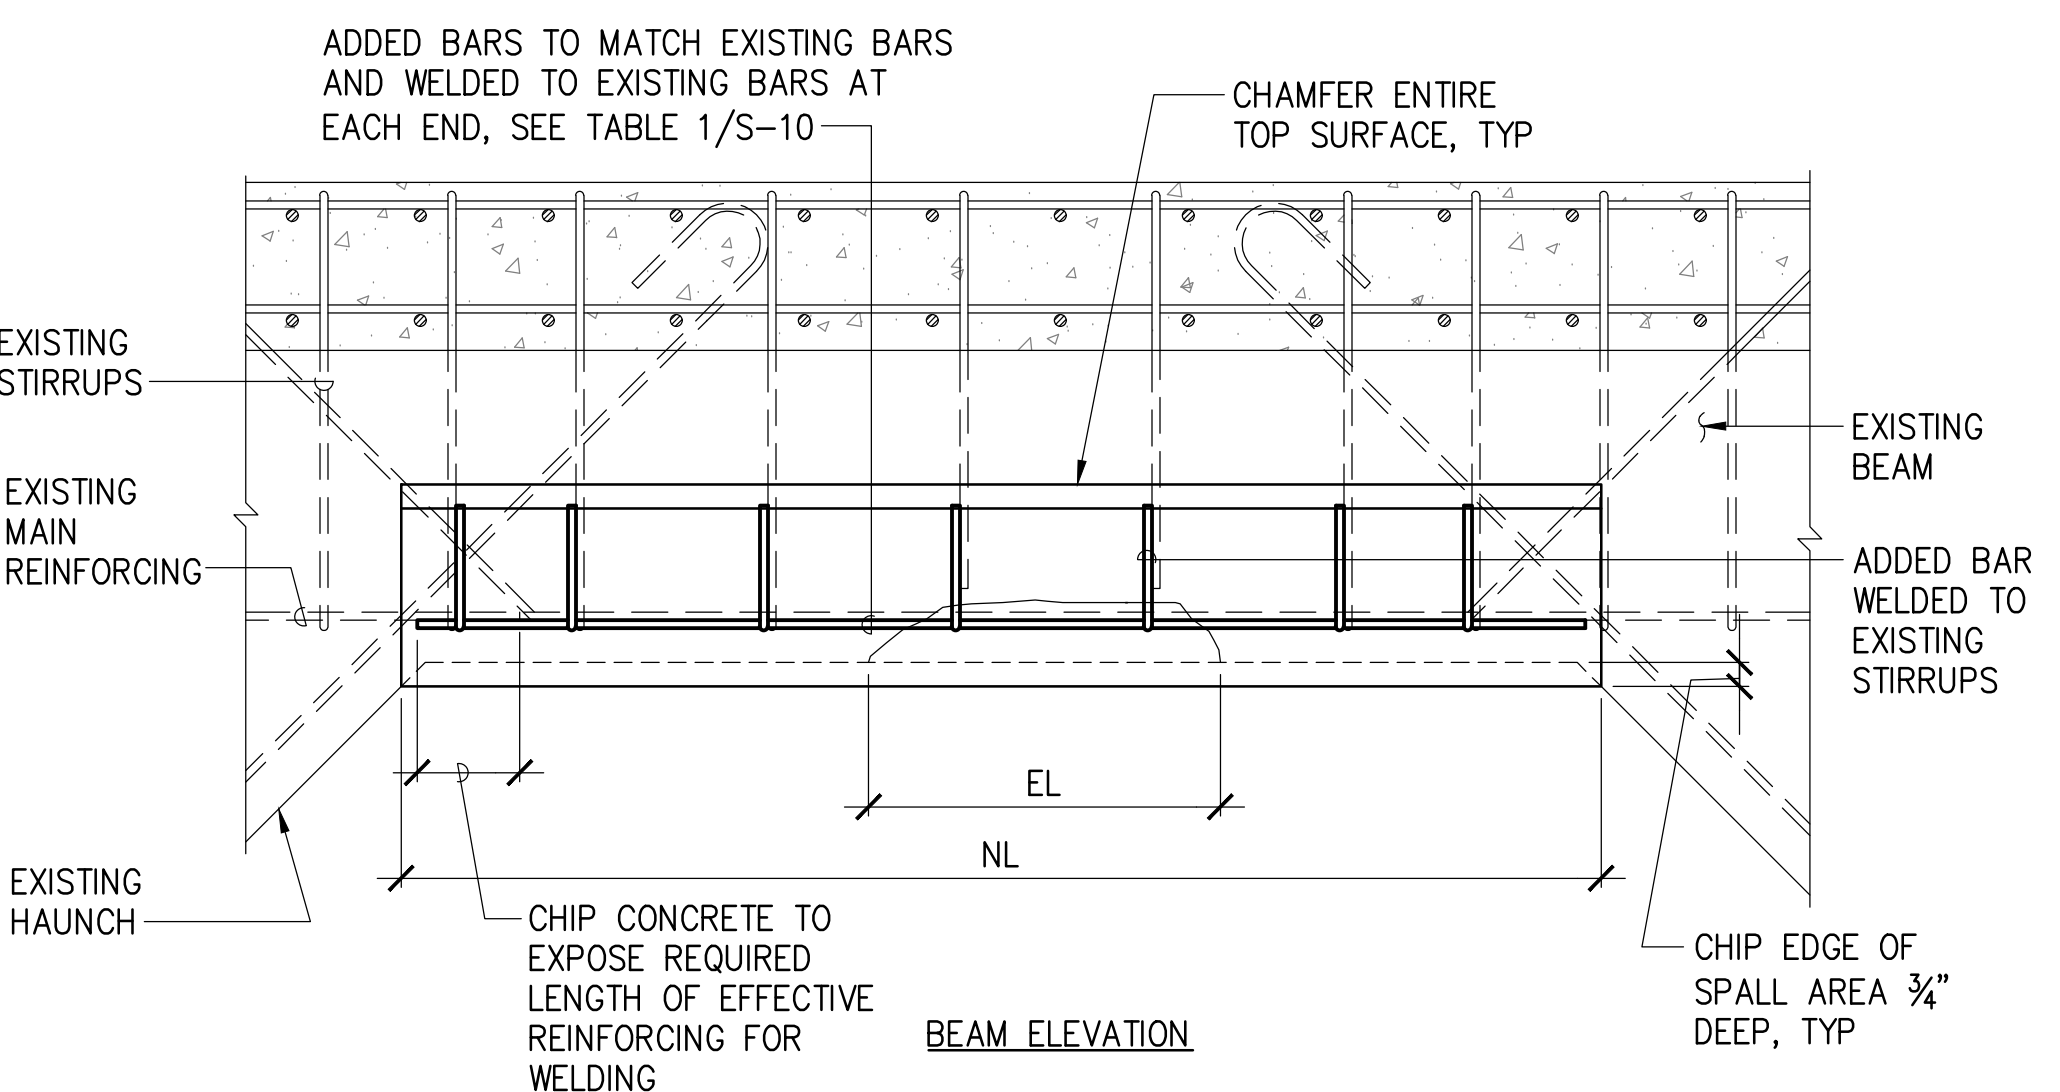

REPAIRED CONDITION

2 BEAM SPALL REPAIR WITH REINFORCING STEEL REPLACEMENT (TYPE BR)
 S-7 NOT TO SCALE

GRANT J. OKUNIGA
 LICENSED PROFESSIONAL ENGINEER
 No. 13001-S
 HAWAII, U.S.A.

REVISION	DATE	DESCRIPTION	BY	APPROVED

STATE OF HAWAII
**DEPARTMENT OF TRANSPORTATION
 HARBORS**

JOB TITLE
**HONOLULU HARBOR, PIERS 13-14,
 SUBSTRUCTURE REPAIRS, PHASE 2, OAHU, HAWAII**


SHEET TITLE
BEAM SPALL REPAIR DETAILS

DESIGNED BY: GO
 DRAWN BY: DL
 CHECKED BY: GO
 DATE: 04/2026
 SCALE: AS SHOWN


JOB NUMBER
S10928

SHEET
S-7
 9 of 12 SHTS.


2024, APR 13, 2024, 3:10 PM

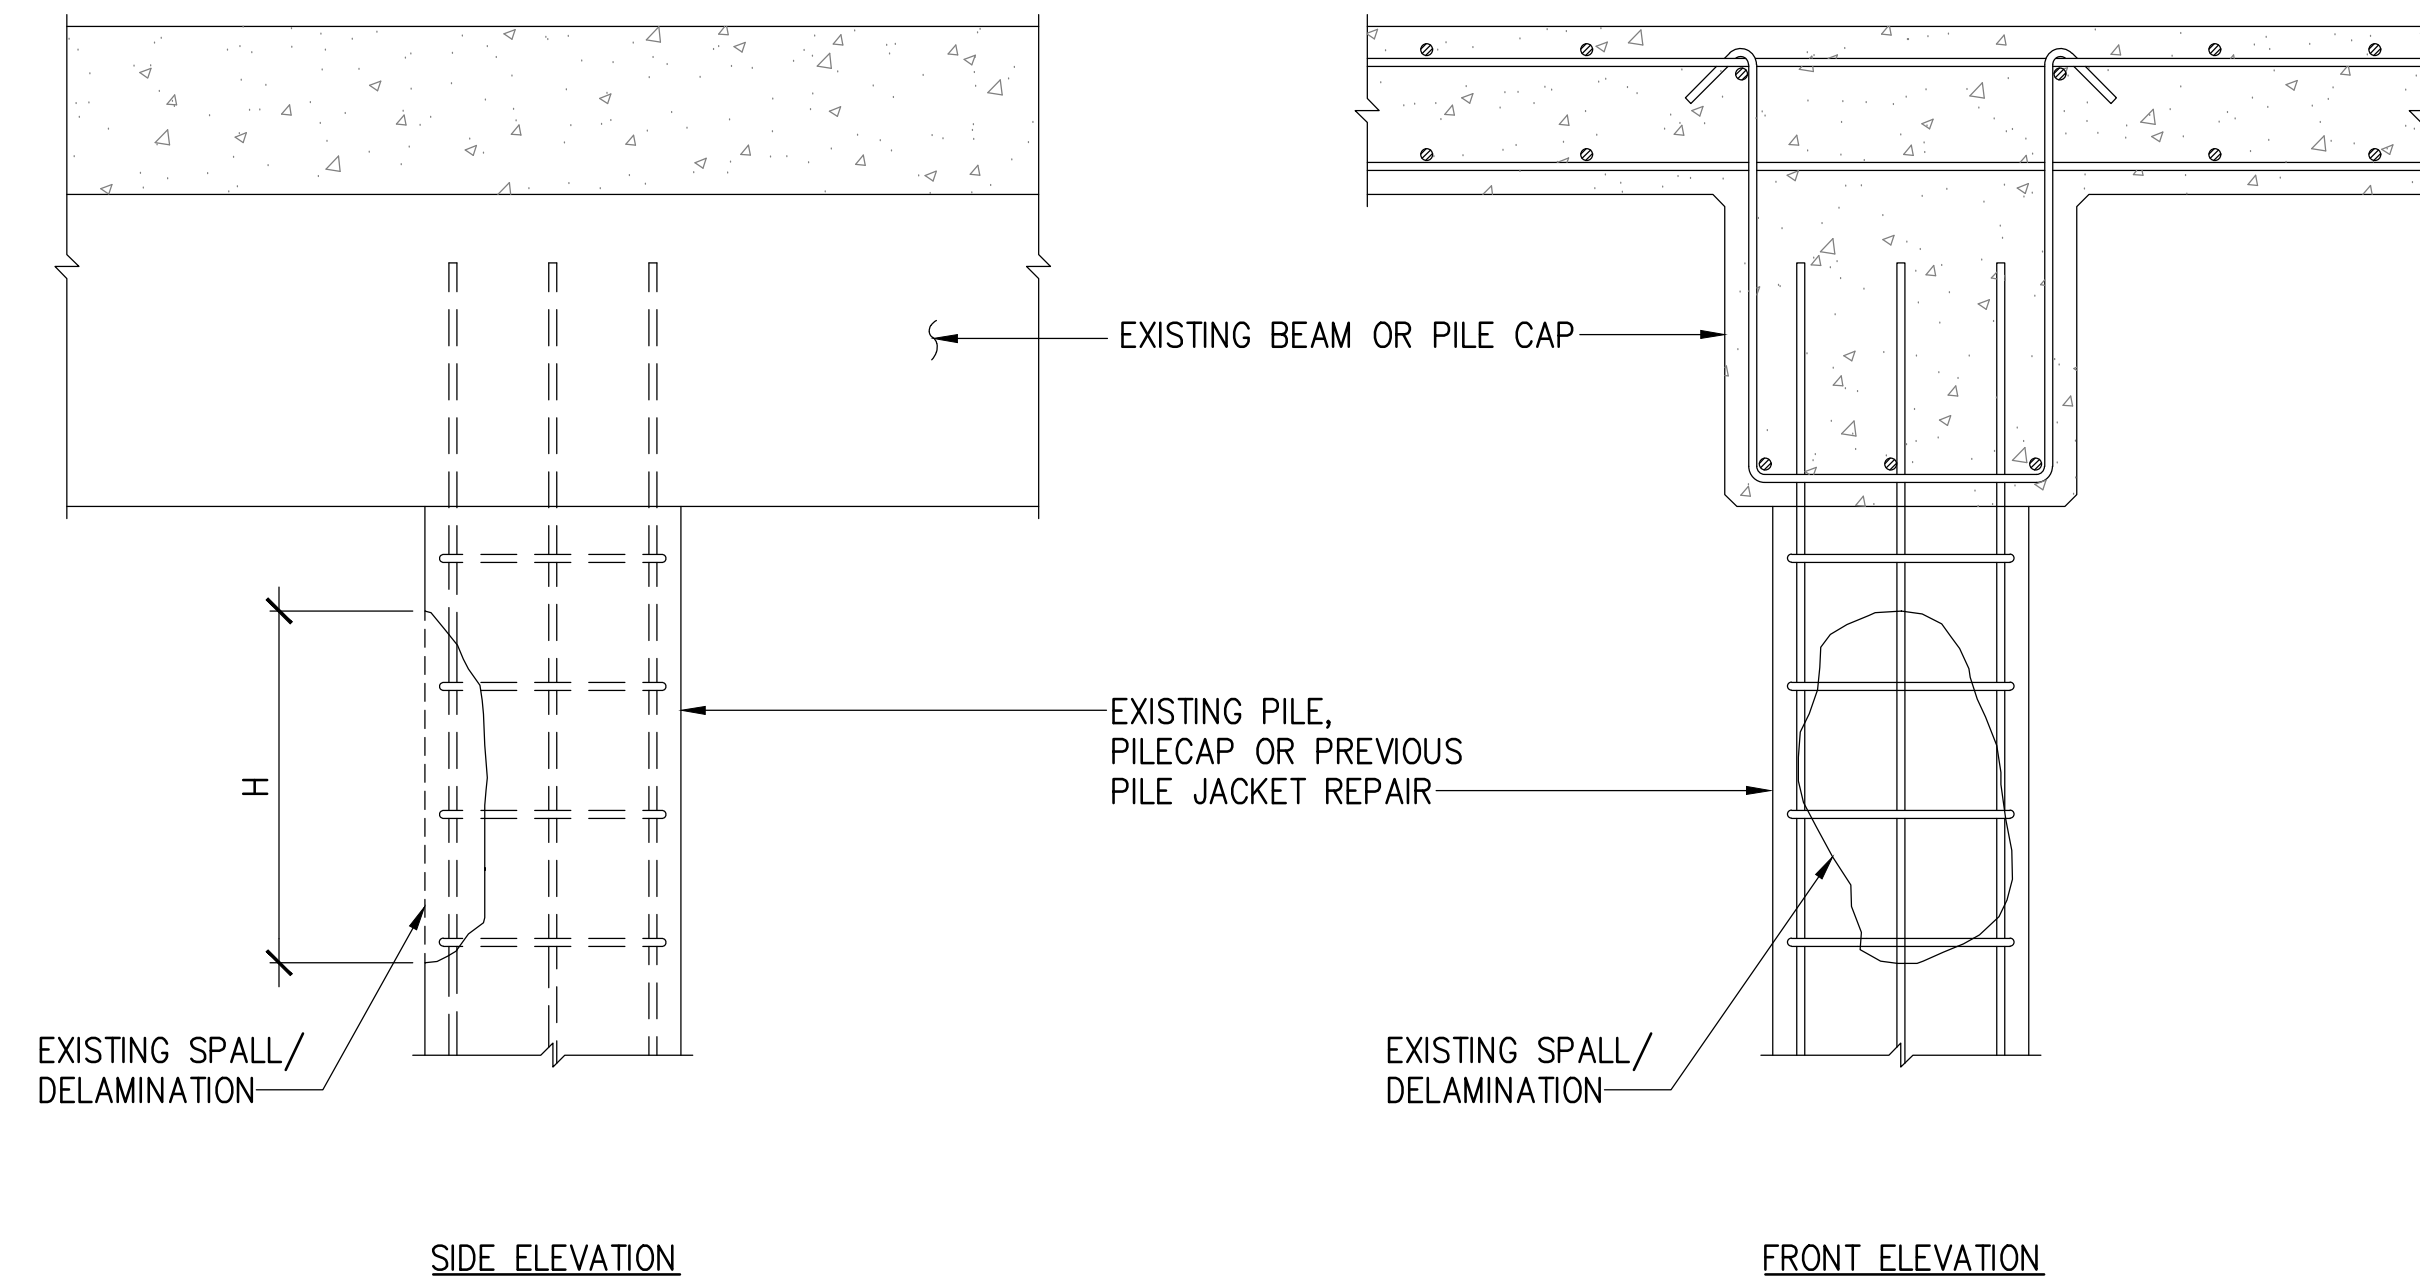


EXISTING CONDITION

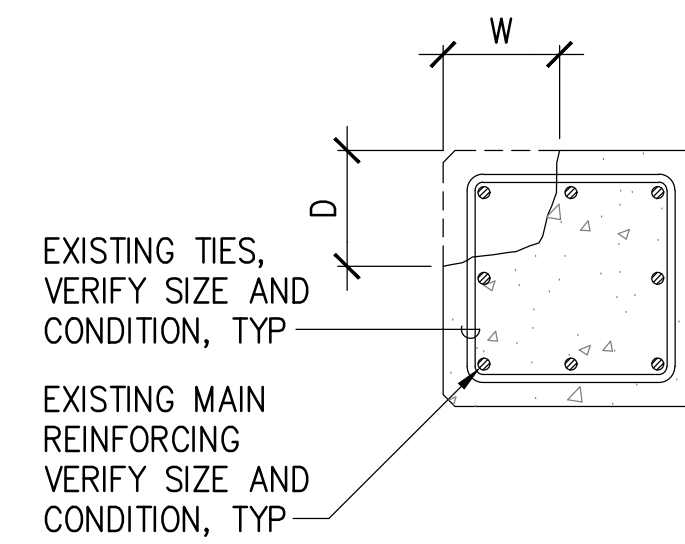

EXISTING SPALL AREA = (W + D)H
PILE SECTION (CORNER SPALL)

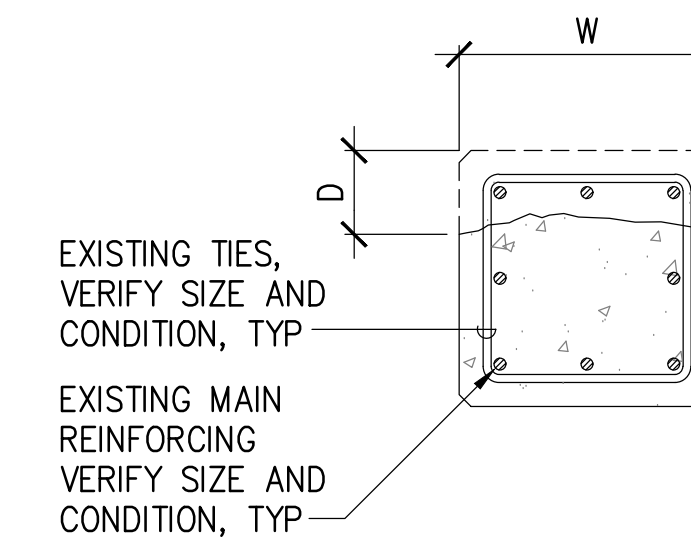


EXISTING SPALL AREA = (W + 2D)H
PILE SECTION (FACE SPALL)

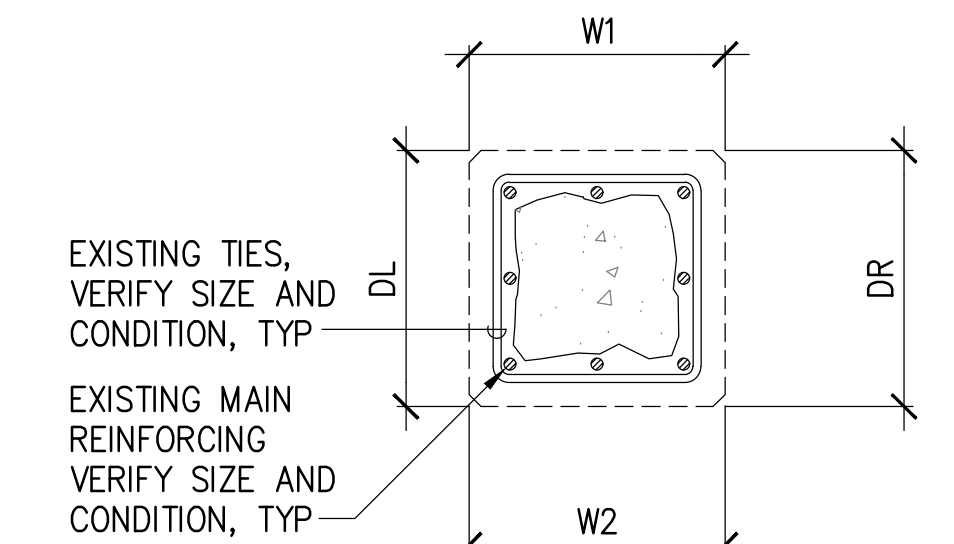


EXISTING SPALL AREA = (W1+W2+DL+DR)H
PILE SECTION (ALL SPALL)


EXISTING CONDITION

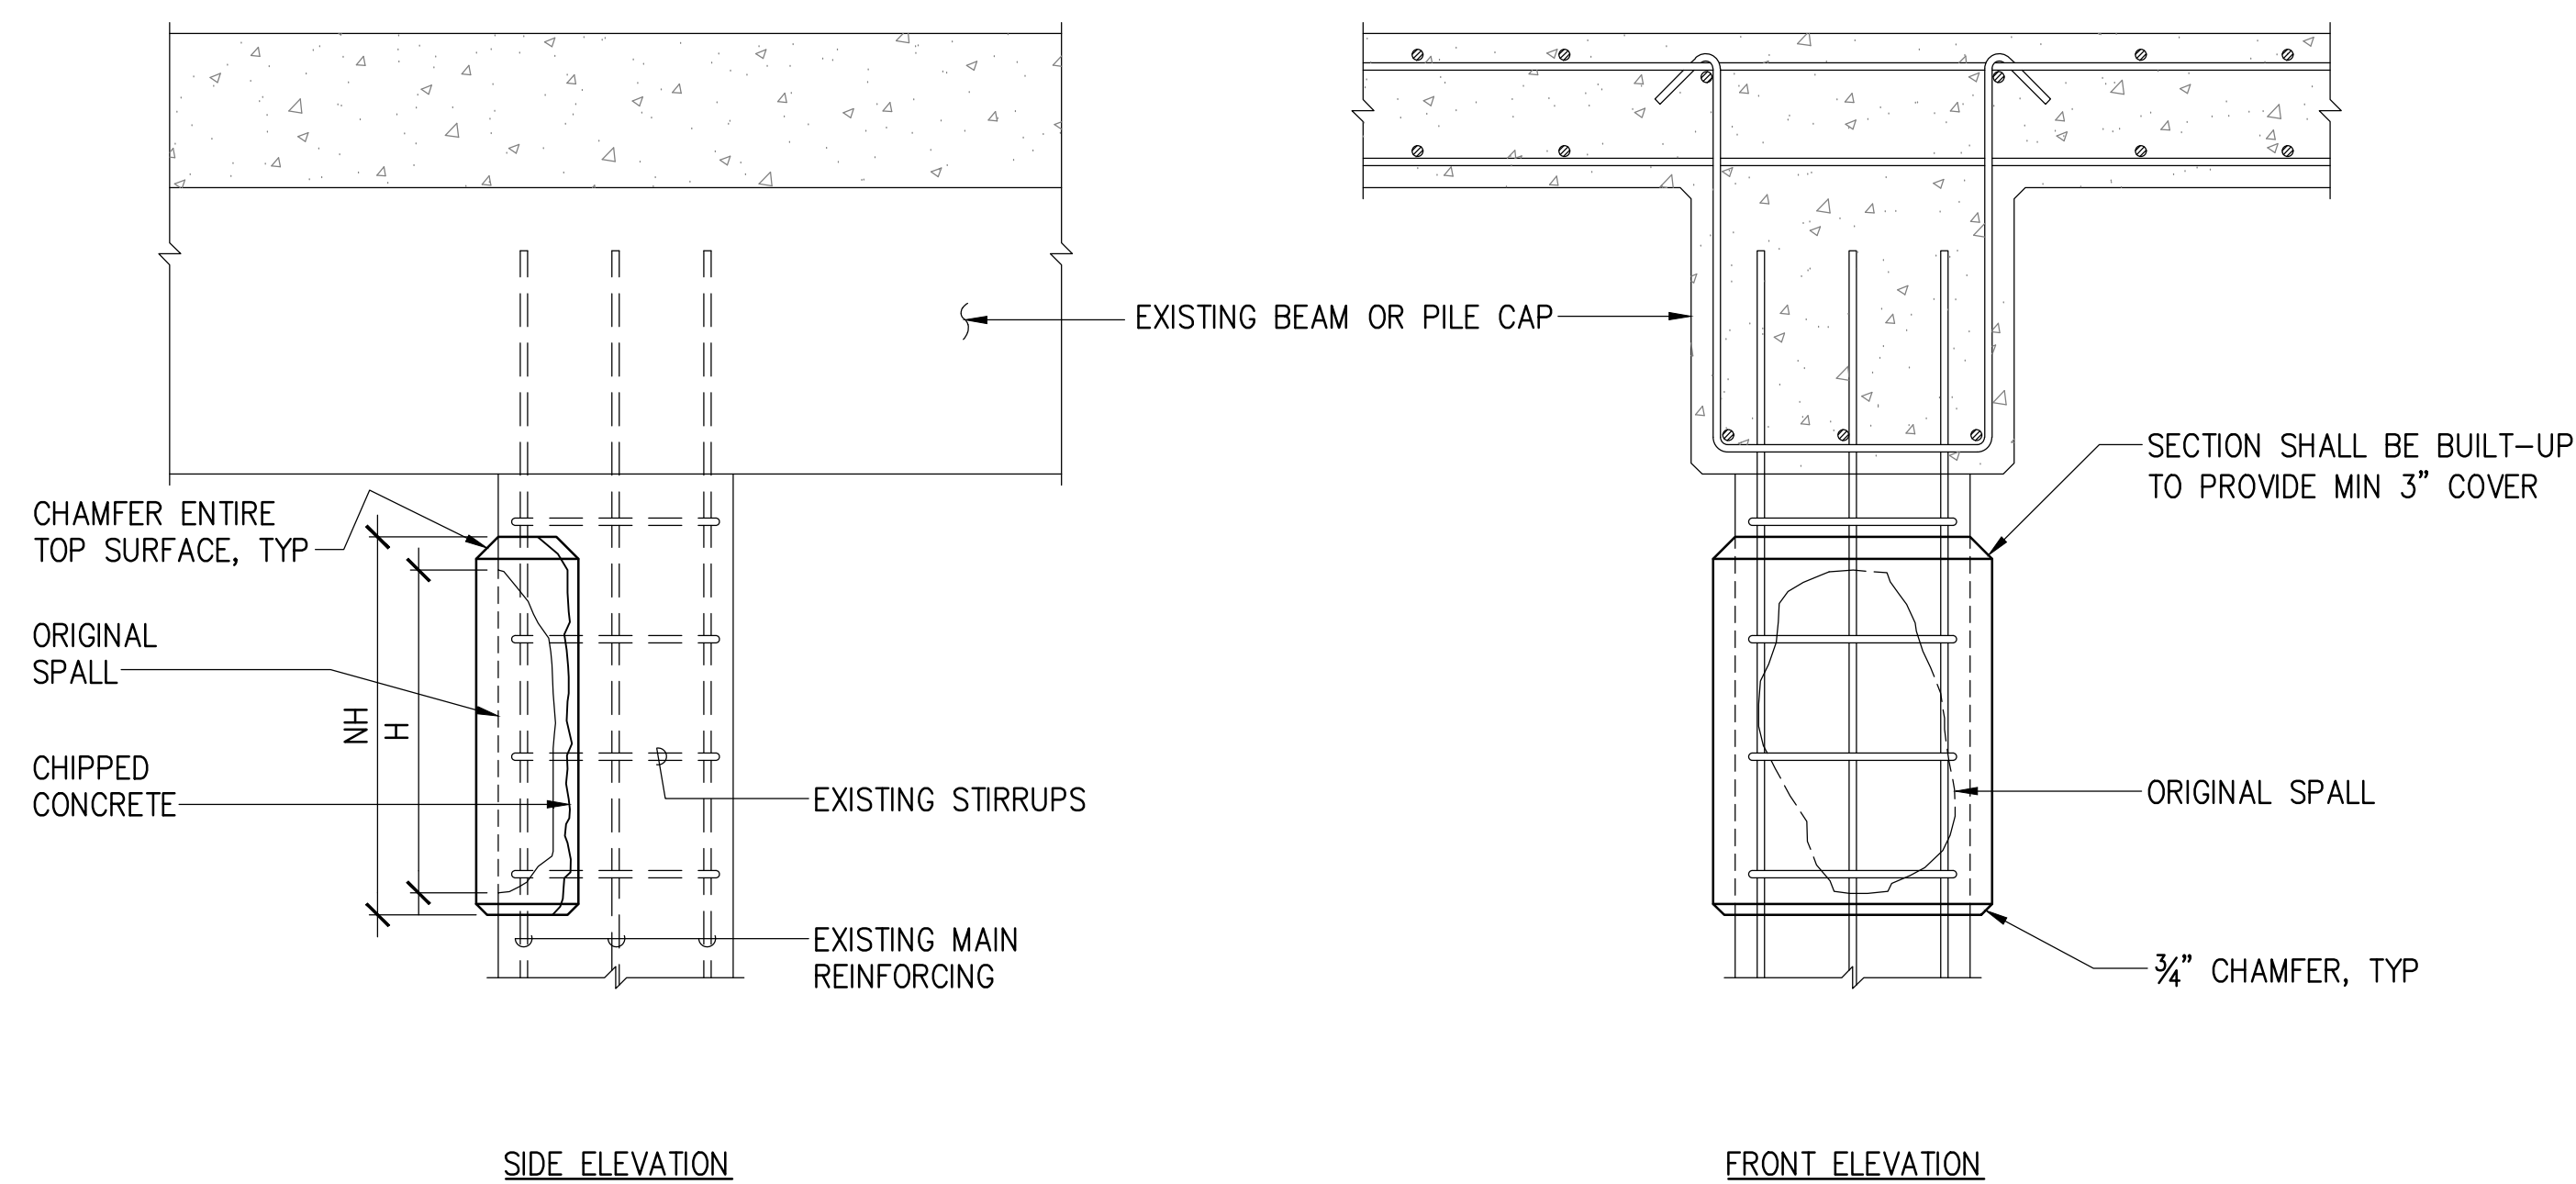


REPAIRED CONDITION

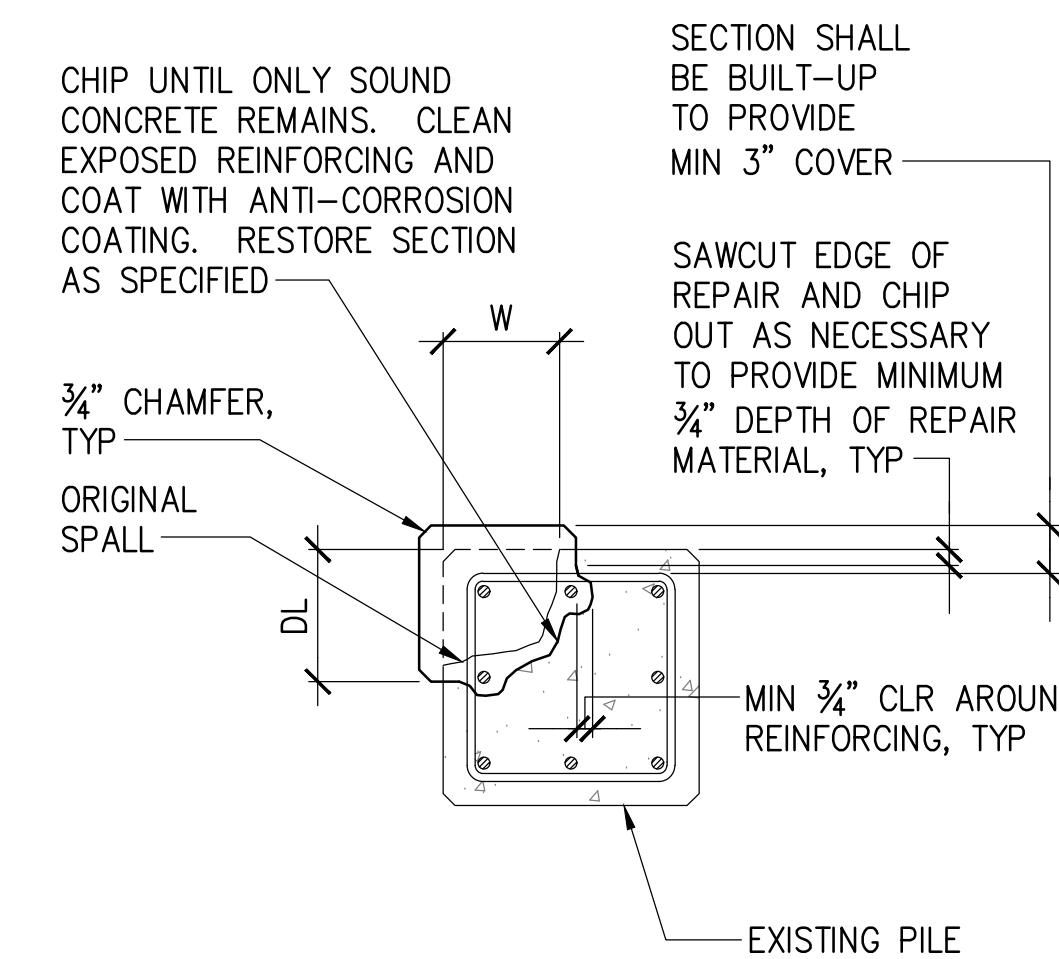

PILE SECTION (CORNER SPALL)

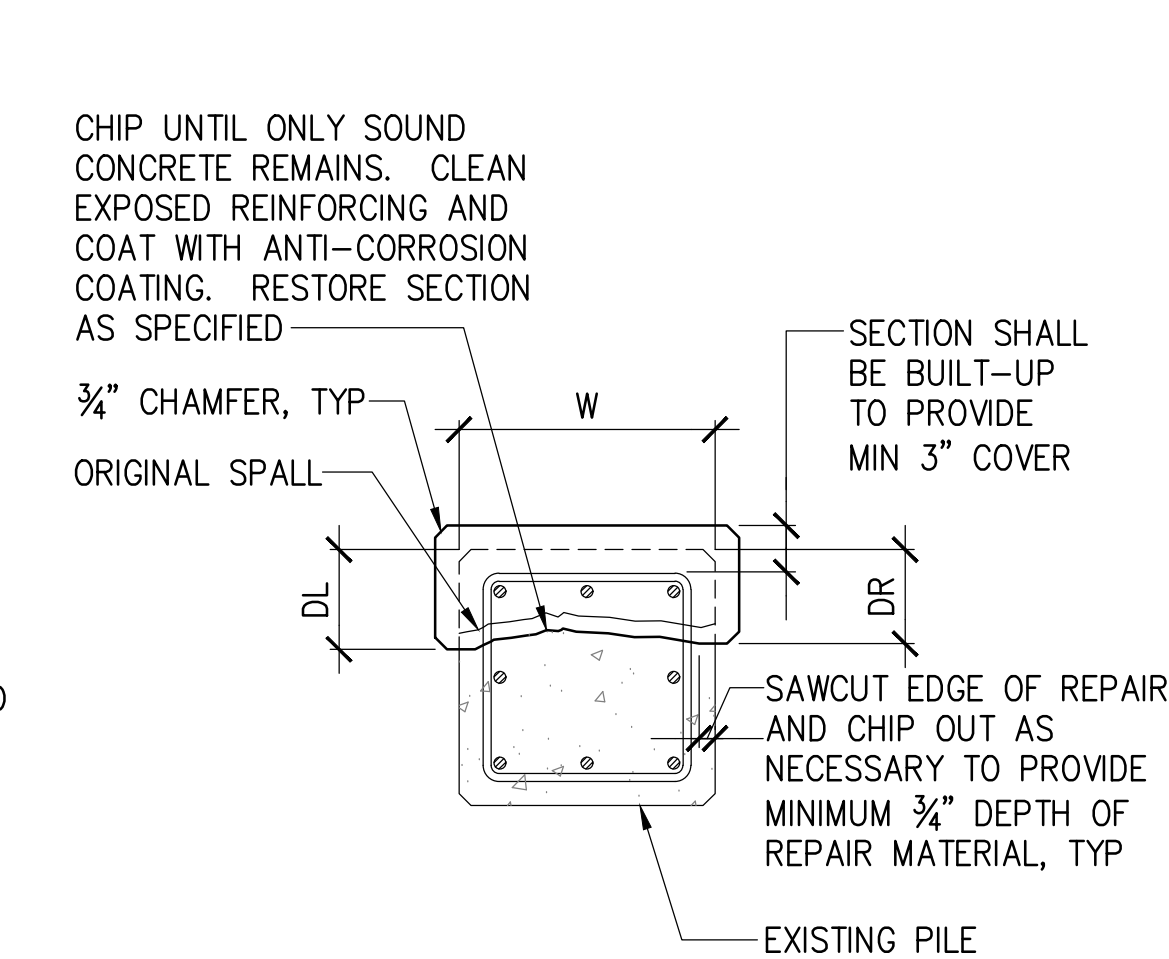

PILE SECTION (FACE SPALL)

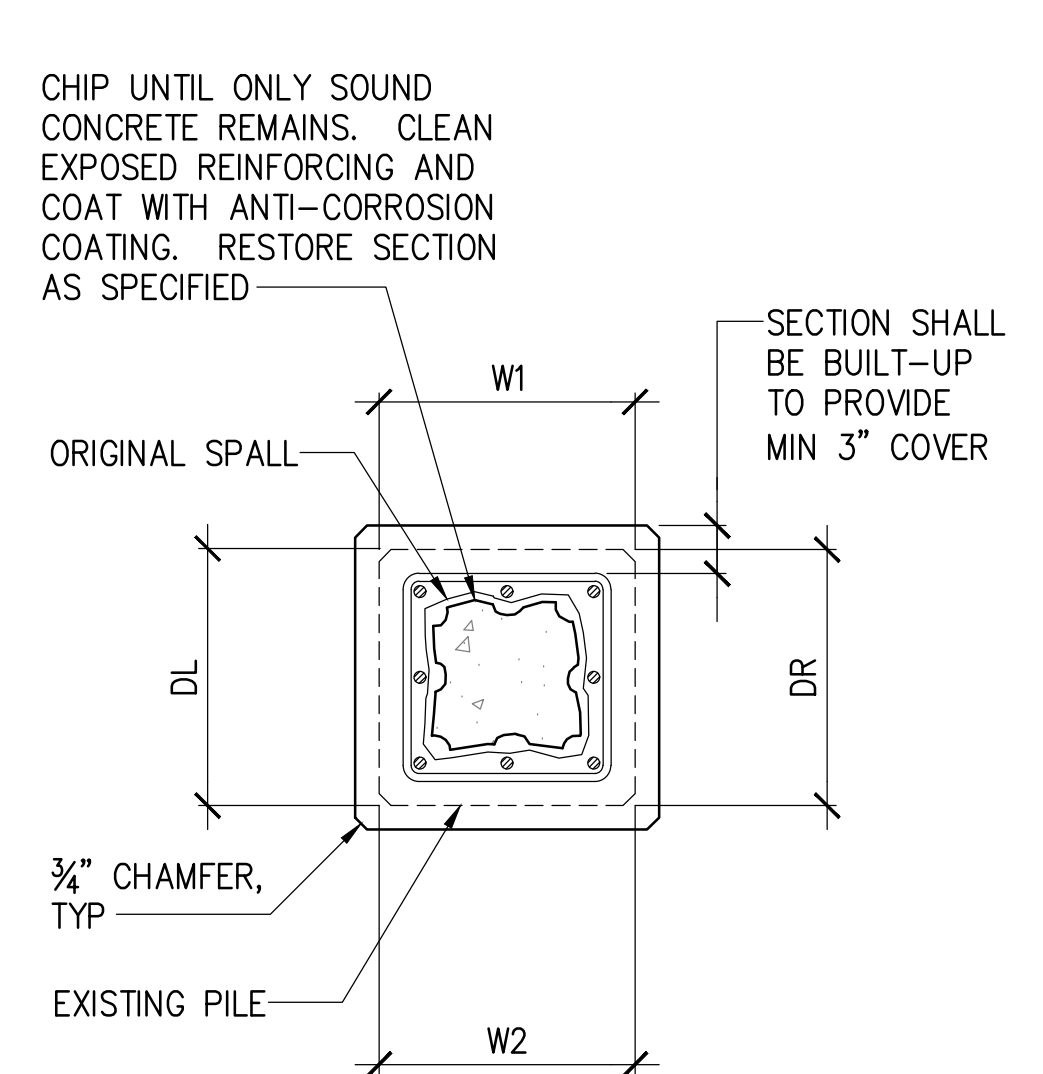

PILE SECTION (ALL SPALL)

REPAIRED CONDITION

PILE REPAIR NOTES:

- "PILES" REFER TO PILES OR PILE CAP AT TOP OF PILE AND SHALL BE REPAIRED SIMILARLY.
- PILE REPAIR TYPICALLY OCCURS ABOVE MLLW, HOWEVER PORTIONS OF REPAIRS MAY EXTEND UNDERWATER
- FOR PILE OR PILE CAP REPAIRS WITH REINFORCING STEEL REPLACEMENT, SEE DETAIL 1/S-9.

CALCULATION OF PAY AREA:

DL = DEPTH OF REPAIR (LEFT SIDE)
DR = DEPTH OF REPAIR (RIGHT SIDE)
D = ORIGINAL DEPTH OF PILE SPALL
W = ORIGINAL WIDTH OF PILE SPALL
H = EXISTING HEIGHT OF SPALL
NH = HEIGHT OF REPAIR

PAY AREA = (DL+DR+W)NH FOR CORNER AND FACE SPALL PILE REPAIRS, SEE PAY AREA NOTE 3.


PAY AREA = (DL+DR+W1+W2)NH FOR ALL SPALL PILE REPAIRS

PAY AREA NOTES:

- PAY AREA SHALL BE THE TOTAL REPAIRED AREA ON ALL PILE OR PILE CAP FACES. IF DL, DR OR W VARY ALONG THE LENGTH OF REPAIR, PAY AREA SHALL BE CALCULATED INDIVIDUALLY FOR EACH PILE FACE.
- FOR PILE CAP REPAIRS EXTENDING DOWN TO PILE CAP SOFFIT, PAY AREA SHALL ALSO INCLUDE THE SOFFIT REPAIR AREA.
- FOR PILE CAP FACE SPALLS NOT EXTENDING TO THE PILE CAP CORNER(S), PAY AREA SHALL NOT INCLUDE DL OR DR.

1 PILE SPALL REPAIRS NO REINFORCING STEEL REPLACEMENT (TYPE P AND PC)
S-8 NOT TO SCALE


	REVISION	DATE	DESCRIPTION	BY	APPROVED
	STATE OF HAWAII DEPARTMENT OF TRANSPORTATION HARBORS				
	JOB TITLE HONOLULU HARBOR, PIERS 13-14, SUBSTRUCTURE REPAIRS, PHASE 2, OAHU, HAWAII				
	SHEET TITLE PILE SPALL REPAIR DETAILS				
DESIGNED BY: GO		JOB NUMBER		SHEET	
DRAWN BY: DL		S10928		S-8	
CHECKED BY: GO		DATE: 04/2026		10 of 12 SHTS.	
SCALE: AS SHOWN					

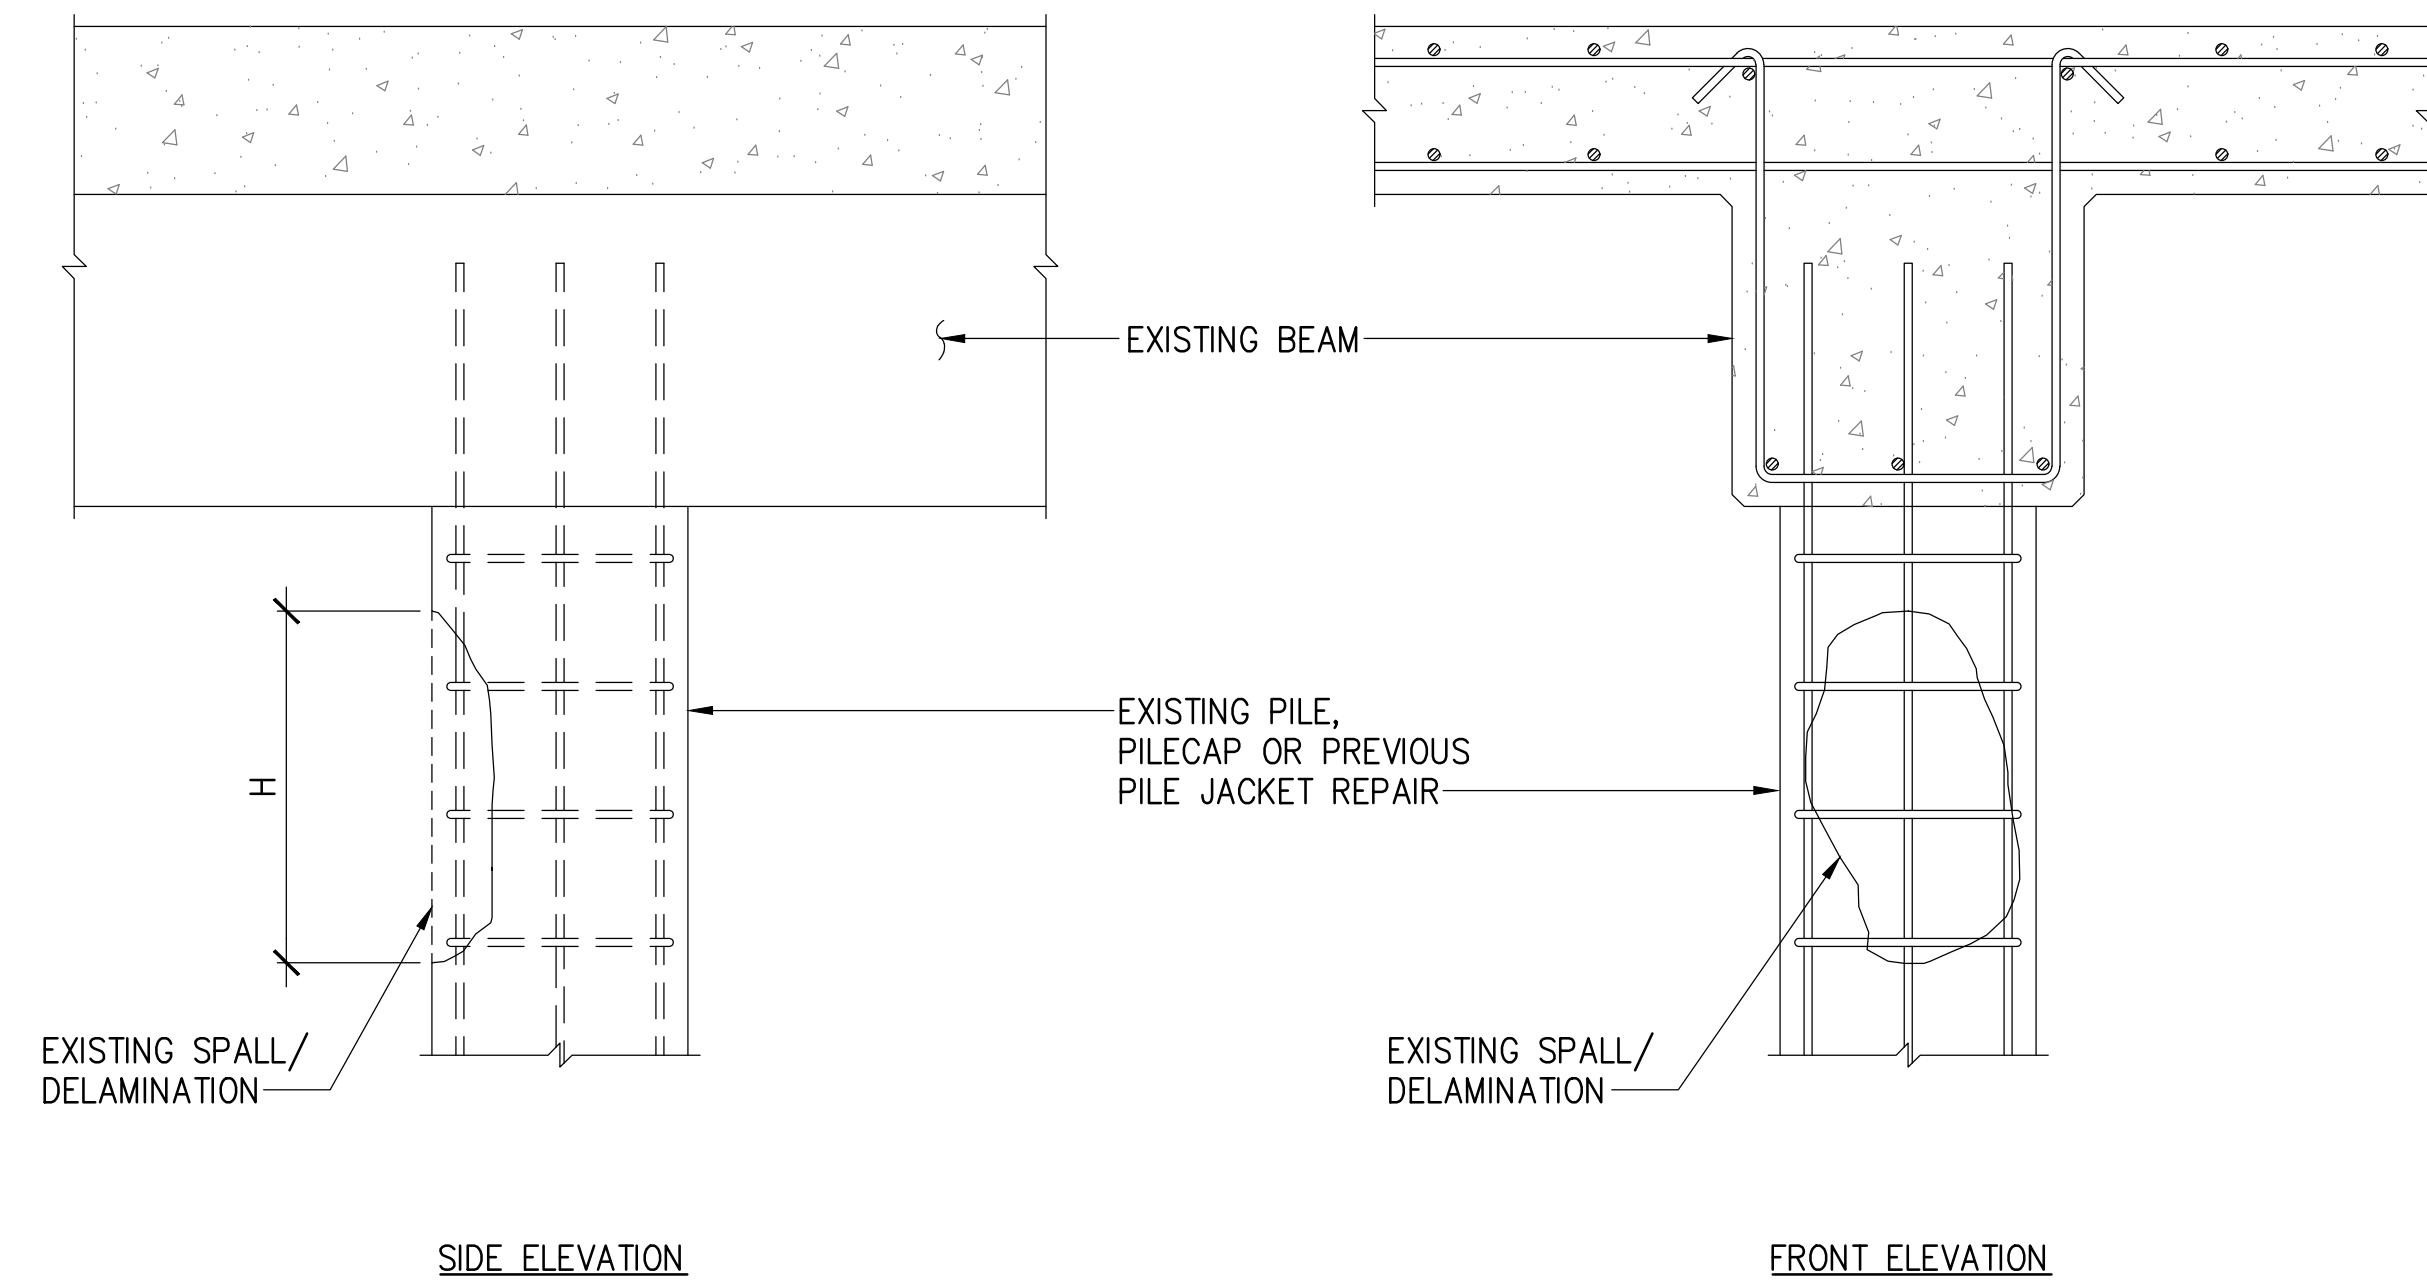


SIDE ELEVATION

FRONT ELEVATION


EXISTING CONDITION

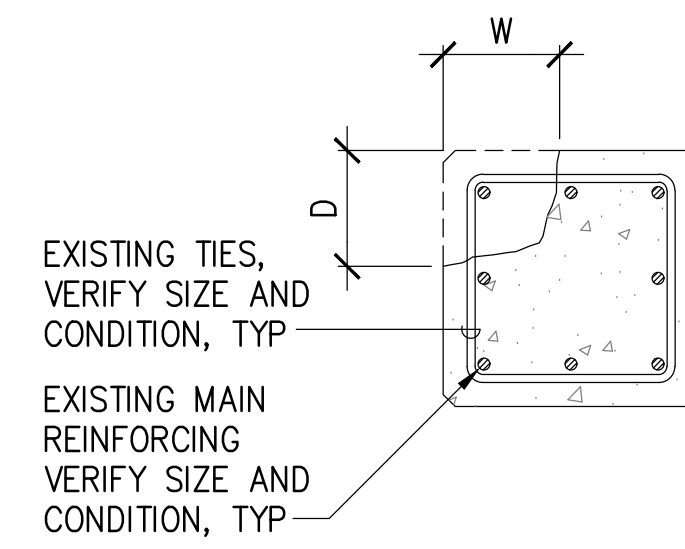

EXISTING SPALL AREA = (W + D)H
PILE SECTION (CORNER SPALL)

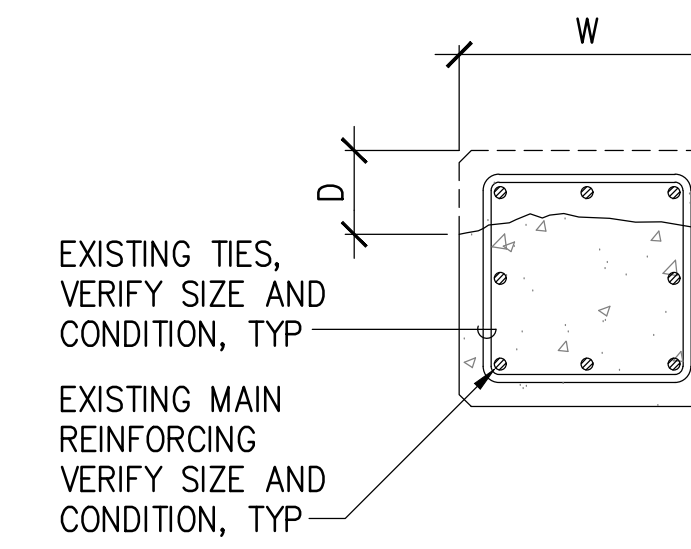


EXISTING SPALL AREA = (W + 2D)H
PILE SECTION (FACE SPALL)

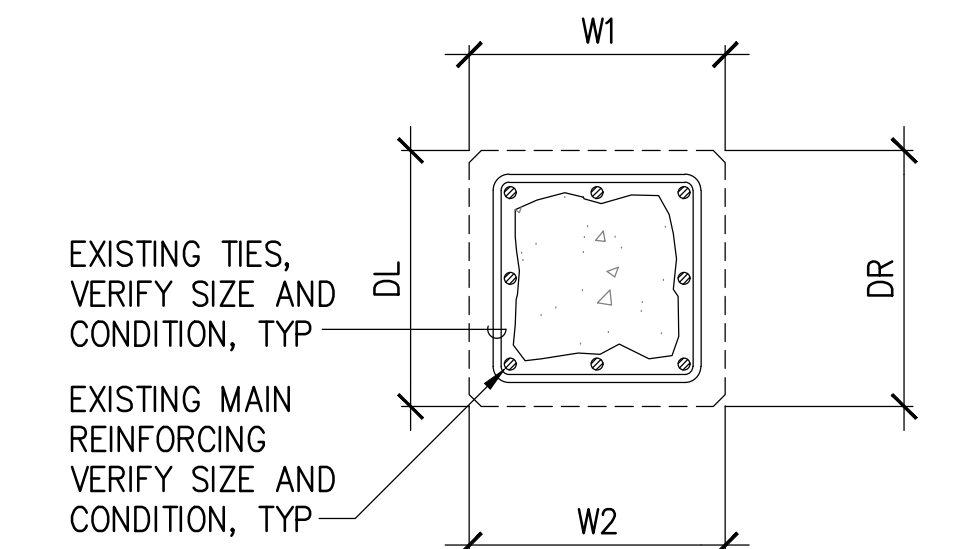

EXISTING SPALL AREA = (W1+W2+DL+DR)H
PILE SECTION (ALL SPALL)


EXISTING CONDITION

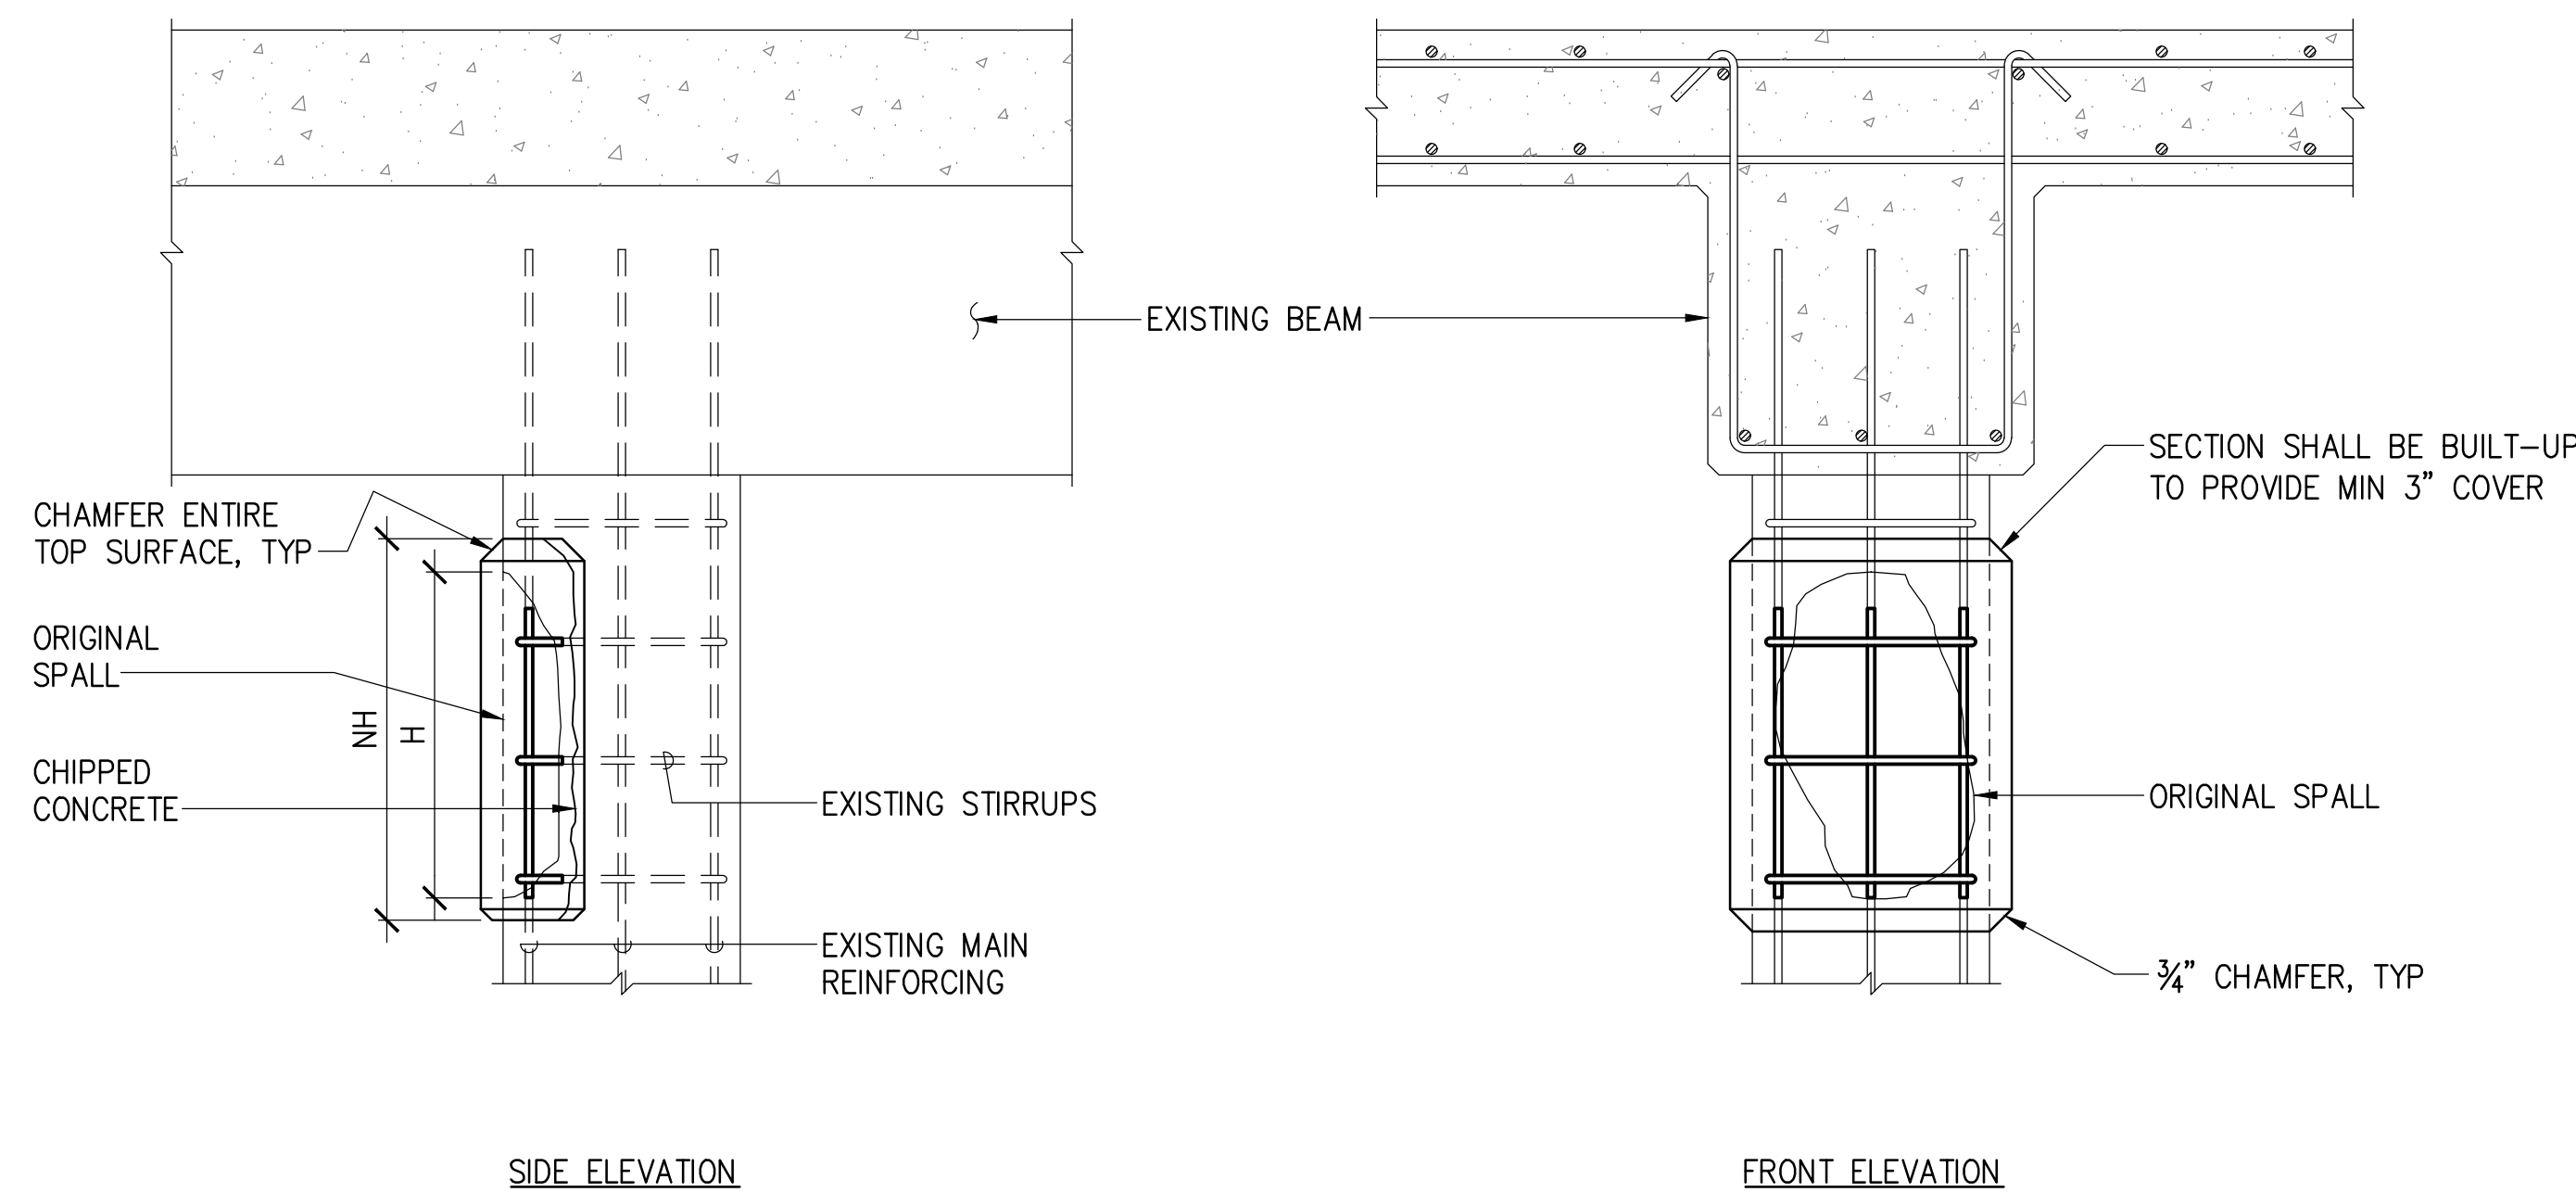


SIDE ELEVATION

FRONT ELEVATION


REPAIRED CONDITION

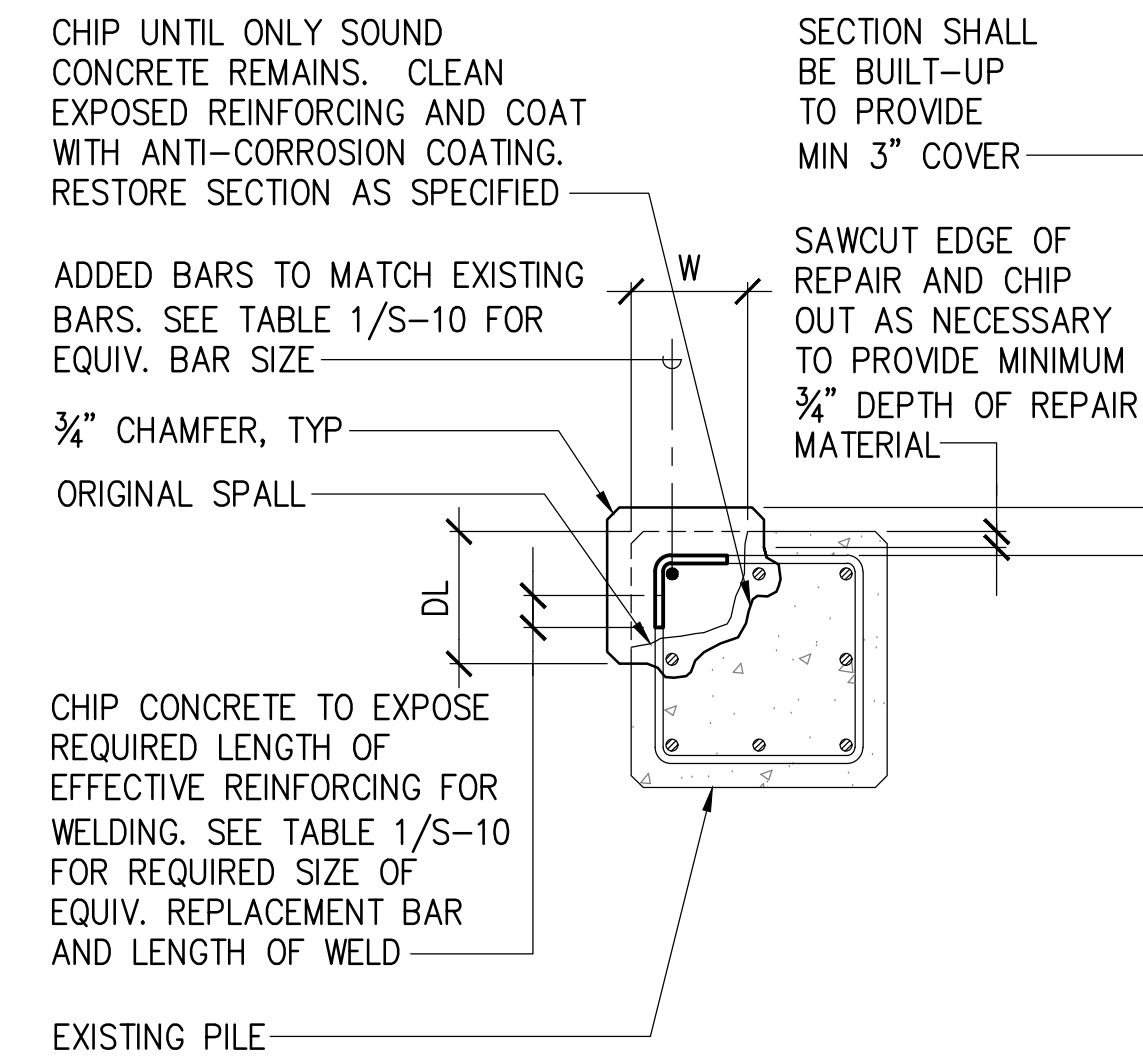

PILE SECTION (CORNER SPALL)

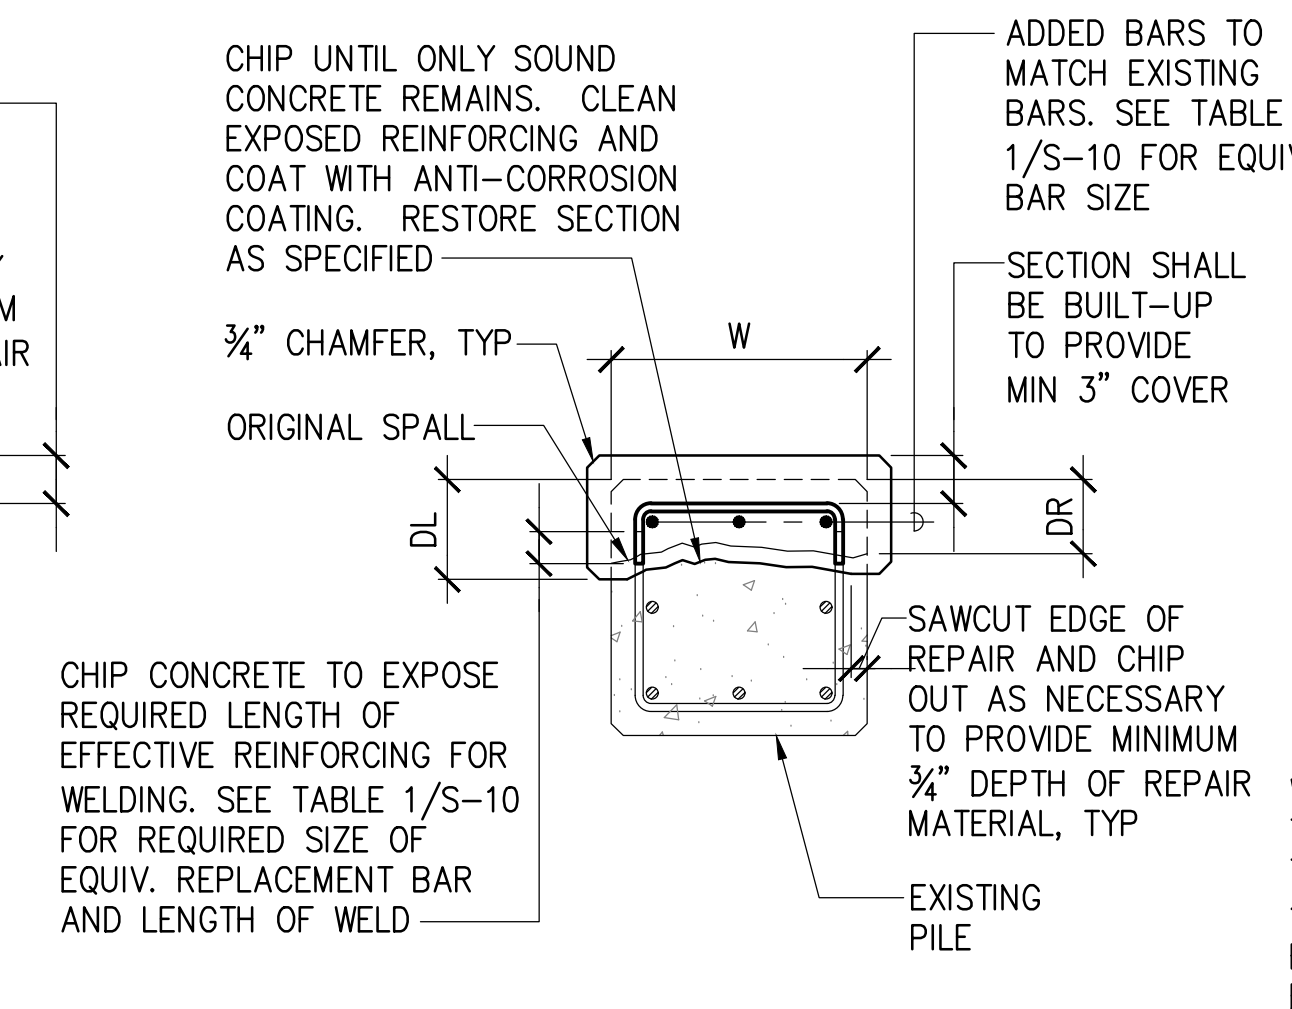

PILE SECTION (FACE SPALL)

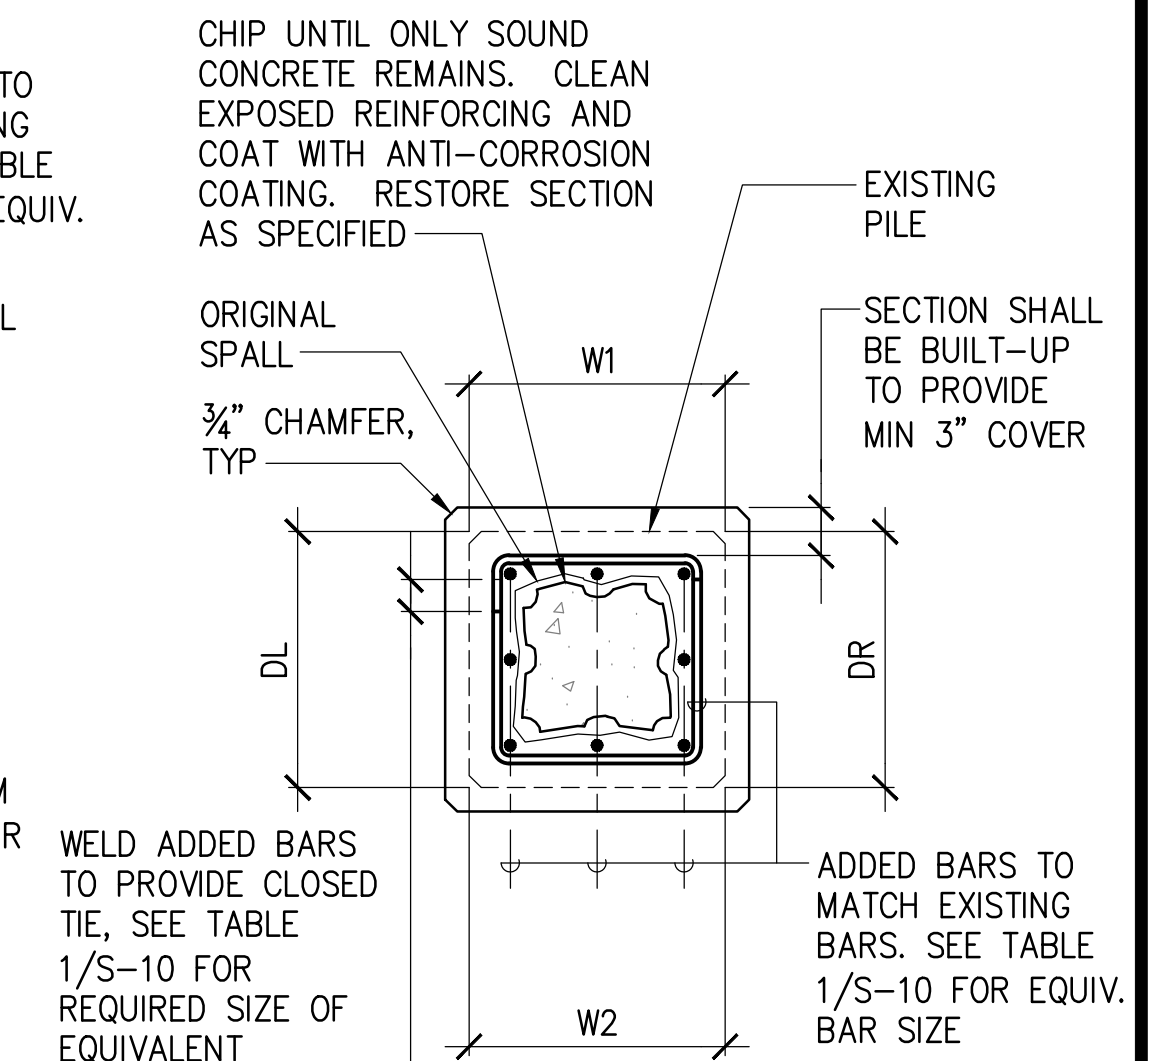

PILE SECTION (ALL SPALL)

REPAIRED CONDITION

- PILE REPAIR NOTES:
- "PILES" REFER TO PILES OR PILE CAP AT TOP OF PILE AND SHALL BE REPAIRED SIMILARLY.
 - PILE REPAIR TYPICALLY OCCURS ABOVE MLLW, HOWEVER PORTIONS OF REPAIRS MAY EXTEND UNDERWATER


CALCULATION OF PAY AREA:

DL = DEPTH OF REPAIR (LEFT SIDE)
 DR = DEPTH OF REPAIR (RIGHT SIDE)
 D = ORIGINAL DEPTH OF PILE SPALL
 W = ORIGINAL WIDTH OF PILE SPALL
 H = EXISTING HEIGHT OF SPALL
 NH = HEIGHT OF REPAIR

PAY AREA = (DL+DR+W)NH FOR CORNER AND FACE SPALL PILE REPAIRS, SEE PAY AREA NOTE 3.
 PAY AREA = (DL+DR+W1+W2)NH FOR ALL SPALL PILE REPAIRS

- PAY AREA NOTES:
- PAY AREA SHALL BE THE TOTAL REPAIRED AREA ON ALL PILE OR PILE CAP FACES. IF DL, DR OR W VARY ALONG THE LENGTH OF REPAIR, PAY AREA SHALL BE CALCULATED INDIVIDUALLY FOR EACH PILE FACE.
 - FOR PILE CAP REPAIRS EXTENDING DOWN TO PILE CAP SOFFIT, PAY AREA SHALL ALSO INCLUDE THE SOFFIT REPAIR AREA.
 - FOR PILE CAP FACE SPALLS NOT EXTENDING TO THE PILE CAP CORNER(S), PAY AREA SHALL NOT INCLUDE DL OR DR.

	REVISION	DATE	DESCRIPTION	BY	APPROVED
	STATE OF HAWAII DEPARTMENT OF TRANSPORTATION HARBORS				
	JOB TITLE HONOLULU HARBOR, PIERS 13-14, SUBSTRUCTURE REPAIRS, PHASE 2, OAHU, HAWAII				
	SHEET TITLE PILE SPALL REPAIR DETAILS				
DESIGNED BY: GO	JOB NUMBER S10928				SHEET S-9
DRAWN BY: DL	DATE: 04/2026				11 of 12 SHTS.
CHECKED BY: GO	SCALE: AS SHOWN				
THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION EXP. 4-30-28 <i>Grant J. Okuniga</i> MKE ASSOCIATES LLC					

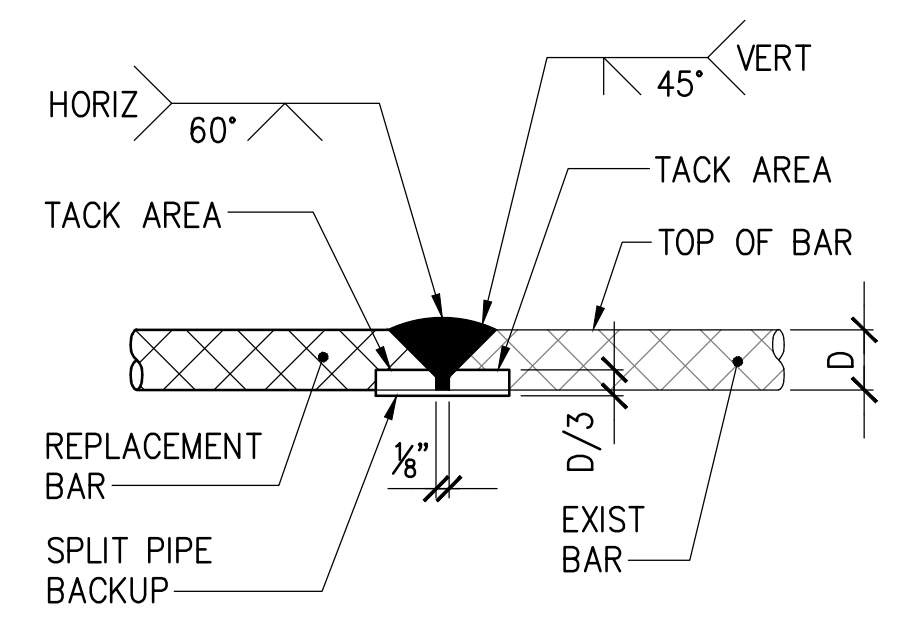


(A) BUTT SPlice

USE DETAIL A FOR #7 BARS AND LARGER

- REINFORCING STEEL WELDING NOTES:
1. CHIP, GRIND, OR GOUGE TO SOUND METAL BEFORE WELDING.
 2. CLEAN EXIST REBAR AND PREPARE ACCORDING TO SPECIFICATIONS. APPLY COATING AFTER WELDING.
 3. SEE STEEL REPLACEMENT SCHEDULE BELOW FOR REPLACEMENT BAR SIZE.
 4. USE E70 ELECTRODES.
 5. SEE AWS D1.4 FOR WELDING PROCESS AND OTHER DETAILS.
 6. FOR WELDING OF #3, #4, AND #5 REPLACEMENT REINFORCING, WELDING MAY BE PERFORMED ON ONE SIDE ONLY, IF l_w IS INCREASED TO l_w1 AS FOLLOWS

SIZE OF EXISTING REINFORCING		SIZE OF REPLACEMENT REINFORCING	MINIMUM LENGTH OF WELD EACH SIDE (l_w)	MINIMUM LENGTH OF WELD ONE SIDE l_w1
SQUARE	ROUND			
3/8"	#3, #4	#4	2"	4"
1/2"	#5	#5	2 1/2"	5"
5/8"	#6	#6	3 1/2"	-
3/4"	#7	#7	-	-
7/8"	#8	#8	-	-

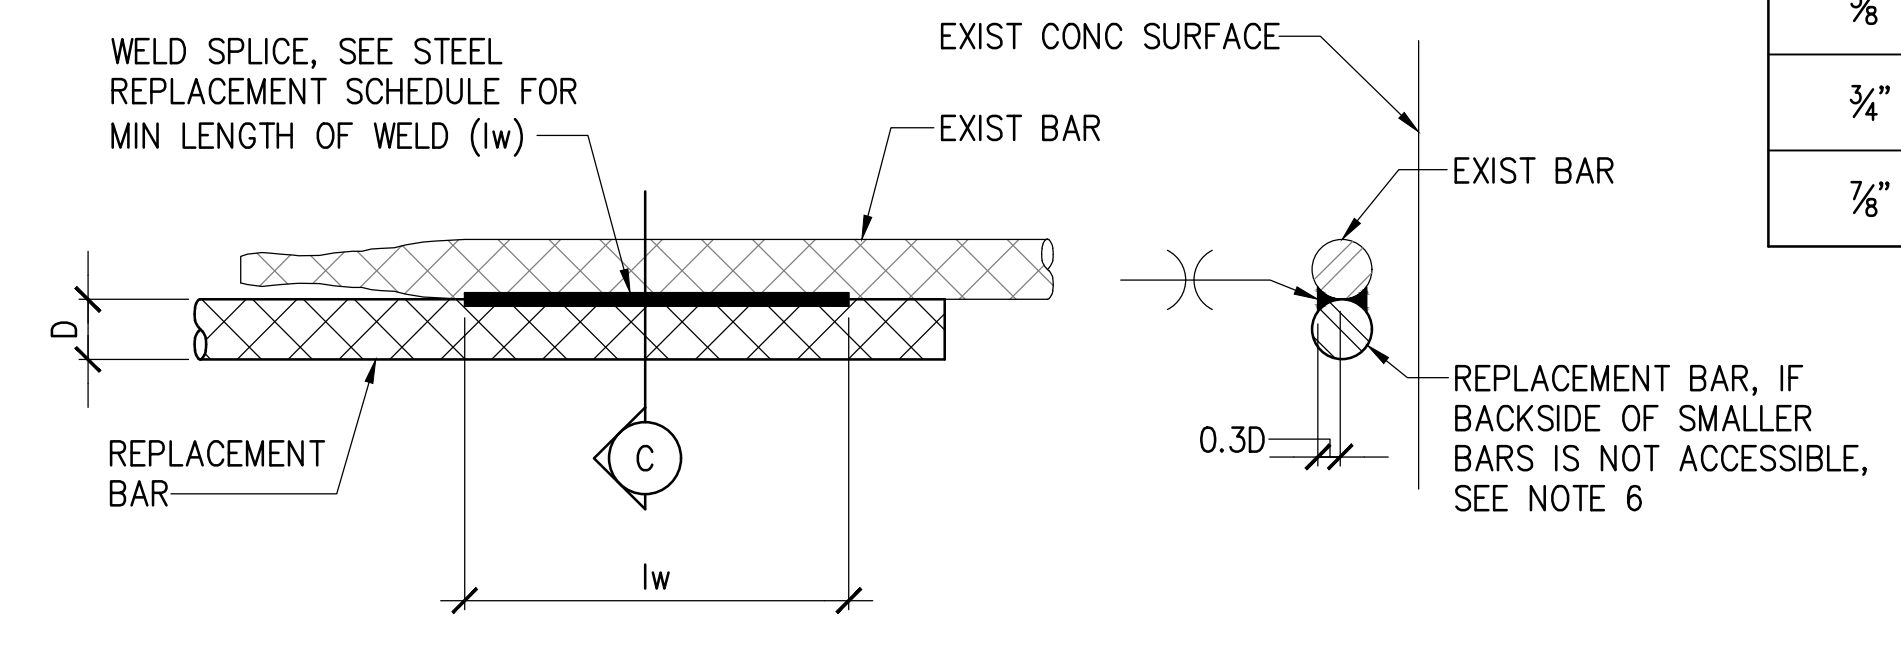


NOTE:
 l_w = LENGTH OF WELD EACH SIDE
 (SEE STEEL REPLACEMENT SCHEDULE)

(B) LAP SPlice

(C) SECTION

USE DETAIL B FOR #6 BARS AND SMALLER

1 REINFORCING STEEL SPlice DETAIL
 S-10 NOT TO SCALE

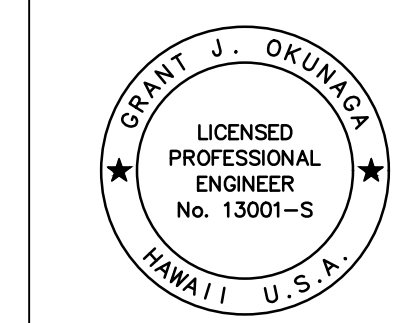

THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION
 EXP. 4-30-28
 MKE ASSOCIATES LLC

REVISION	DATE	DESCRIPTION	BY	APPROVED
STATE OF HAWAII DEPARTMENT OF TRANSPORTATION HARBORS				
JOB TITLE HONOLULU HARBOR, PIERS 13-14, SUBSTRUCTURE REPAIRS, PHASE 2, OAHU, HAWAII				
SHEET TITLE SPlice DETAIL				
DESIGNED BY: GO				SHEET S-10
DRAWN BY: DL				
CHECKED BY: GO				JOB NUMBER S10928
DATE: 04/2026				
SCALE: AS SHOWN				
				12 of 12 SHITS