


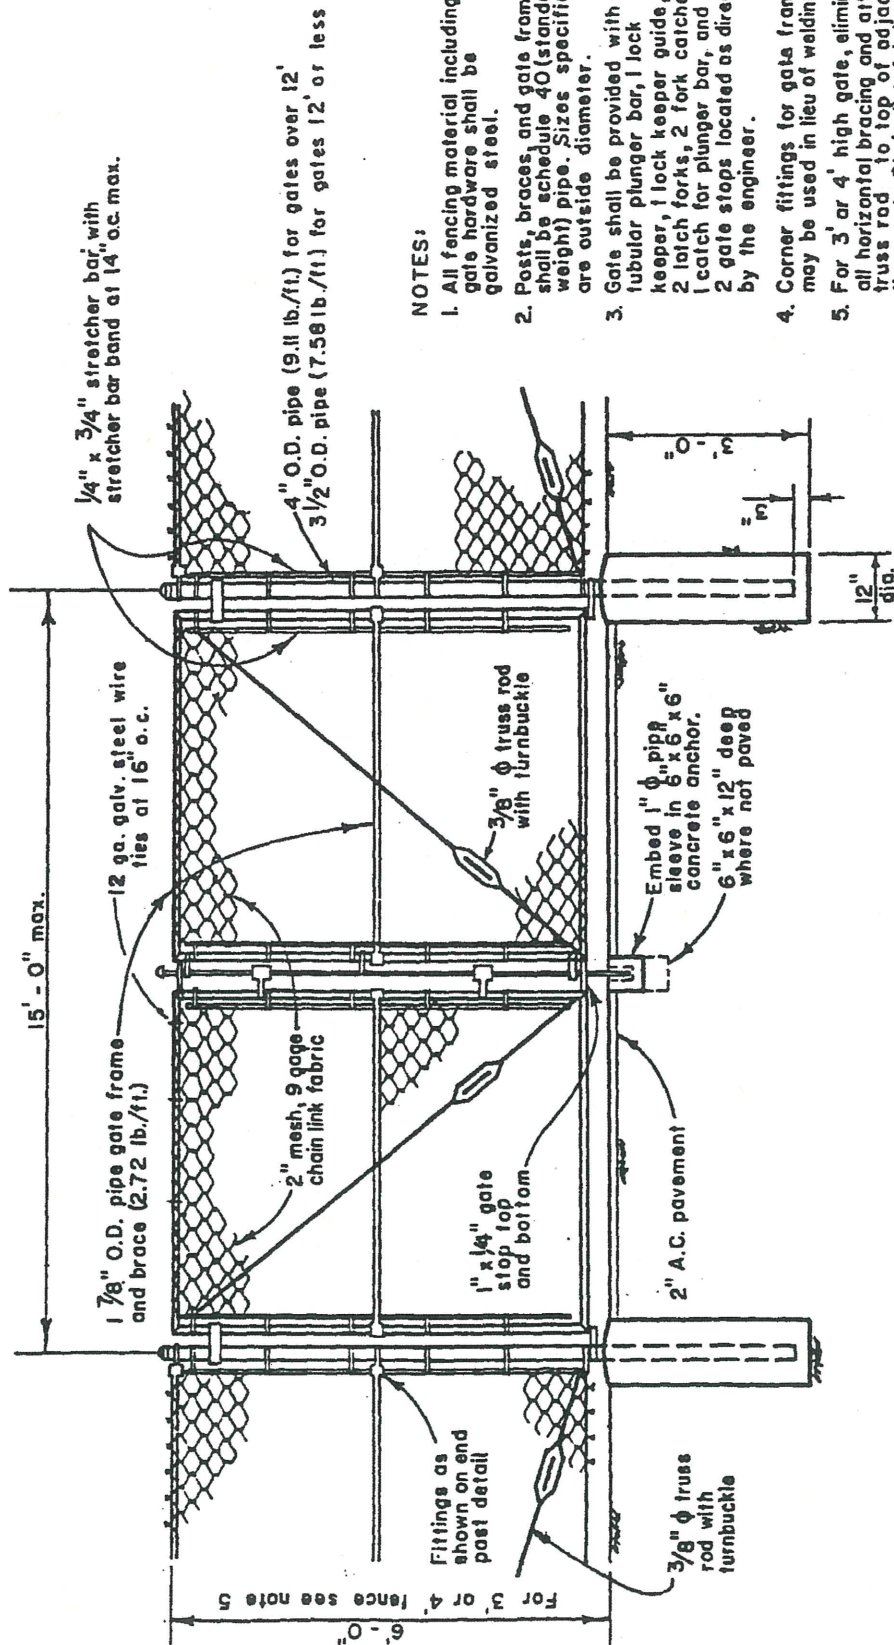

NOTES:

1. All fencing material including gate hardware shall be galvanized steel.
2. Posts, braces, and gate frames shall be schedule 40 (standard weight) pipe. Sizes specified are outside diameter.
3. Gate shall be provided with tubular plunger bar, 1 lock keeper, 1 lock keeper guide, 2 latch forks, 2 fork catches, 1 catch for plunger bar, and 2 gate stops located as directed by the engineer.
4. Corner fittings for gate frames may be used in lieu of welding.
5. For 3' or 4' high gate, eliminate all horizontal bracing and attach truss rod to top of adjacent line post. Chain link fabric shall be 2" mesh, 11 gauge.
6. Gate shall have knuckled selvage top and bottom.
7. Top of concrete footing shall be crowned to shed water.

TYPICAL DOUBLE SWING GATE

SCALE: 3/8" = 1'-0"

SUPERSEDES R-21

COUNTY OF KAUAI
CITY & COUNTY OF HONOLULU
COUNTY OF MAUI
COUNTY OF HAWAII

TYPICAL DOUBLE GATE

SCALE: 3/8" = 1'-0"

MARCH 1991

STANDARD
DETAILS

R-21A